PERMIT

Issue Date: 06/23/93 Permit No. 062393BDW

Property Owner: DELBERT W. BIDDLE c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: JOHN KAMPFE EXCAVATION License No.:

____ New Installation ✓ Existing System

____ Repair ✓ Replacement ____ Extension ____ Other

Describe: NEW TANK AND ANY DRAINFIELD REPAIR REQUIRED ON INSPECTION

Parcel Description:

Legal: LOT 8 S4 T.28 R33

Address or Location: 17375 Hwy 56 TROY

Approved Design Criteria:

Septic Tank Size: 1000 gallons Drainfield Size: 180 lineal feet

Special Instructions: INSTALL ACCORDING TO LOT LAYOUT & SEPTIC SYSTEM REGULATION

Approved Site plan (Lot Layout) Attached

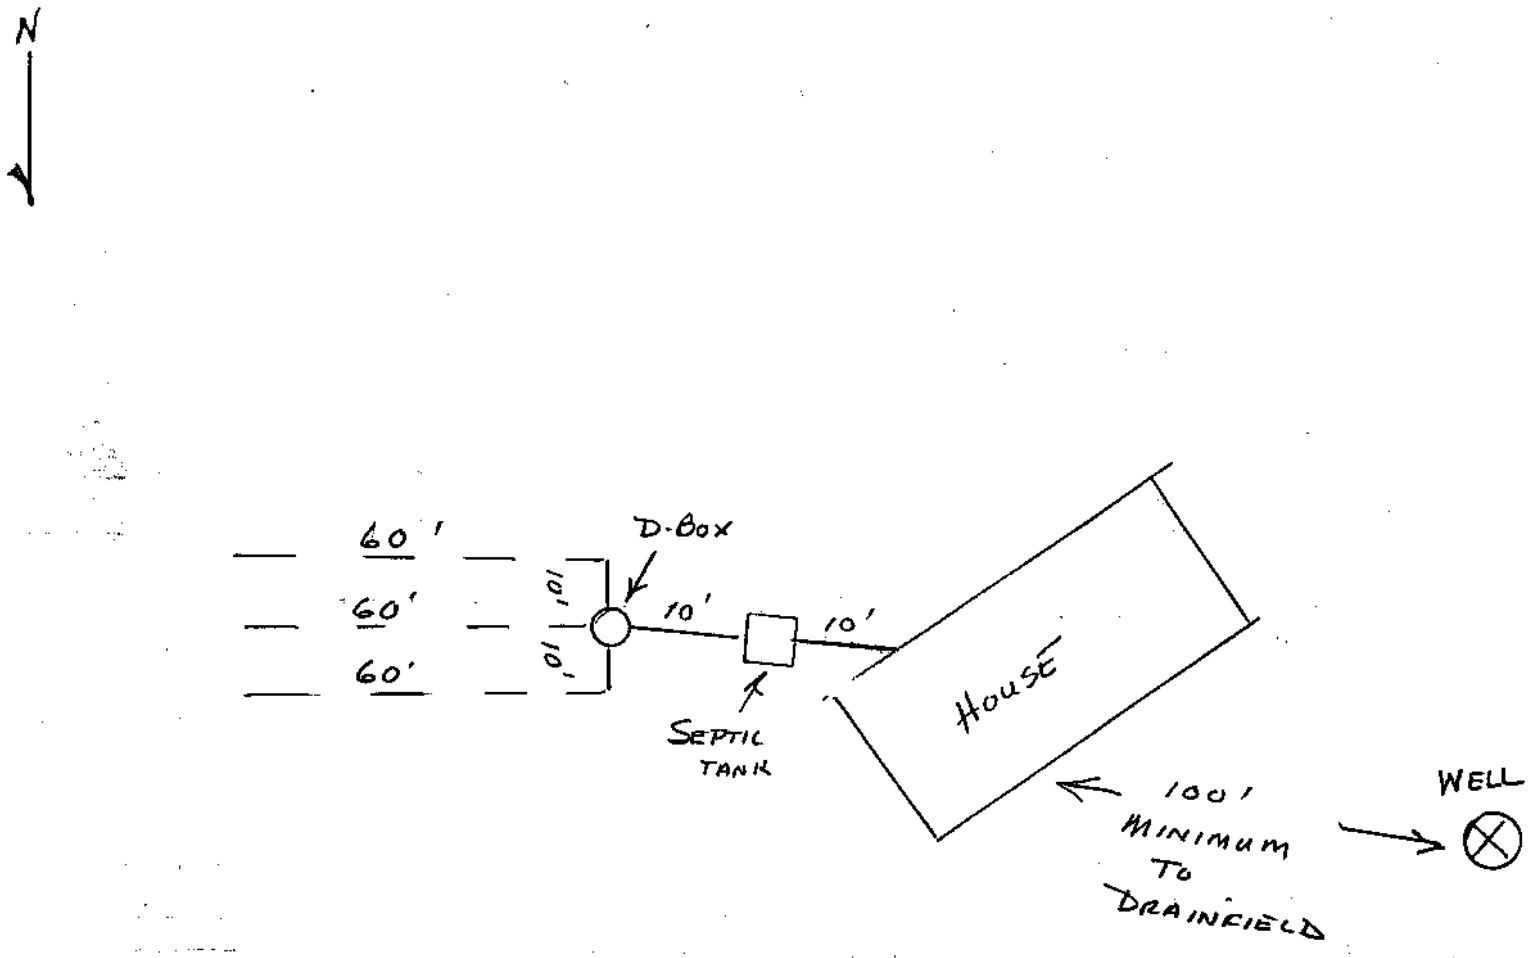
Issued By: [signature], RS

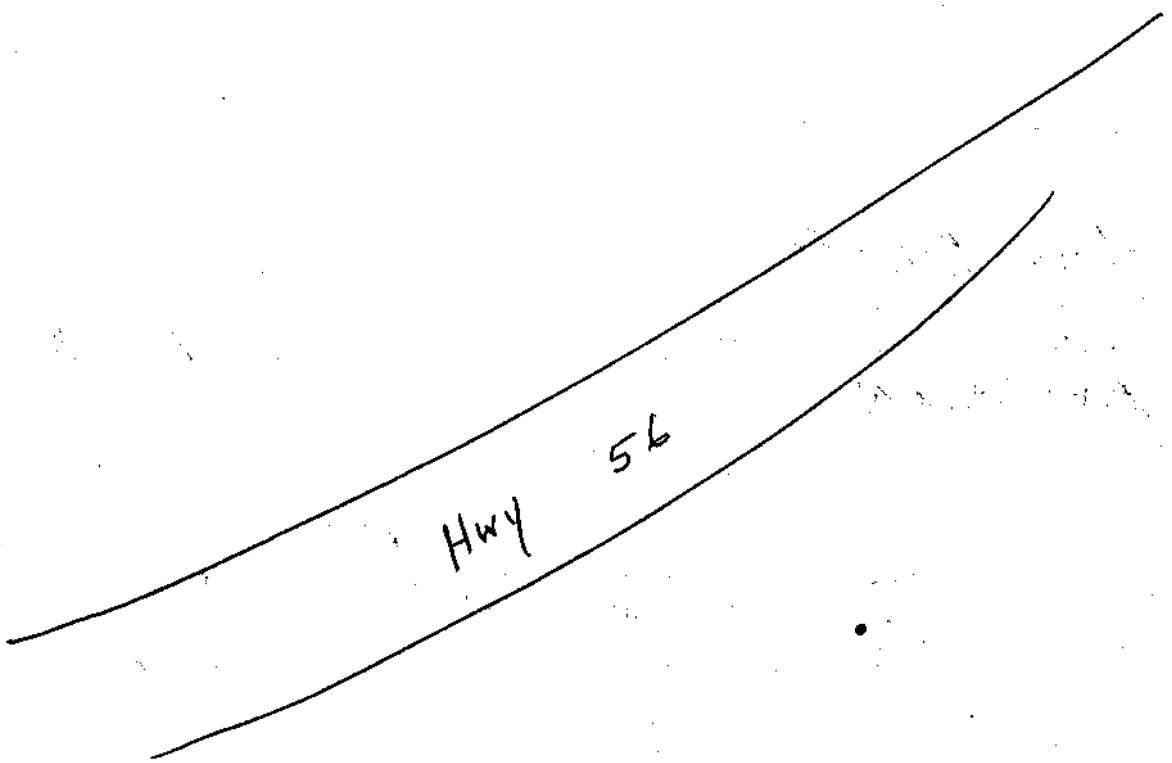
Closure Statement:

I, JOHN KAMPFE *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 10-1-93

Title: INSTALLER


N
60'
60'
60'
D-Box
10'
10'
10'
10'
SEPTIC TANK
HOUSE
100' MINIMUM TO DRAINFIELD
WELL


HWY 56