LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/31/05 Expiration Date: 09/01/06

Property Owner: Ron & Sharon Curtiss c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Larry Bowman License No. 75

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Pressure-dosed system, in 3-foot wide trenches, will be utilized.

Parcel Description:

Legal: S32 T29 R33 Lot12W in Upham Beach

Address or Location: 16052 Bull lake Highway

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 450 Square Feet

Dosing Chamber Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO DETAILS, LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lund, R.S.

Closure Statement:

I, Larry Bowman, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Larry Bowman *Date:* 18 Nov 05

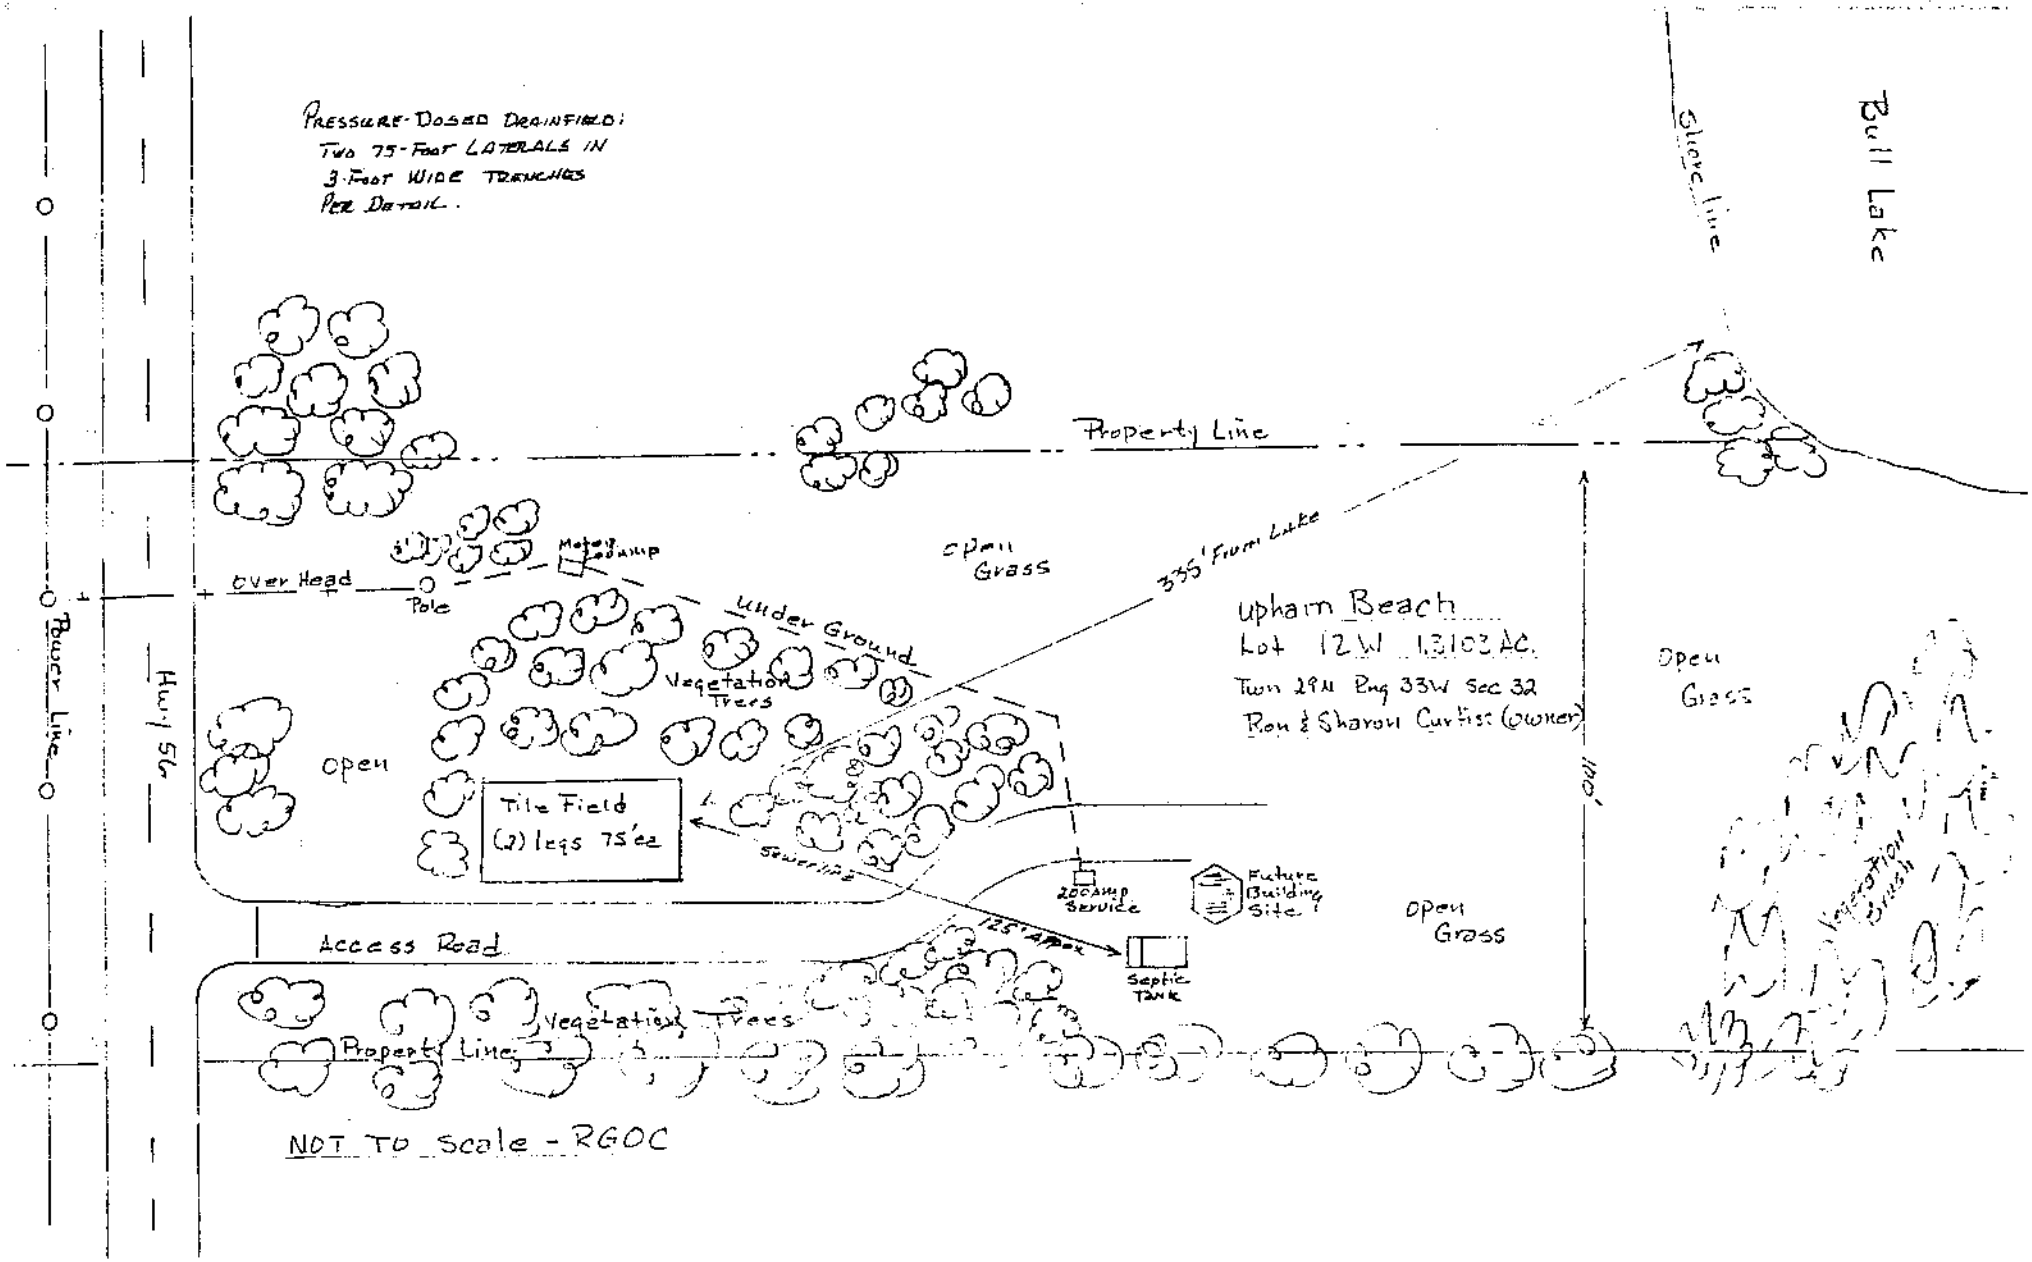
Title: Owner B-K Land Development & Construction

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Pressure-Dosed Drainfield:
Two 75-Foot Laterals in
3-Foot Wide Trenches
Per Detail.
Bull Lake
Glacier Line
Property Line
Motor & Pump
Over Head
Pole
Power Line
Hwy 56
Open
Grass
335' From Lake
Upham Beach
Lot 12W 1.3102 Ac.
Twn 29N Rng 33W Sec 32
Ron & Sharon Curtiss (owner)
Under Ground
Vegetation Trees
Open
Tile Field
(2) legs 75'ea
Sewer Line
200 amp Service
Future Building Site
Septic Tank
25' Approx
100'
Open
Grass
Access Road
Property Line
Vegetation Trees
Vegetation Brush
NOT TO Scale - RGOC