LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/15/05 Expiration Date: 08/16/06

Property Owner: Merritt E. Dutton c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Tallily Hoe License No. 01

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement _____ Extension _____ Other

Describe: Lift station will be installed.

Parcel Description:

Legal: S32 T29 R33 Lots 9E & 9W of Upham Beach

Address or Location: 16100 Bull Lake Road

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 140 Linear Feet

Lift Station Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

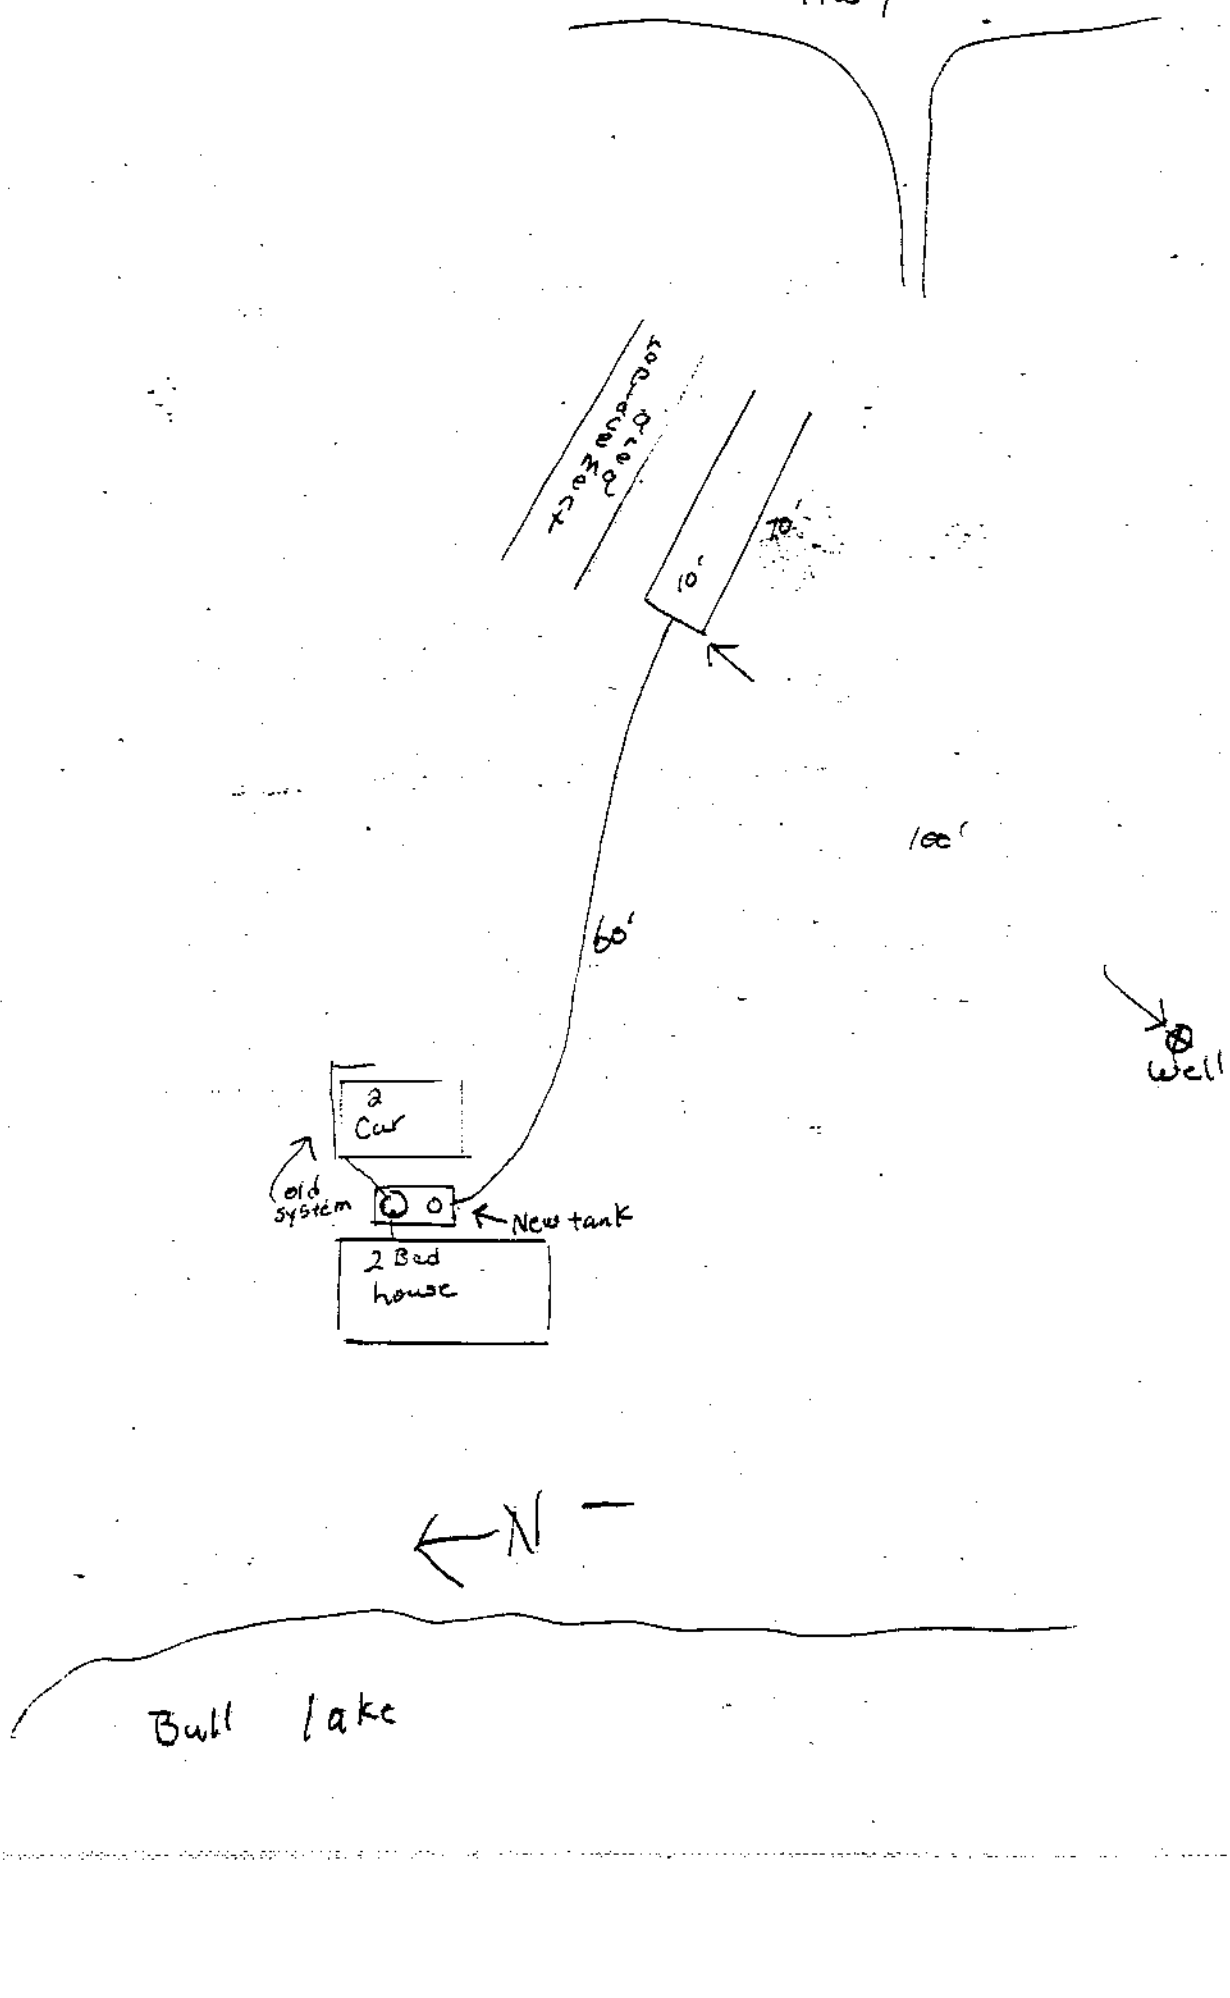
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Hwy 56
Driveway
10'
10'
100'
60'
well
2 Car
old system
New tank
2 Bed house
N
Bull lake