LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/21/2018 Expiration Date: 5/21/2019

Property Owner: Angel Island Association c/o: DJ Welch

Address: 976 Halo Drive, Troy, MT

Telephone: (Home) 334-1363 (Work)

Installer: DJ Welch License No. 155

___ New Installation __xx_ Existing System

___ Repair __xx_ Replacement ____ Extension ____ Other

Describe: Replacing Failed System with 14' by 42' adsorption bed for clubhouse.

Parcel Description:

Legal: S29 T29 R33

Address or Location: Angel Island, Block 1 Lots 12 & 13

Geo/Assessors code: 0000005669

Approved Design Criteria:

470 gallons/day Septic Tank Size: 1000 gallons Drainfield Size: 588 SQ Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Dustin Welch, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 7-20-18

Title: _____

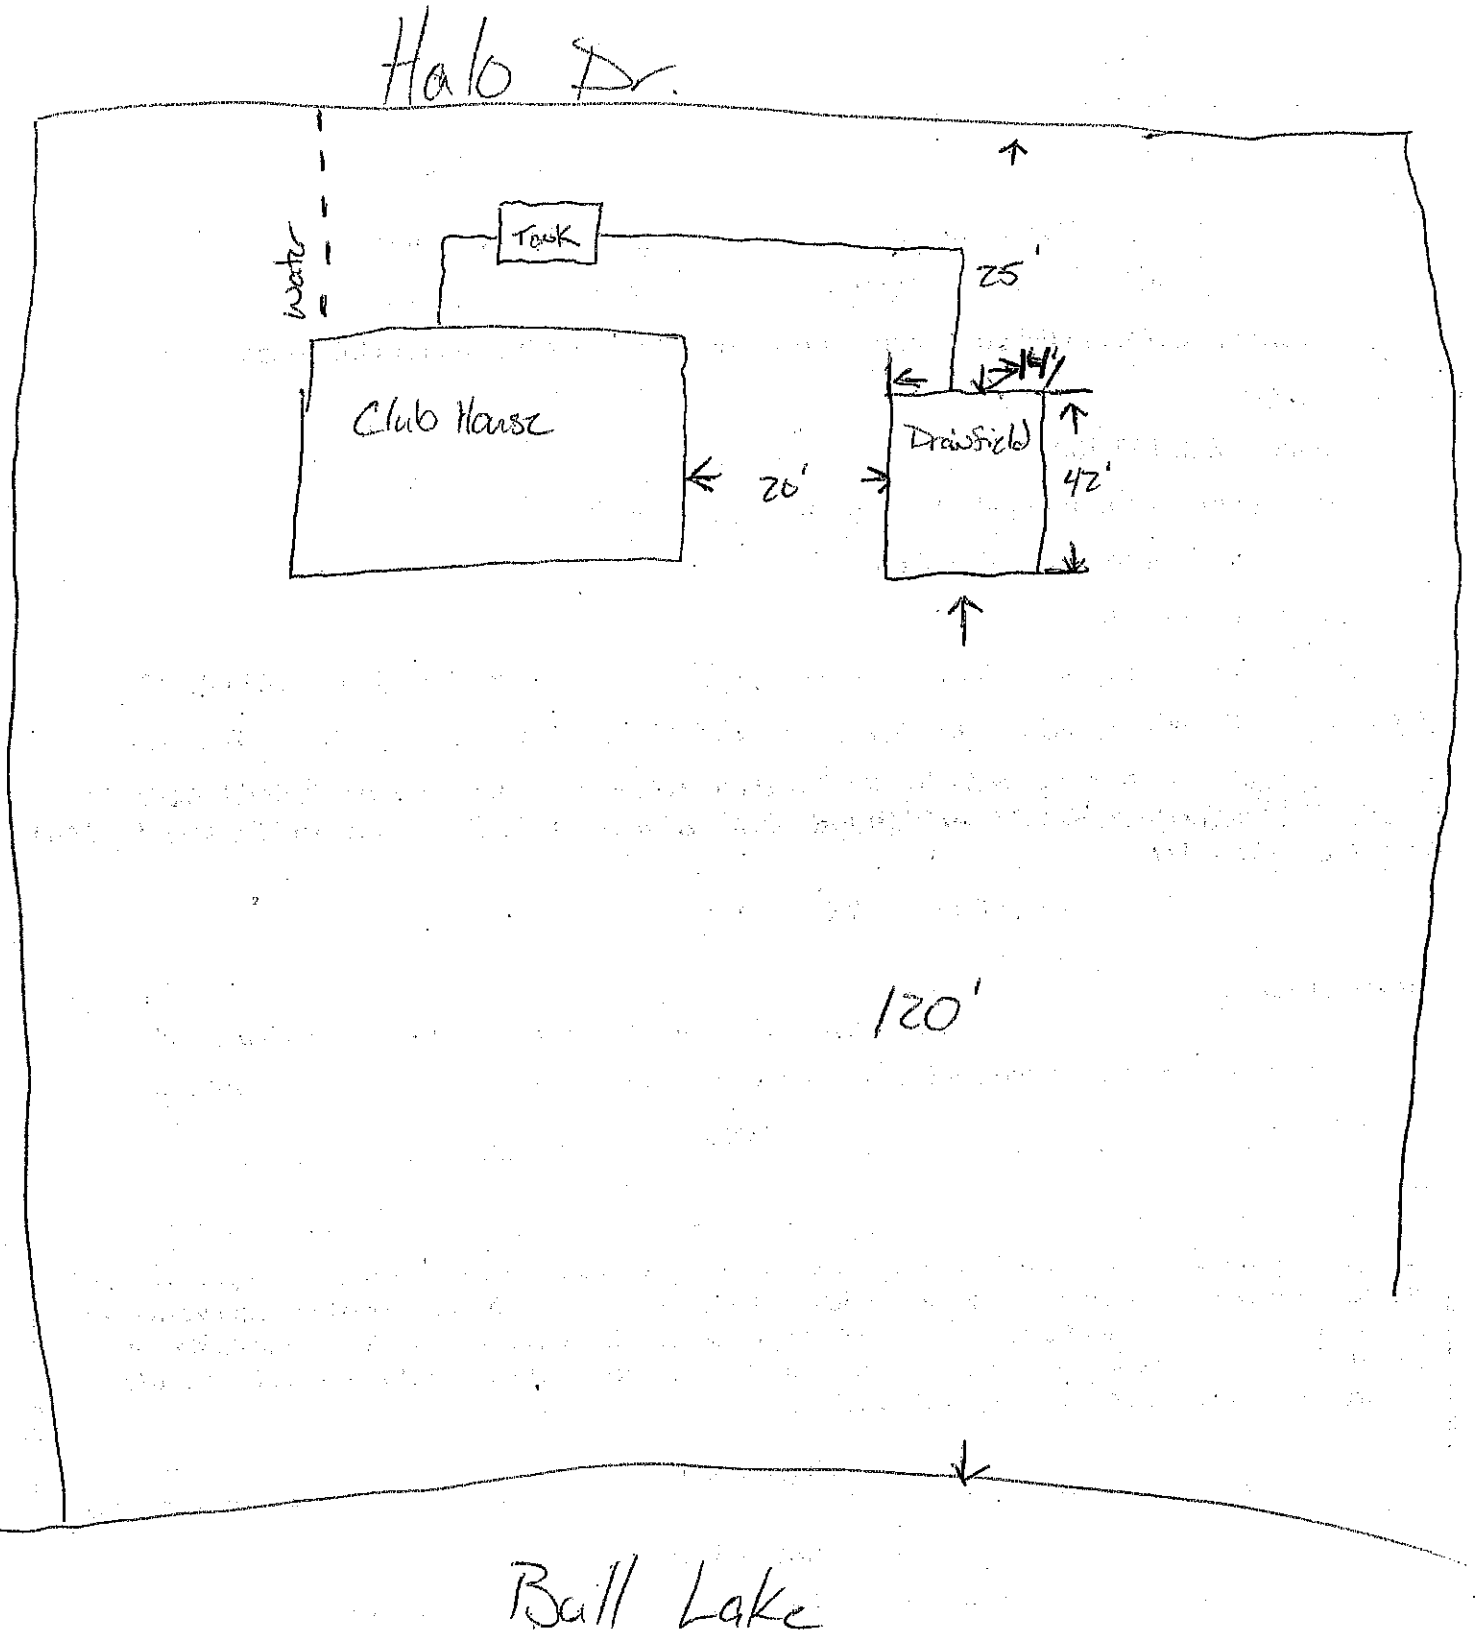
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Halo Dr.
water
Tank
25'
Club House
20'
Drainfield
14'
42'
120'
Ball Lake