New

SEPTIC TANK PERMIT
for
LINCOLN COUNTY

Permit Sent _____

Date AUGUST 18, 1978

Phone [redacted]

Property Owner J.P. BINGHAM Address [redacted]


Lot, Block Number, or legal description of Property ANGEL BLANO LOTS 30-31 Block 1

To be built by: WARRINGTON Square feet absorption area. 450 sq. ft.

Septic Tank Size 1000 gal# of bedrooms 3 Water Supply COMMON WELL


Description of Absorption Area: Dig a bed at least 30' in length x 15' wide x 2½' deep according to lot layout. Grade of pipe should be level throughout the bed

Sketch; Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

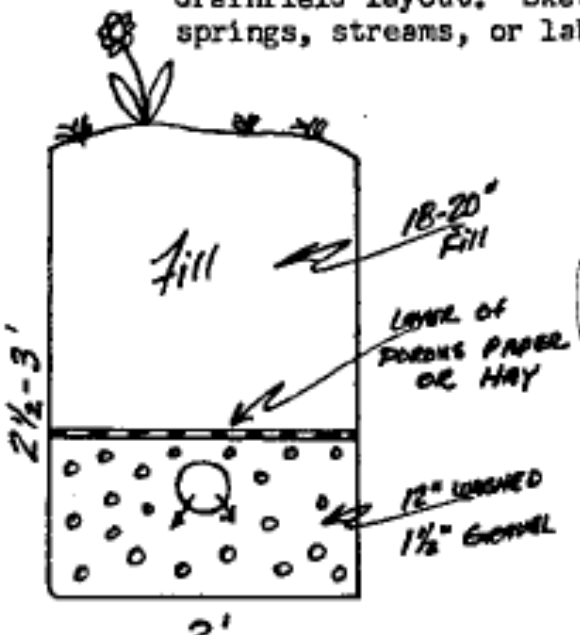

DITCH DIAGRAM

LOT LAYOUT

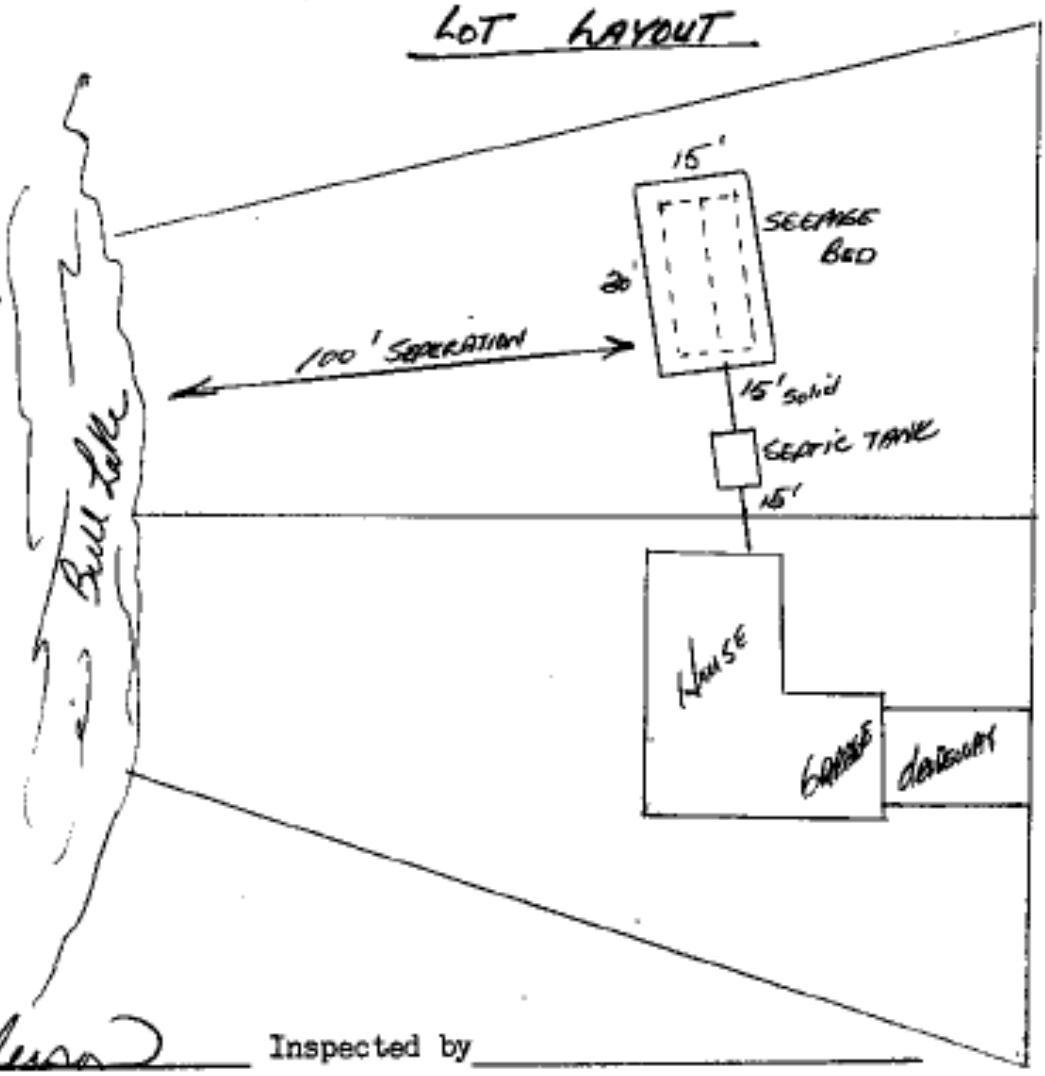

SOIL: Sandy clay w/ mixed gravels

SLOPE: 1-3%

Issued by Ron Anderson Inspected by _____

Date August 18, 1978