# LINCOLN COUNTY HEALTH DEPARTMENT
# ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/09/2022 (rev 3/20/2023) Expiration Date: 8/08/2023

Property Owner: Glen & Betty Crammer

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: licensed installer required - TBD License #:

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: pressure dosed system with 3' wide chambers, add 500 gallon dose tank

*Parcel Description:*

Legal: Angel Island Blk 2, Lot 9, S29 T29N R33W, 0.509 acres

Property Address: 83 Halo Ct S, Troy, MT 59935 Assessment Code: 5709

*Approved Design Criteria:*

# of Bedrooms: 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 216 square feet

# of Laterals: 2 Length of Laterals: 36 lineal feet Trench Depth: 24 - 36 inches

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!**

*Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 25% reduction given for infiltrators. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.*

**Issued By:** *Kathi J. Hooper, R.S.*

**NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

Closure Statement:

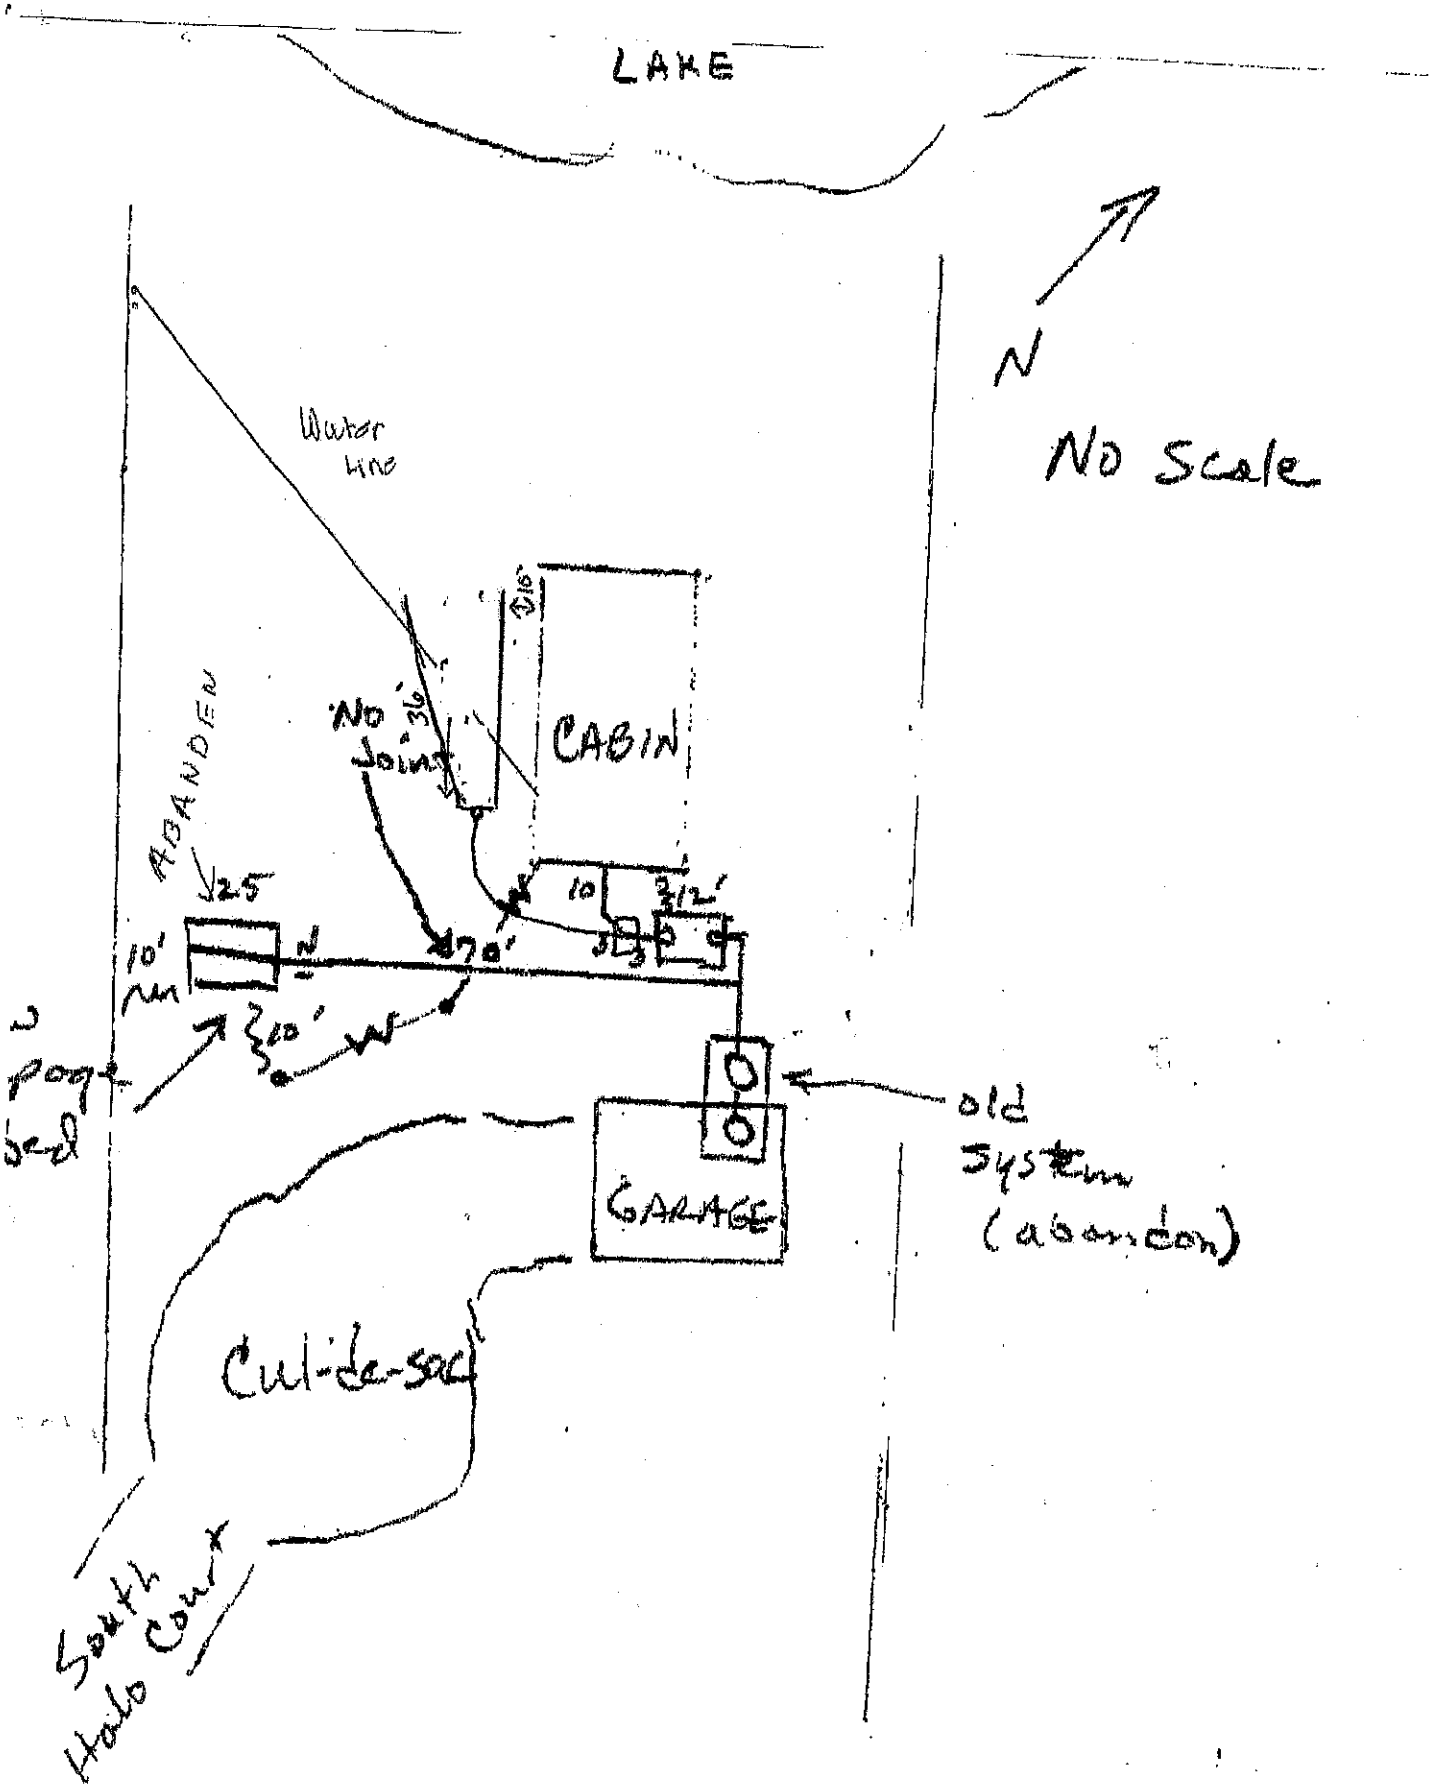
*This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* 3/22/23

_____ Lincoln County Health Department (LCHD) X Licensed Installer w/ approval of LCHD

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LAKE
N
No Scale
Water Line
ABANDON
25'
No Joint
36'
CABIN
16'
10'
3 1/2'
70'
10'
N
10' W
3 pool bed
old system (abandon)
GARAGE
Cul-de-sac
South Hollo Court