SEPTIC TANK PERMIT
for
LINCOLN COUNTY

Permit Sent _____

Date Sept. 5, 1975

Phone [redacted]

Property Owner D. Graven Address [redacted]


Lot, Block Number, or legal description of Property Lot 57 & Block 1 Clear

To be built by: Oedewalt Square feet absorption area. ~~130~~ 2600 ft.


Septic Tank Size 1000 gal # of bedrooms 2 Water Supply Common Well.

Description of Absorption Area: Dig a ditch 130' in length x 2' wide x 2½'-3' deep according to lot layout and ditch diagram - Keep pipe fairly level - about ½ bubble drop in each 10' length -

Sketch; Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

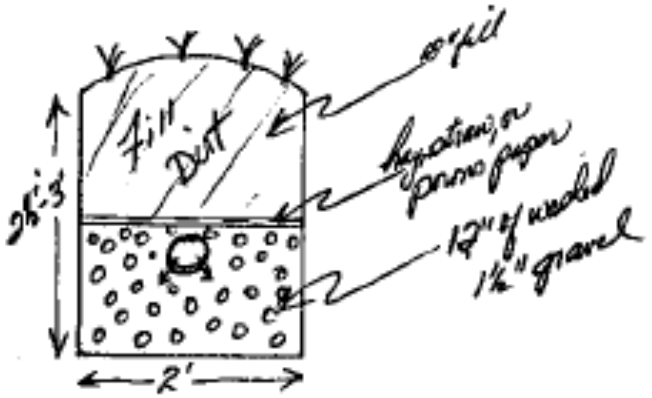

ditch diagram

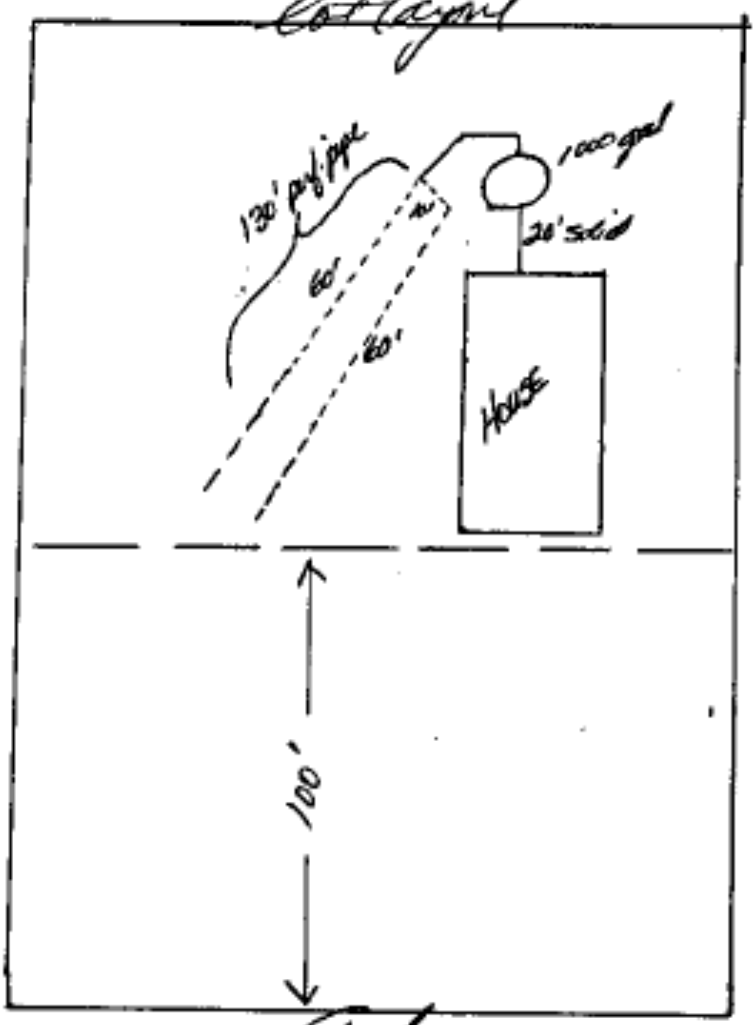

Soil: Clay

Issued by Ron Anderson Inspected by Anderson Lake

Date Sept. 5, 1975