Lic Installer
Sign & Return

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: March 8, 2004 Expiration Date: March 8, 2005

Property Owner: James and Louise Hopkins c/o:

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Tally Hoe License No. 1

Proposed Work: (Check One) _X_ New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe:

Parcel Description:

Legal: Angle Island, Sec 29, T 29N, R 33W

Address or Location: 94 Halo Drive

Approved Design Criteria: Standard Absorption Trenches

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 225 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: RS

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 4-27-04

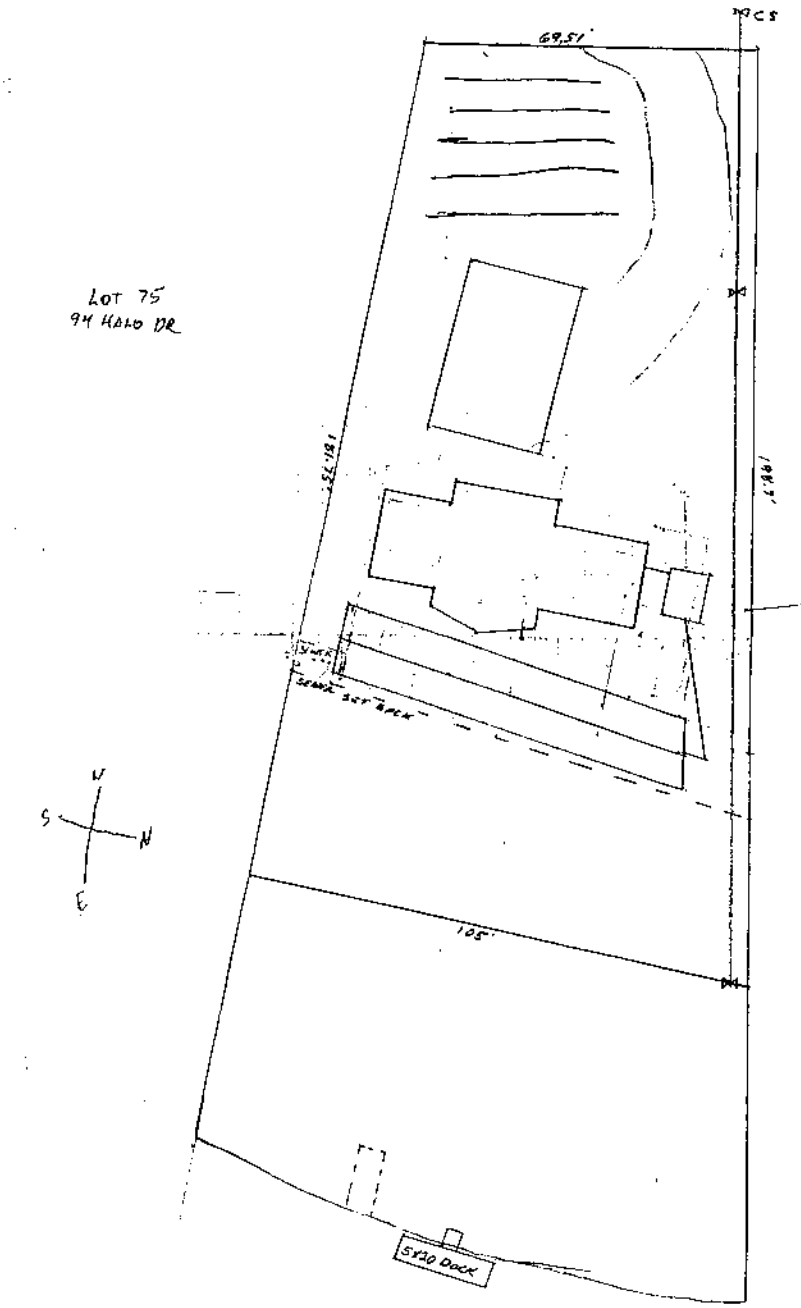
Title:

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT 75
94 HALO DR
69.51'
185.18'
185'
15' MIN
SEAWALL SET BACK
105'
5'x20' Dock
W
S
N
E