LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/25/2018 Expiration Date: 6/25/2019

Property Owner: Paul Jones c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: License No. ///

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' laterals using gravelless chambers size reduced per 0.8 app rate.

Parcel Description:

Legal: S32 T29 R33

Address or Location: Gordon Beach Lot 8

Geo/Assessors code: 0000014725

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 252 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Keith Mack, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

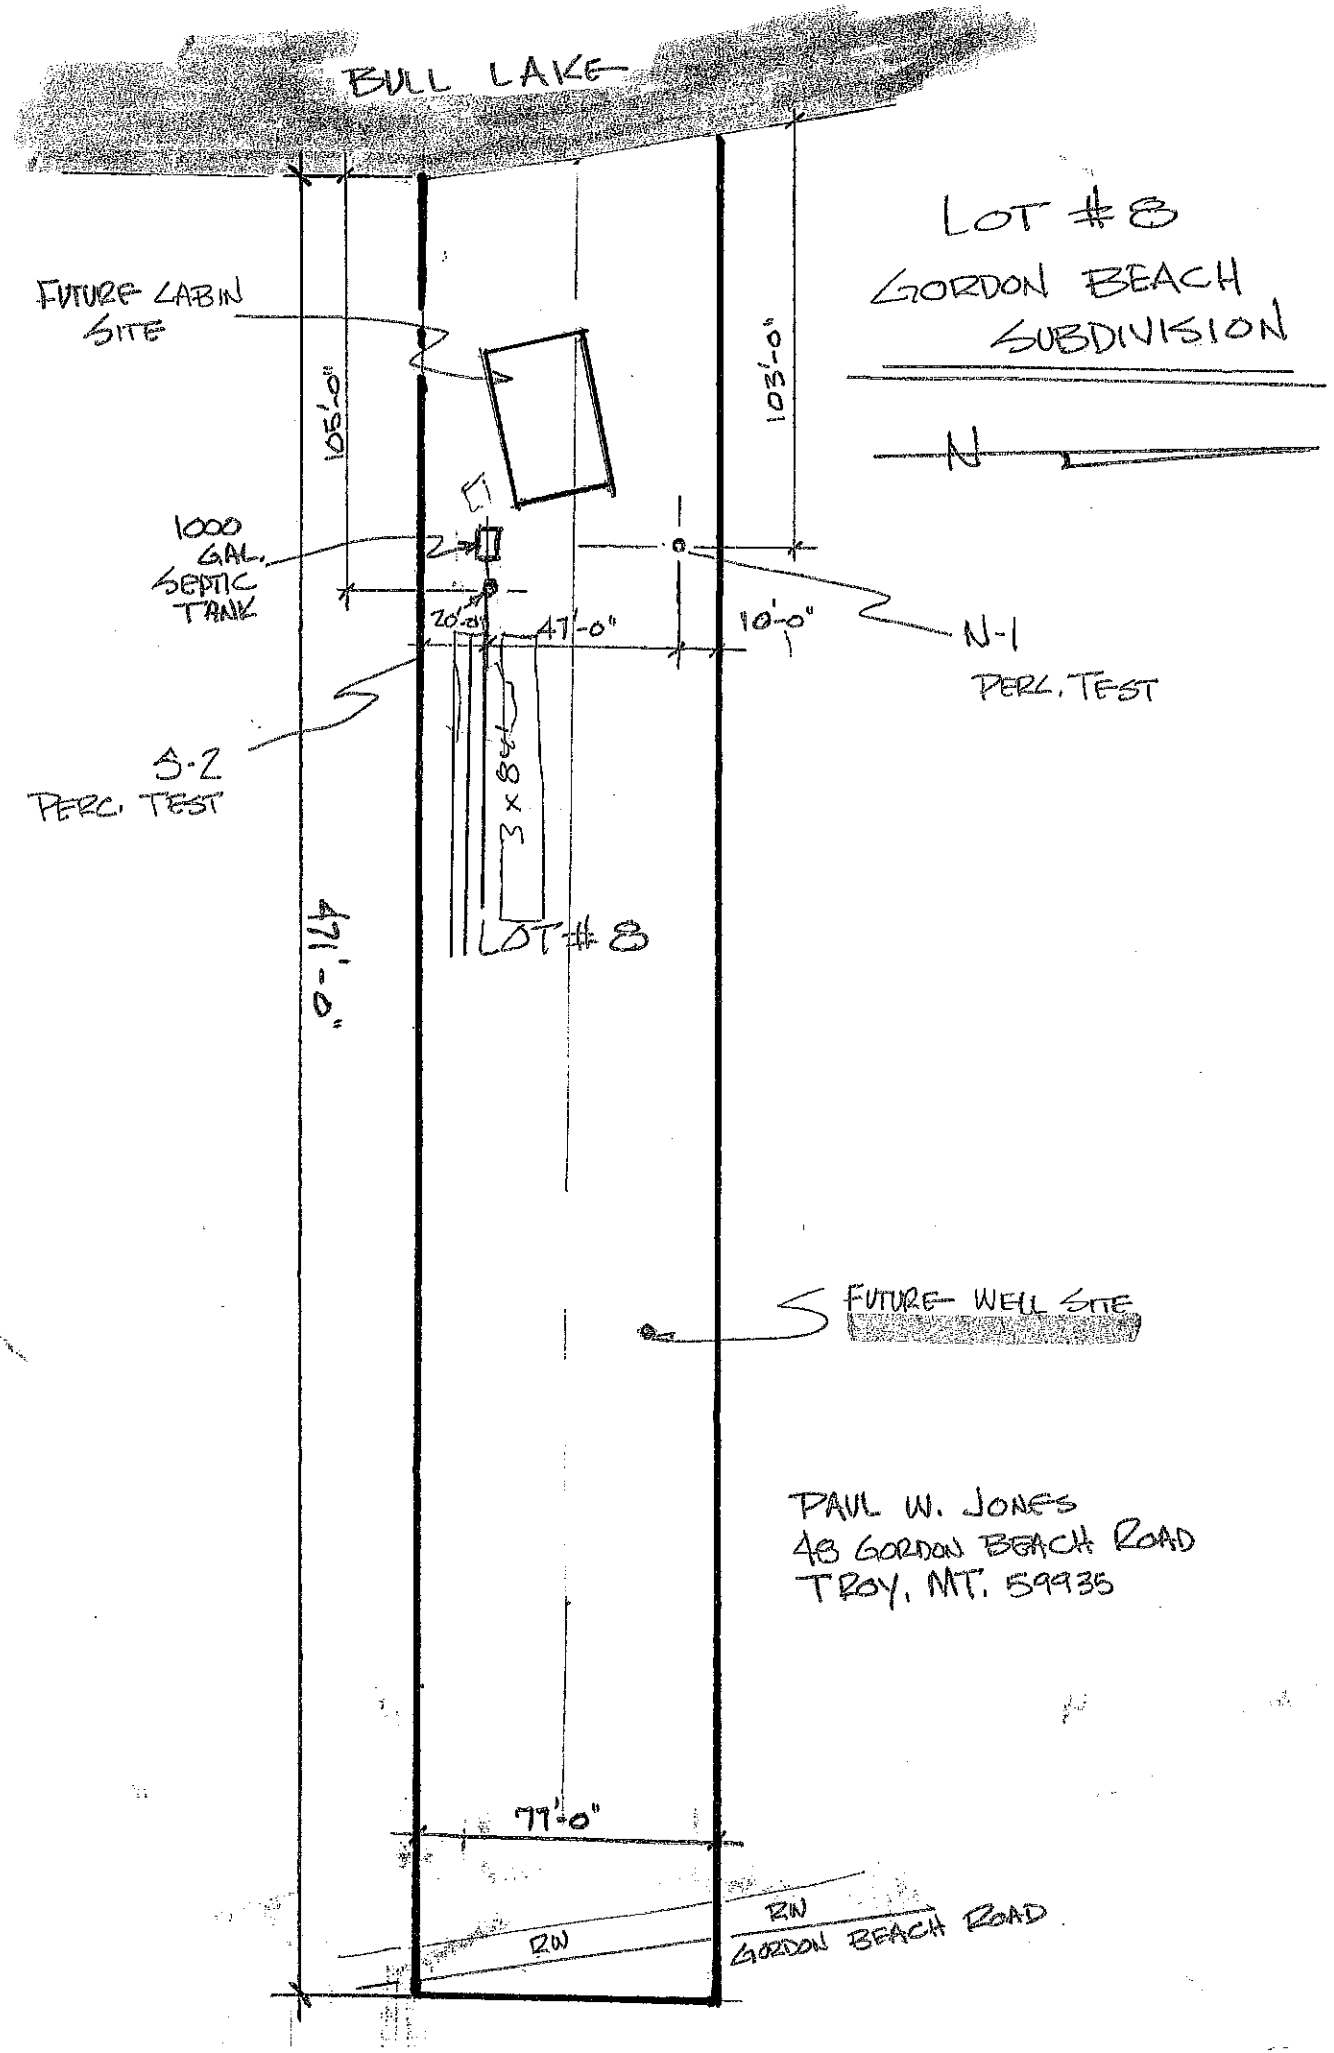
Signed: [signature] *Date:* 6-13-19

Title: Mack Excavating Owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


BULL LAKE
LOT #8
GORDON BEACH
SUBDIVISION
N
FUTURE CABIN SITE
105'-0"
103'-0"
1000 GAL. SEPTIC TANK
20'-0"
47'-0"
10'-0"
N-1
PERC. TEST
S-2
PERC. TEST
3 x 84'
LOT #8
47'-0"
FUTURE WELL SITE
PAUL W. JONES
48 GORDON BEACH ROAD
TROY, MT. 59935
77'-0"
RW
RW
GORDON BEACH ROAD