# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/06/2012 Expiration Date: 06/07/2013

Property Owner: Alfred (Sam) & Fran McCully c/o: Brett McCully

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: License No.

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "drainfield size" below.

*Parcel Description*:

Legal: Block 1 Lot 26 of Angel Island

Address or Location: 802 Halo Drive

*Approved Design Criteria*:

# Bedrooms: 2 Existing Septic Tank Size: 750 gallons Drainfield Size: 108 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** *Kendra J. Lind, R.S.*

Closure Statement:

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* _____

*Title:* _____

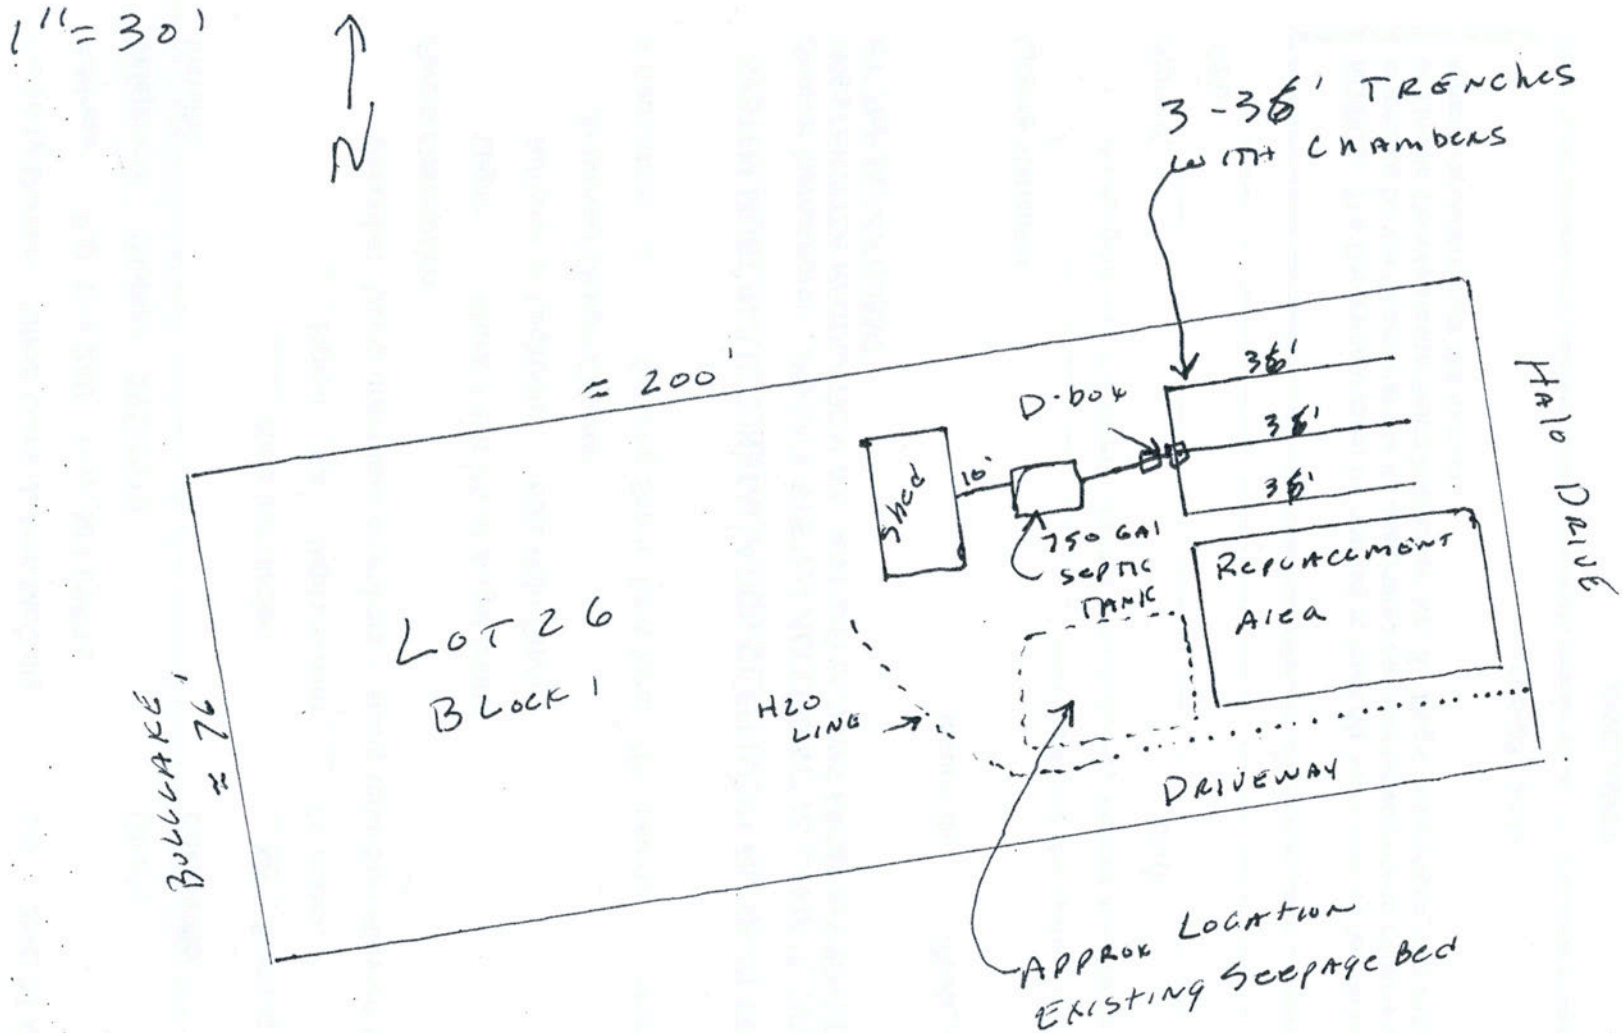
**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly

LOT LAYOUT


1" = 30'
N
3 - 35' TRENCHES
WITH CHAMBERS
≈ 200'
D-box
35'
35'
35'
Shed
10'
750 GAL
SEPTIC
TANK
REPLACEMENT
AREA
HALO DRIVE
LOT 26
BLOCK 1
H2O
LINE
DRIVEWAY
BULLCREEK
≈ 76'
APPROX LOCATION
EXISTING SEEPAGE BED