LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/29/2014 Expiration Date: 10/30/2015

Property Owner: William & Diana Miller c/o:

Address:

Telephone: (Home) (Work)

Installer: Terry Oedewaldt License No. 2

____ Direct Connection _____ Grinder Pump Connection __XX__ Lift Tank Connection

Describe: Sewer line connection to sewer main for approved community drainfield

Parcel Description:

Legal: S29 T29 R33

Address or Location: Lot 28 in Bull Lake Estates

Approved Design Criteria:

Septic Tank Size: 1000 gallons Pump Tank Size: 500 gallons

Special Instructions: INSTALL LIFT-TANK AND LINE CONNECTION TO THE MAIN SEWER LINE FOR THE BULL LAKE ESTATES COMMUNITY DRAINFIELD ACCORDING TO THE LOT LAYOUT AND DEQ APPROVAL STATEMENT. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.

Signed: _____ *Date:* _____

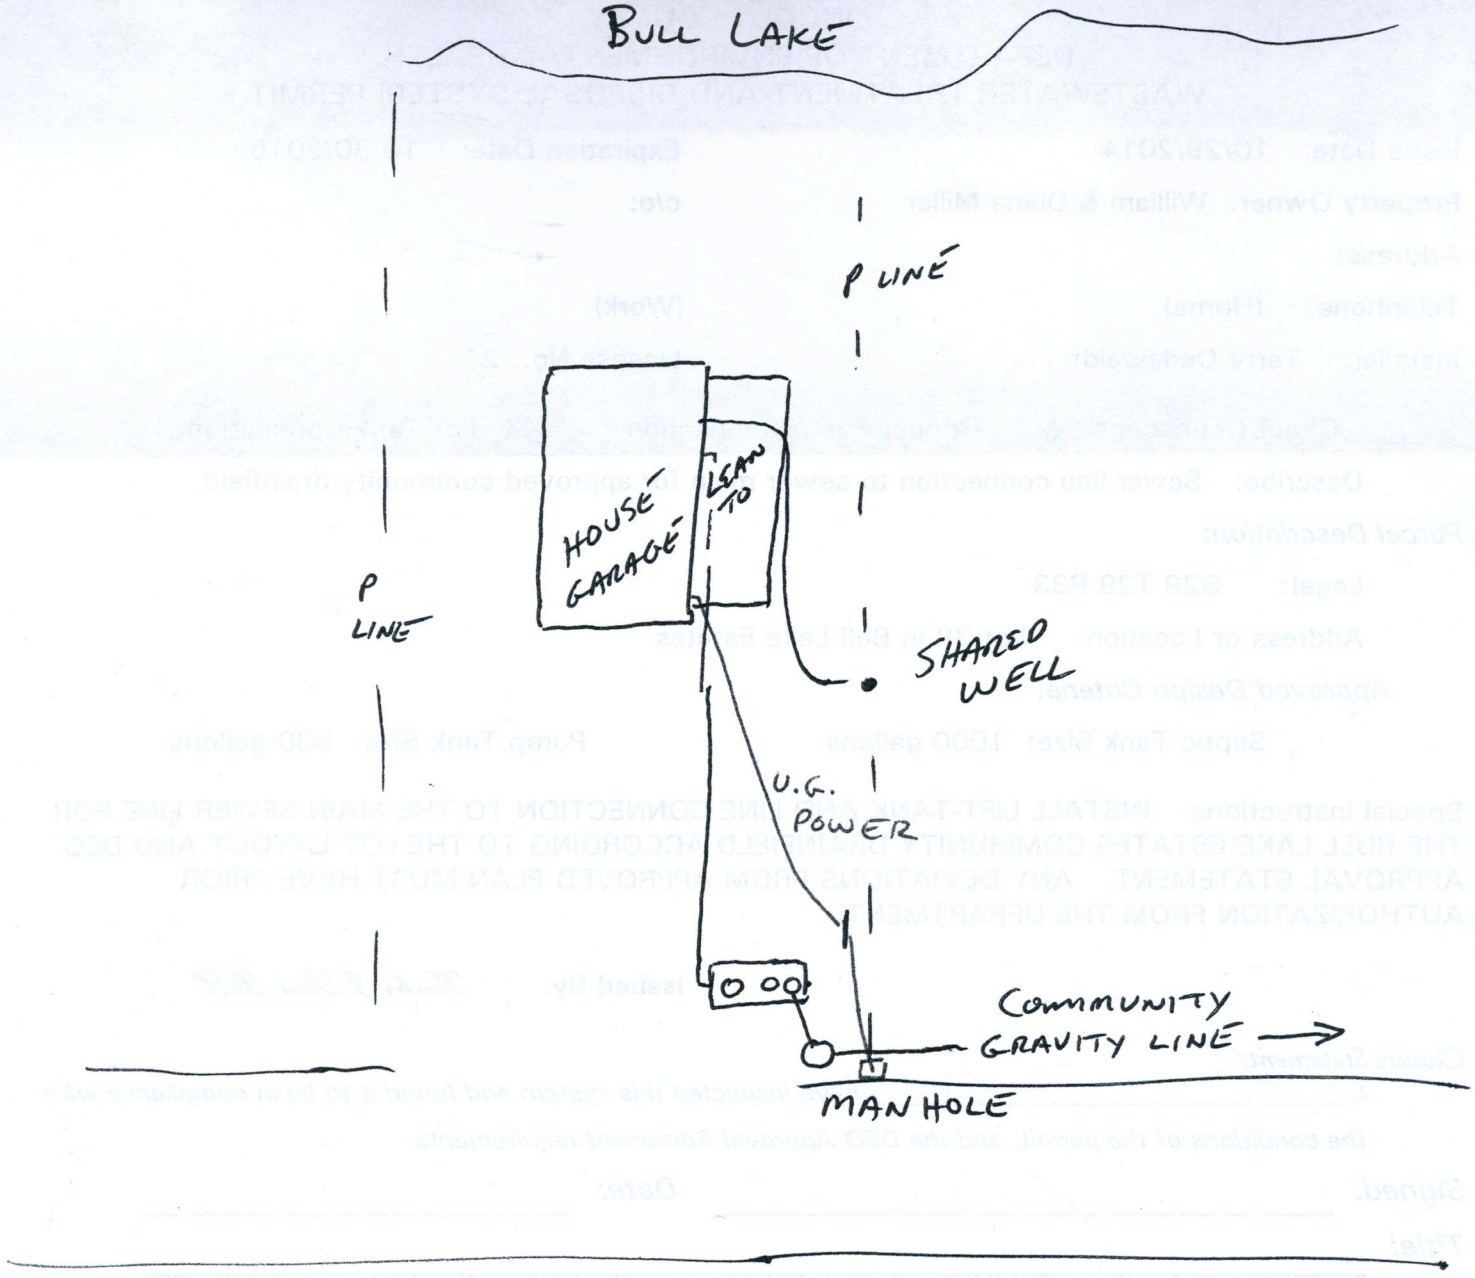
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.


BULL LAKE
P LINE
P LINE
HOUSE GARAGE
LEAN TO
SHARED WELL
U.G. POWER
COMMUNITY GRAVITY LINE
MAN HOLE