# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/27/04 Expiration Date: 05/28/05

Property Owner: Steven R. Munyan c/o: LeRoy Corning

Address: [redacted]

Telephone: [redacted] (Work)

Installer: License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe:

*Parcel Description*:

Legal: Block 1 Lot 72 --- Angel Island

Address or Location: 134 Halo Drive

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 234 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Kendra J. Lind, R.S.

Closure Statement:

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* _____

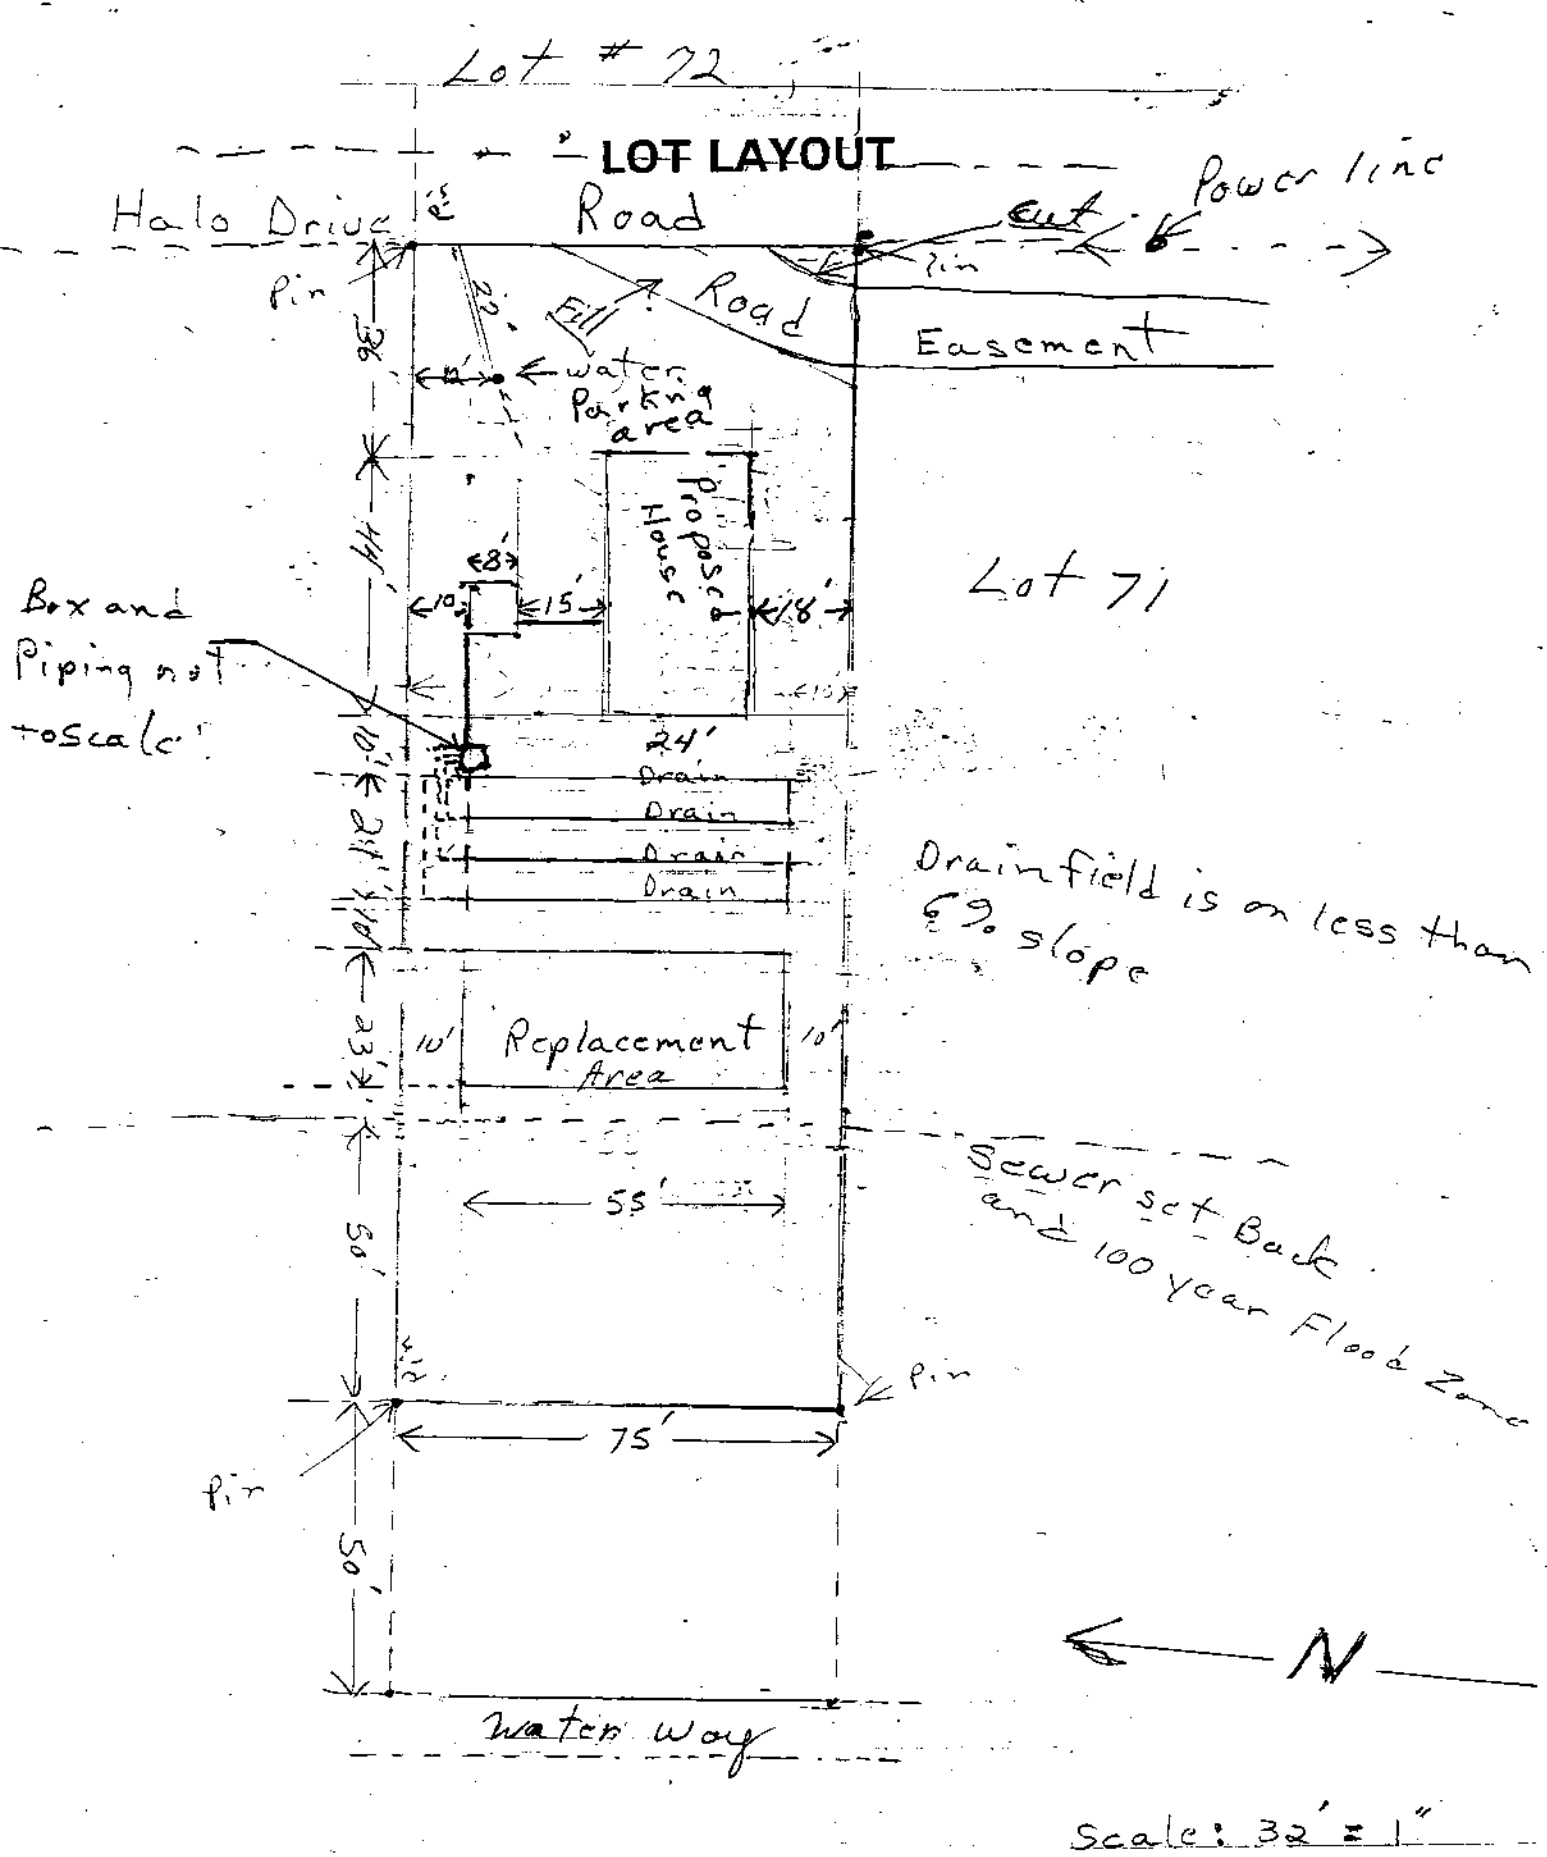
*Title:* _____

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-293-7781**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lot # 72
LOT LAYOUT
Halo Drive
Road
Power line
cut
Pin
Pin
Road
Fill
Easement
22'
water
Parking area
Proposed House
Lot 71
8'
10'
15'
18'
Box and Piping not to scale
24'
Drain
Drain
Drain
Drain
Drainfield is on less than 5% slope
10'
Replacement Area
10'
33'
55'
50'
Sewer set Back and 100 year Flood Zone
Pin
75'
Pin
50'
N
Water Way
Scale: 32' = 1"