LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/30/03 Expiration Date: 10/31/04

Property Owner: Neil Odegard c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Tally Hoe License No. 1

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Pressure-dosed system, using ME-50 Pump will be required. Septic Tank & Pumping Station will be permanently installed at a later date and must be separately signed off on closure statement.

Parcel Description:

Legal: S29 T29 R33 Lot 2 of Roberts Bull Lake Lots
Address or Location: 14988 Bull Lake Road

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 375 Square Feet
Pumping Bay Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO ENGINEER'S PLAN, LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Drainfield Closure Statement:

I, _____, have inspected this pressure-dosed drainfield installation and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: *Date:*

Title:

Septic Tank/Pumping Station Closure Statement:

I, _____, have inspected this pressure-dosed drainfield installation found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: *Date:*

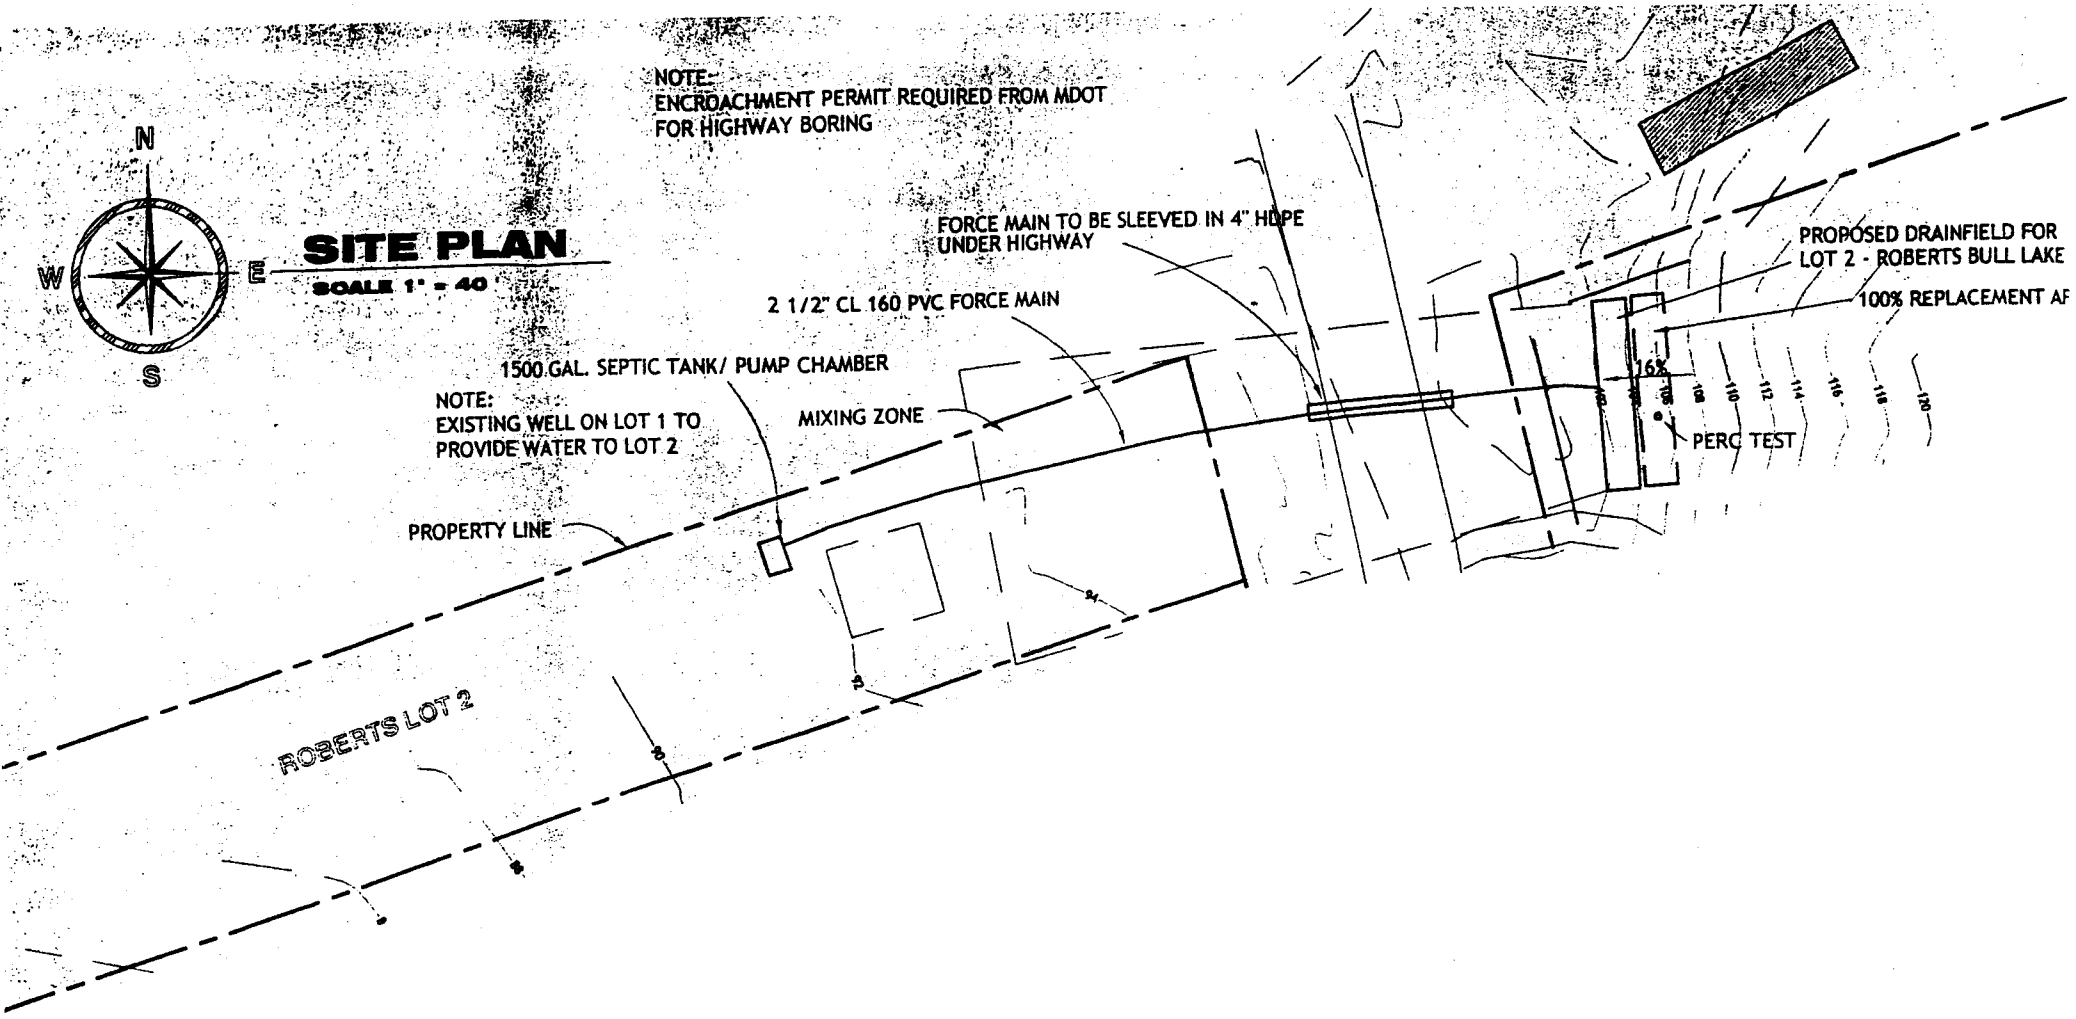
Title:

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
W
E
S
SITE PLAN
SCALE 1" = 40'
NOTE:
ENCROACHMENT PERMIT REQUIRED FROM MDOT
FOR HIGHWAY BORING
FORCE MAIN TO BE SLEEVED IN 4" HDPE
UNDER HIGHWAY
2 1/2" CL 160 PVC FORCE MAIN
1500 GAL. SEPTIC TANK/ PUMP CHAMBER
NOTE:
EXISTING WELL ON LOT 1 TO
PROVIDE WATER TO LOT 2
MIXING ZONE
PROPERTY LINE
ROBERTS LOT 2
PROPOSED DRAINFIELD FOR
LOT 2 - ROBERTS BULL LAKE
100% REPLACEMENT AF
16%
PERC TEST