PERMIT

Issue Date: 6-28-00 Expiration Date: 6-28-01

Property Owner: NEIL & MARTHA ODEGARD

Address: C/o Oedewaldt Const. [redacted]

Telephone: (Home) 295-0812 (Work) [redacted]

Installer: Terry Oedewaldt License No. 2

✓ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 2 bdrm expansion

Parcel Description:

Legal: Roberts Subdiv. Lot 1 S29 T29N R33W

Address or Location: 14988 BULL LAKE ROAD, TROY, MT 59935

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1500 gallons Drainfield Size: 130 lineal feet

INSTALL SYSTEM AS PER APPROVED SITE PLAN (LOT LAYOUT) AND LINCOLN COUNTY WASTEWATER REGULATION #3.

Special Instructions: Sandlined drainfield required. Install lift station as per Lincoln Co. Wastewater Rules.

Issued By: Johnnie Peterson, RS

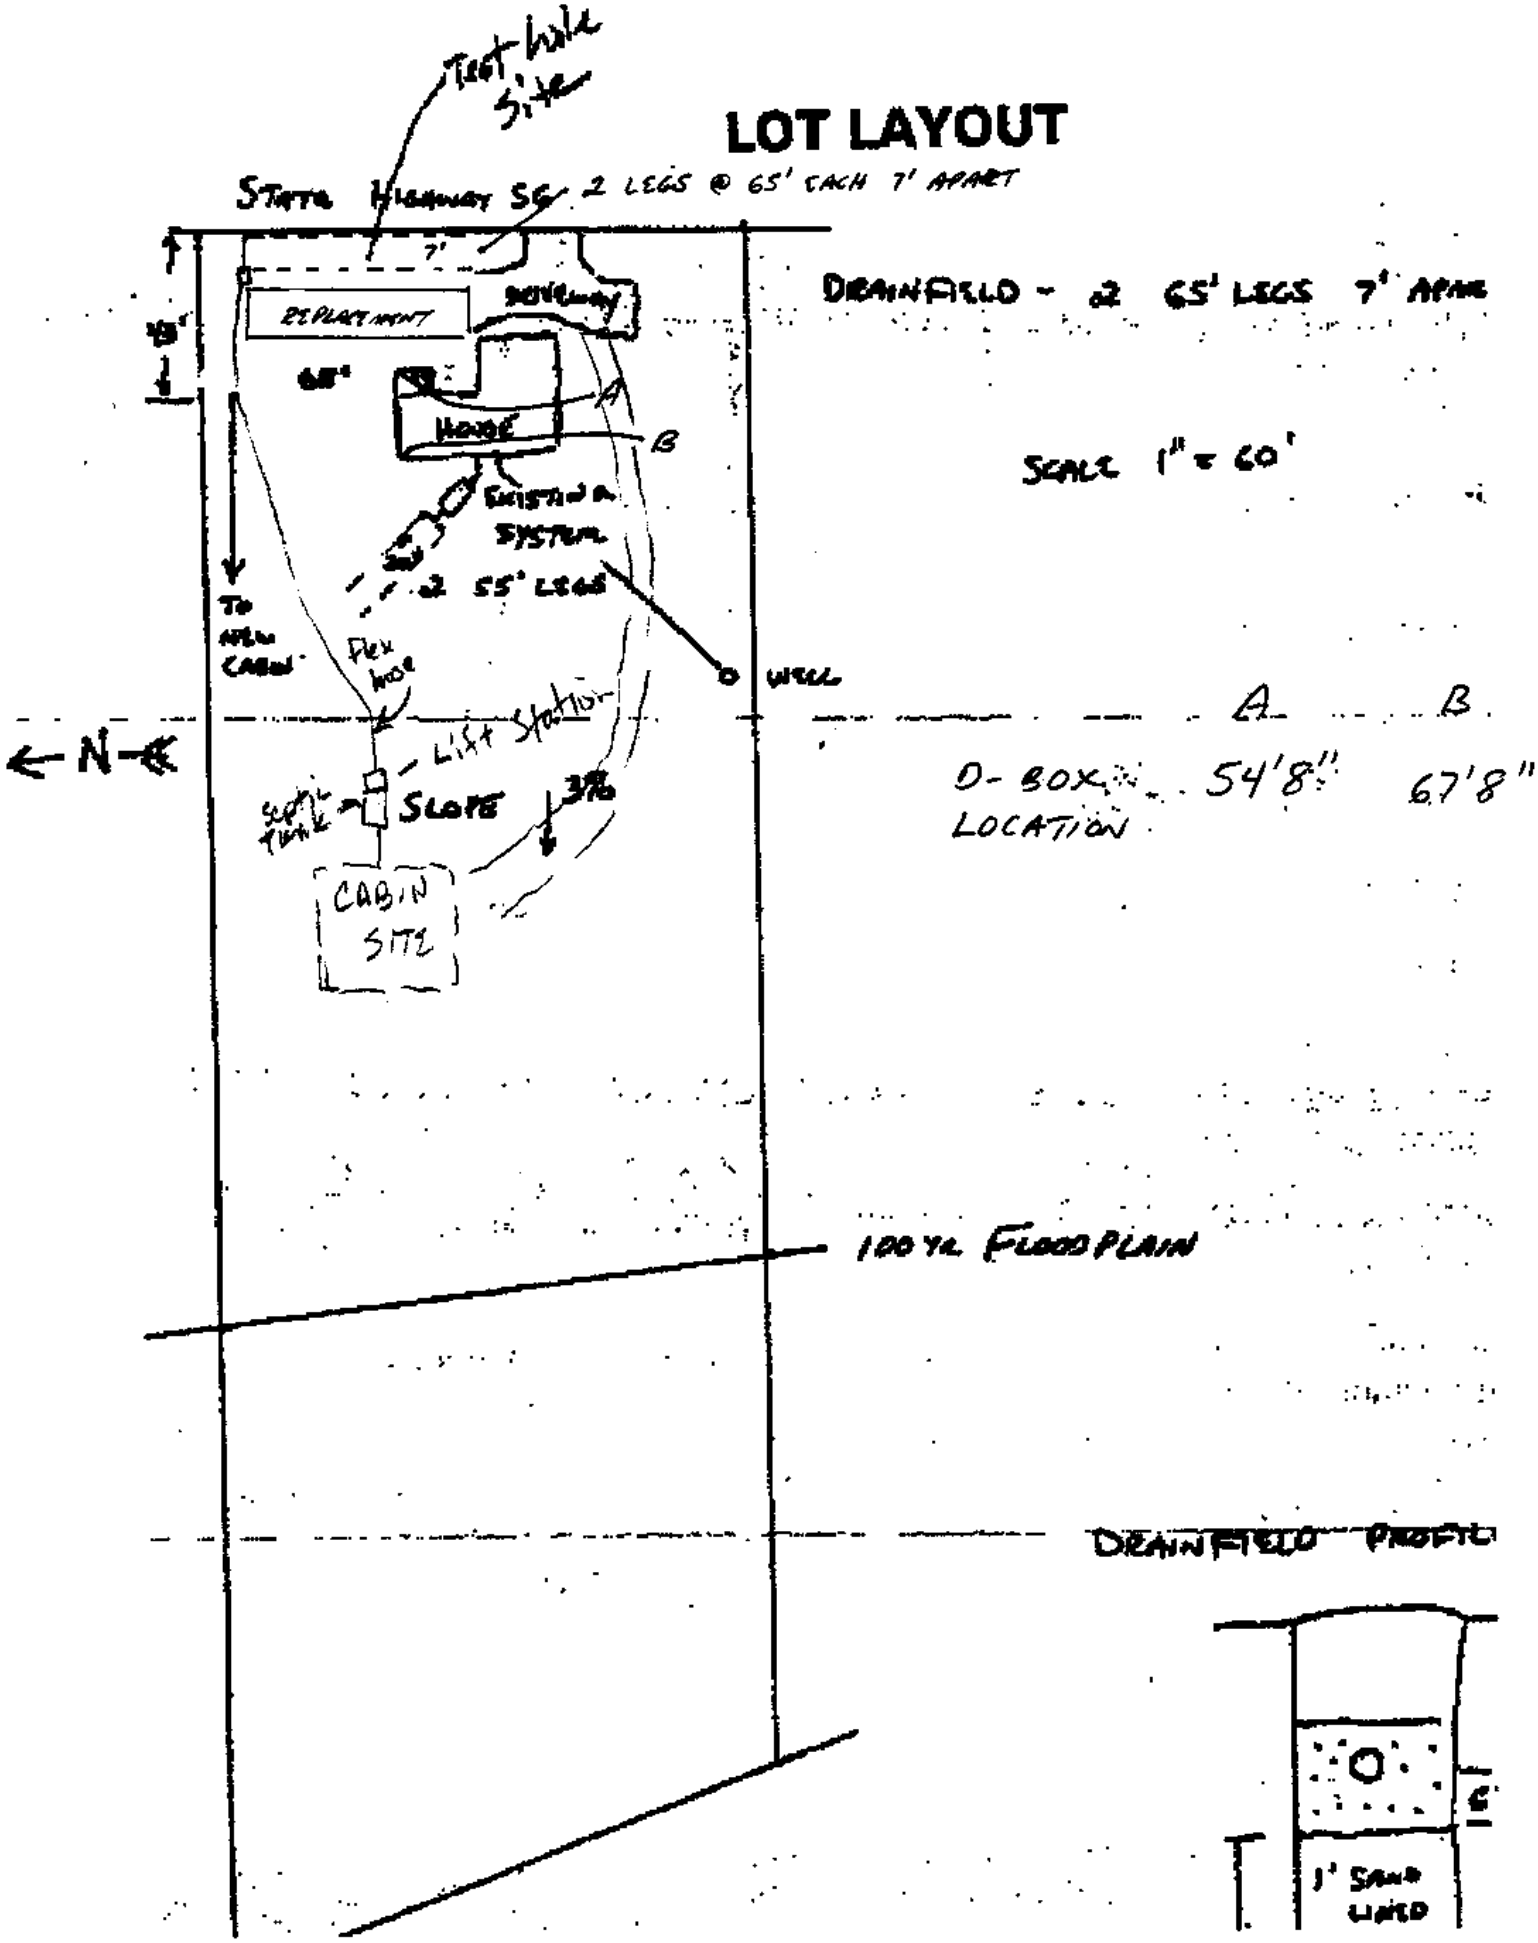
Closure Statement:

I, Terry J. Oedewaldt, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 5/2/01

Title: Contr.

LOT LAYOUT


Test hole Site
STATE HIGHWAY SG
2 LEGS @ 65' EACH 7' APART
7'
REPLACEMENT
DRIVEWAY
65'
HOUSE
A
B
EXISTING SYSTEM
2 55' LEGS
DRAINFIELD - 2 65' LEGS 7' APART
SCALE 1" = 60'
TO NEW CABIN
Flex hose
WELL
A
B
Lift Station
N
SEPTIC TANK
SLOPE
3%
O-BOX LOCATION
54'8"
67'8"
CABIN SITE
100 YR. FLOOD PLAIN
DRAINFIELD PROFILE
1'
1' SAND LINED