LINCOLN COUNTY
SEPTIC SYSTEM PERMIT NO. NEW - TRL (14x70)

ISSUED TO: PIERRE PETRAU DATE: 6-4-84

ADDRESS: [redacted] PHONE: [redacted]

ISSUED BY (sign.) John W Peterson, R.S.

INSPECTION BY (sign.) _____ DATE: _____

(You must notify the Department of Environmental Health a minimum of 8 working day hours before backfilling the septic system, so that it can be inspected.)

CONTRACTOR: M. Warrington

DESCRIPTION OF SYSTEM:


LOCATION OF PROPOSED SYSTEM Angel Island B13 LOT 10

SEPTIC TANK 1,000 gal. ABSORPTION AREA: 300 ft²

SEWAGE DISCHARGE - gal/day No. OF BEDROOMS 3

WATER SUPPLY SOURCE Community SOIL Silty Loam SLOPE 2%

INSTRUCTIONS: Dig a ditch 150' long x 2½-3' deep x 2' wide according to lot layout & septic system regs. Slope of pipe should not exceed 2" / 100 Lin.

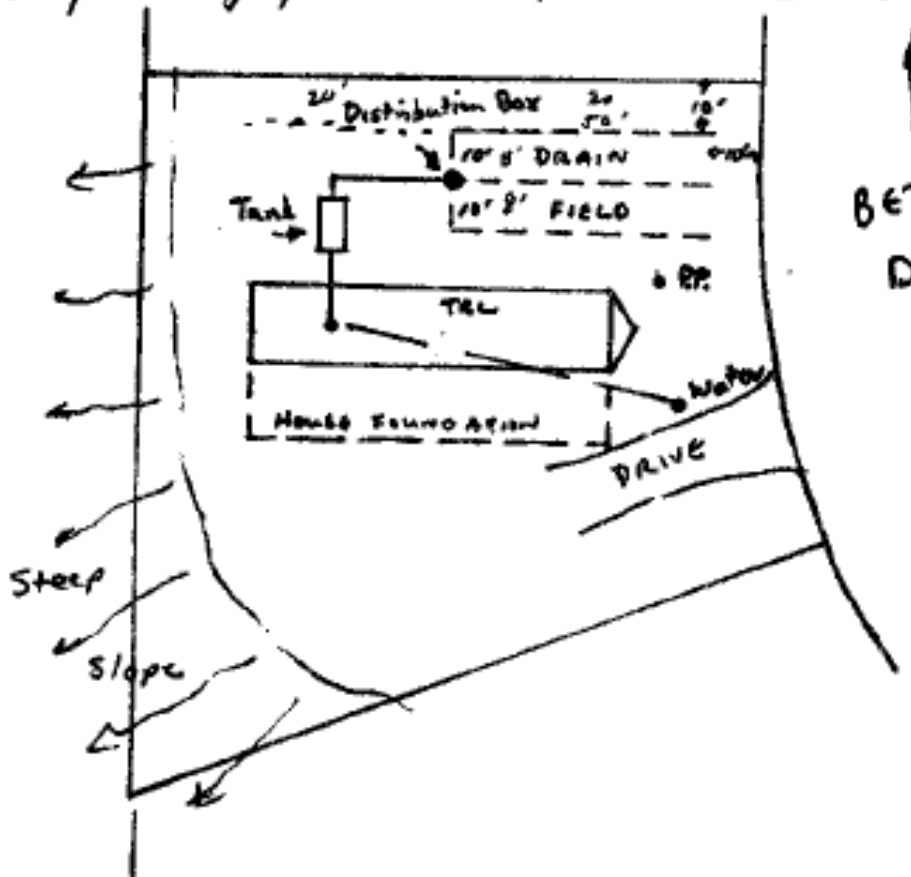

BETHEL DRIVE

N

distance changes

9/25 JWP