Robert Phillips

file

LINCOLN COUNTY SEPTIC SYSTEM PERMIT

ISSUED TO: R.C. Phillips (John Day, OR 97845) PHONE: [redacted]

ADDRESS: C/o Dave Moley - Mots Maytag 904 Utah, Libby CONTRACTOR: _____

ISSUED BY (sign.): John S Peterson, RS DATE: 7-30-90

INSPECTION BY (sign.): _____ DATE: _____

*PLEASE NOTE: The Lincoln County "On-site Sewage Disposal Regulation" does not conform with all requirements of the Montana State "Sanitation in Subdivision Act". Therefore, septic systems permitted under the county regulation may not be approvable for the purpose of future land division health reviews.

You must notify the Department of Environmental Health a minimum of 8 working hours before backfilling the septic system, so that it can be inspected.


LOCATION OF PROPOSED SYSTEM: Angel Island Block 1 lot 32

SEPTIC TANK: 1000 gal. ABSORPTION AREA: 450 ft² 15'x30' seepage bed

SEWAGE DISCHARGE: ~ gal/day No. OF BEDROOMS: 2

WATER SUPPLY SOURCE: Community SOIL: gravelly loam SLOPE: 6%

INSTRUCTIONS: Construct a seepage bed as per lot layout & Septic System regulation. Place 12" of washed rock in bottom of bed. Slope of pipes in bed should be at 0% grade. Backfill bed w/ 12-16" of cover SKETCH OF LOT LAYOUT: not to scale.

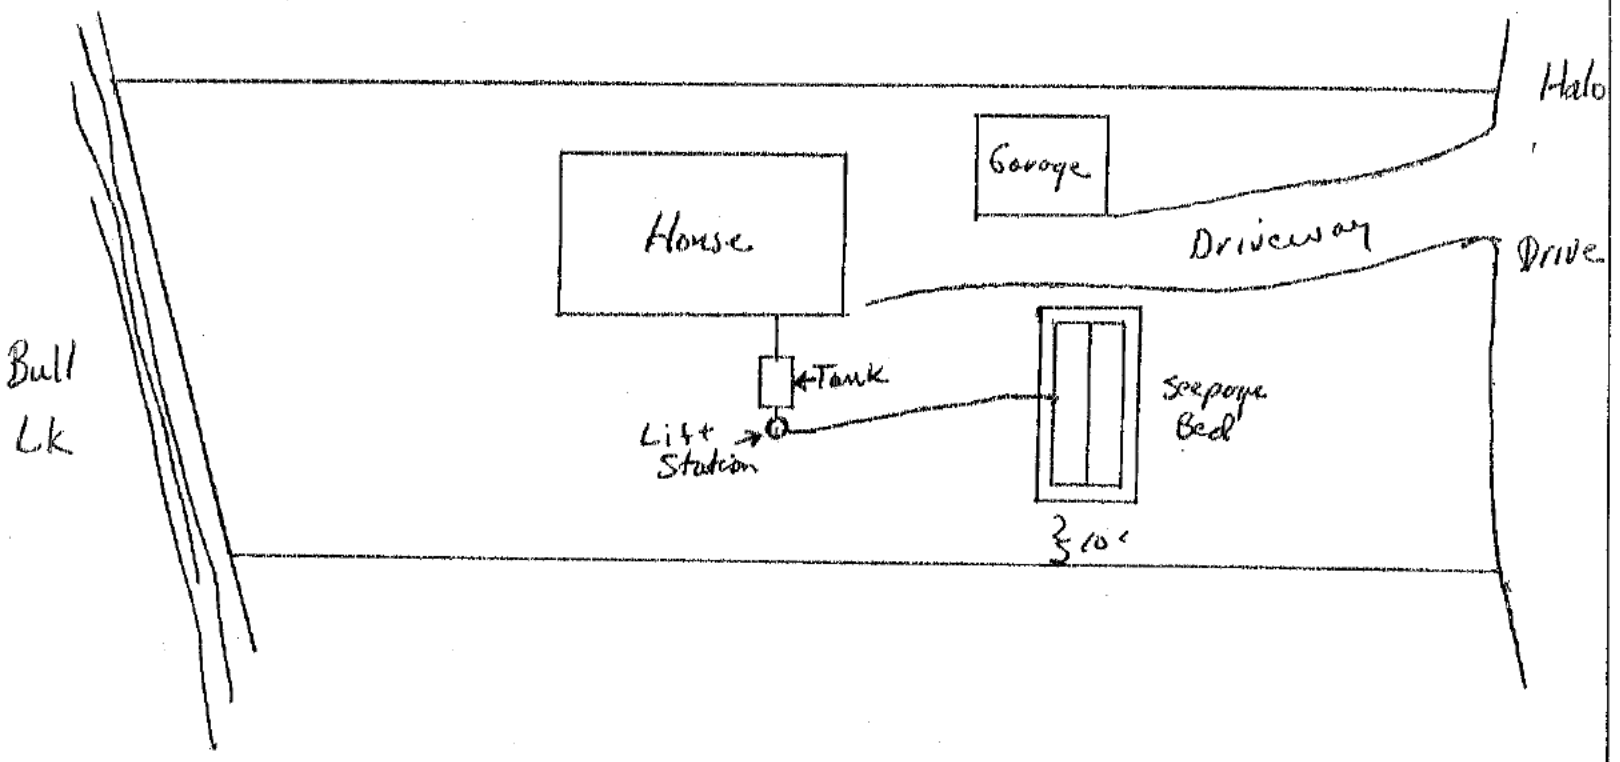

Robert

LINCOLN COUNTY SEPTIC SYSTEM ~~PERMIT~~ Application

ISSUED TO: R C PHILLIPS c/o Dave Moles PHONE:

ADDRESS: JOHN DAY, OR. 97845 CONTRACTOR:

ISSUED BY (sign.): DATE: Sept. 6, 1988

INSPECTION BY (sign.): DATE:

*PLEASE NOTE: The Lincoln County "On-site Sewage Disposal Regulation" does not conform with all requirements of the Montana State "Sanitation in Subdivision Act". Therefore, septic systems permitted under the county regulation may not be approvable for the purpose of future land division health reviews.

You must notify the Department of Environmental Health a minimum of 8 working hrs. before backfilling the septic system, so that it can be inspected.

LOCATION OF PROPOSED SYSTEM: ANGEL ISL. Lot 32 BLK 1


SEPTIC TANK: 1000 + gal. ABSORPTION AREA: 450 ft^2

SEWAGE DISCHARGE: gal/day No. OF BEDROOMS: 2

WATER SUPPLY SOURCE: Community SOIL: GRAVEL SLOPE: 6%

INSTRUCTIONS: LIFT STATION TO LEACH BED 15' X 30' X 3' - MIN 12" WASHED ROCK UNDER PIPE - 3"-4" COVERING PIPE -

SKETCH OF LOT LAYOUT:

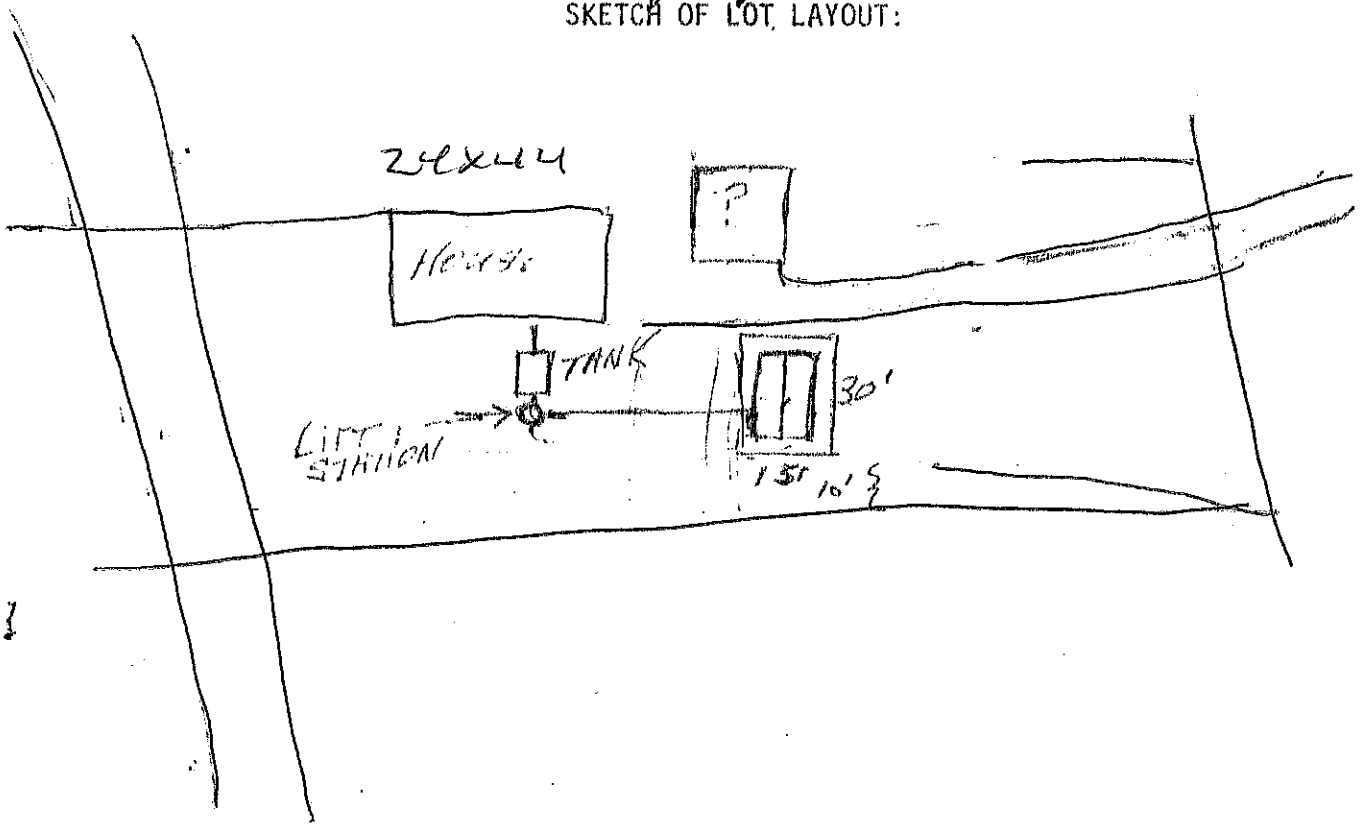

Angel Island