LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/09/2021 Expiration Date: 11/09/2022

Property Owner: Skillings, Jared & Miller, Kaitlin c/o:

Address: [redacted]

Telephone: [redacted] [redacted]

Installer: Sawtooth Excavation (L. Muntz) License No. 160

XX Direct Connection (**with inline/intermediate 1,500 gallon septic tank**) ____ Grinder Pump Connection ____ Lift Tank Connection

Describe: Connection to Bull Lake estates community subsurface sewage treatment system, including 1,500 gallon inline/intermediate septic tank to be installed between residence and gravity feed sewer main.

Parcel Description:

Legal: BULL LAKE ESTATES, S29, T29 N, R33 W, Lot 013, ACRES 2, PM 6351 SPLIT FROM 13727

Address or Location: 13 Northshore Dr. Troy, MT 59923

Geo/Assessors code: 0000053767

Approved Design Criteria:
This lot is approved for a 4-bedroom single family home. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 350 gallons per day. Any proposed increase in wastewater flows must be reviewed by and receive the approval of the HOA Review Board and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL DIRECT SEWERLINE CONNECTION (WITH INLINE/INERTMEDIATE SEPTIC TANK) TO THE GRAVITY SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE LOT LAYOUT AND DEQ APPROVAL STATEMENT E.Q. 95-1240. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE *Bull Lake Estates subdivision homeowners association,* ENVIRONMENTAL REVIEW BOARD, DEQ AND THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:
I, Logan Muntz, *have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.*

Signed: [signature] *Date:* 11/10/21


Title: Sawtooth Excavating

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.

LOT LAYOUT

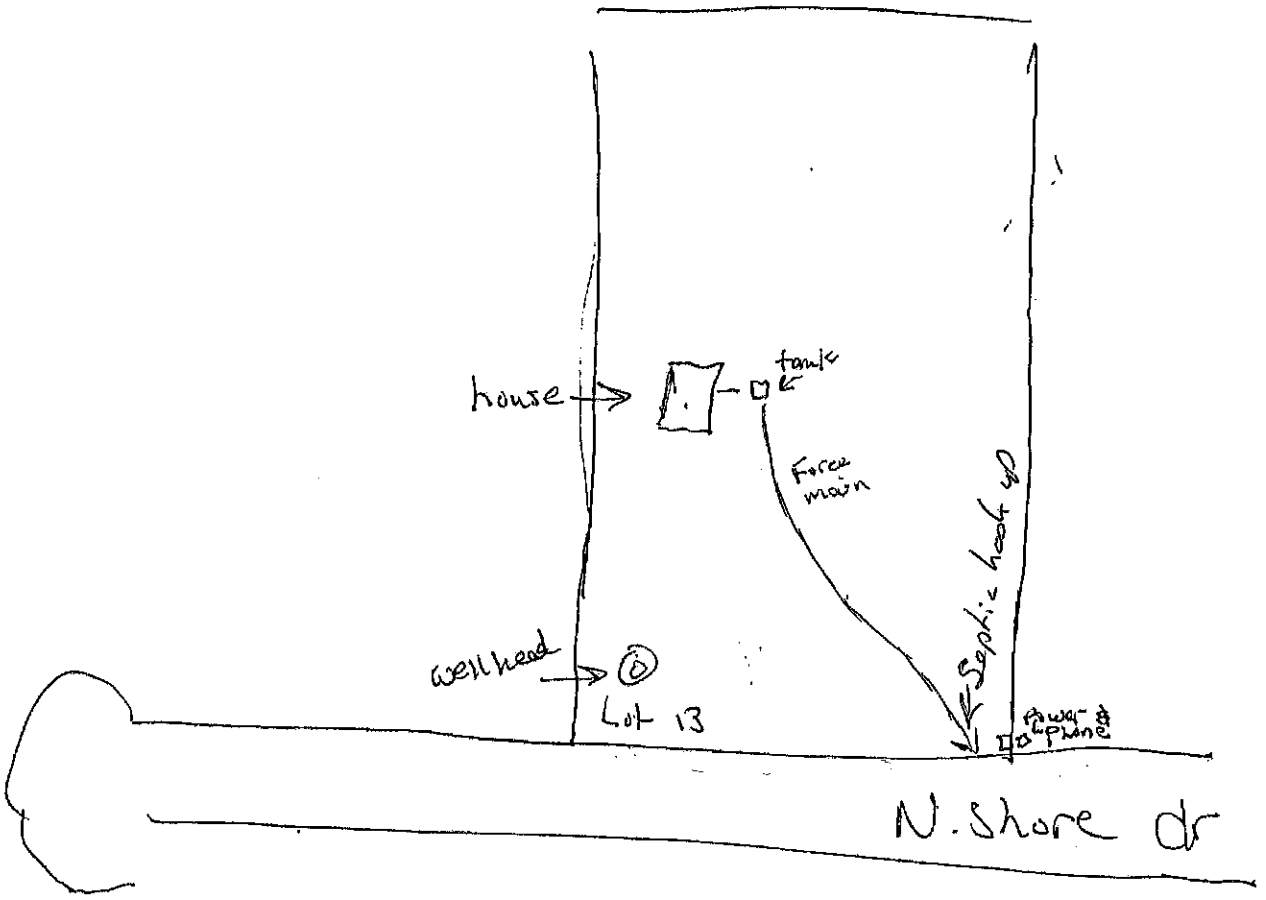

Scanned with CamScanner