Lincoln City-County Board of Health
418 Mineral Ave
Libby, MT 59923

August 11, 2011

Becky & Joshua Stillo
135 Werner Peak Trail
Kalispell, MT 59901

RE: Variance Approval

Dear Mr. and Mrs. Stillo,

The City-County Board of Health for Lincoln County voted at their August 9, 2022 meeting to grant you a variance for your septic tank at 428 Halo Drive, Troy, MT (Angel Island Block 1, Lot 45) which is installed 80 feet from surface water. This is a variance to the Angel Island Subdivision Certificate of Removal of Sanitary Restriction requirement that "no sewage disposal system shall be located within 100 feet of the lake."

Christopher Eaton, project engineer, confirmed that this septic tank meets the conditions of approval for this variance.

Sincerely,

Josh Letcher
Chair

cc: Christopher Eaton

Receipt# 199

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/02/2022 (rev 8/11/22) Expiration Date: 08/03/2023

Property Owner: Becky and Joshua Stillo

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Spencer Construction License #: 152

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Pressure dose system using 3' chambers and 2 laterals at 40'. Variance issued for septic tank location.

Parcel Description:

Legal: Angel Island – S29, T29N, R33W, Block 001, Lot 45, .38 acres

Property Address: 428 Halo Drive, Troy, MT 59935 Assessment Code: 6112

Approved Design Criteria:

# of Bedrooms: 2 Septic Tank Size: 1000 + 500 gallons Drainfield Size: 240 square feet

# of Laterals: 2 Length of Laterals: 40 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Jesse Haag (rev. KH)

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


I, Kathi Hooper *, have inspected/reviewed this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8-11-22

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

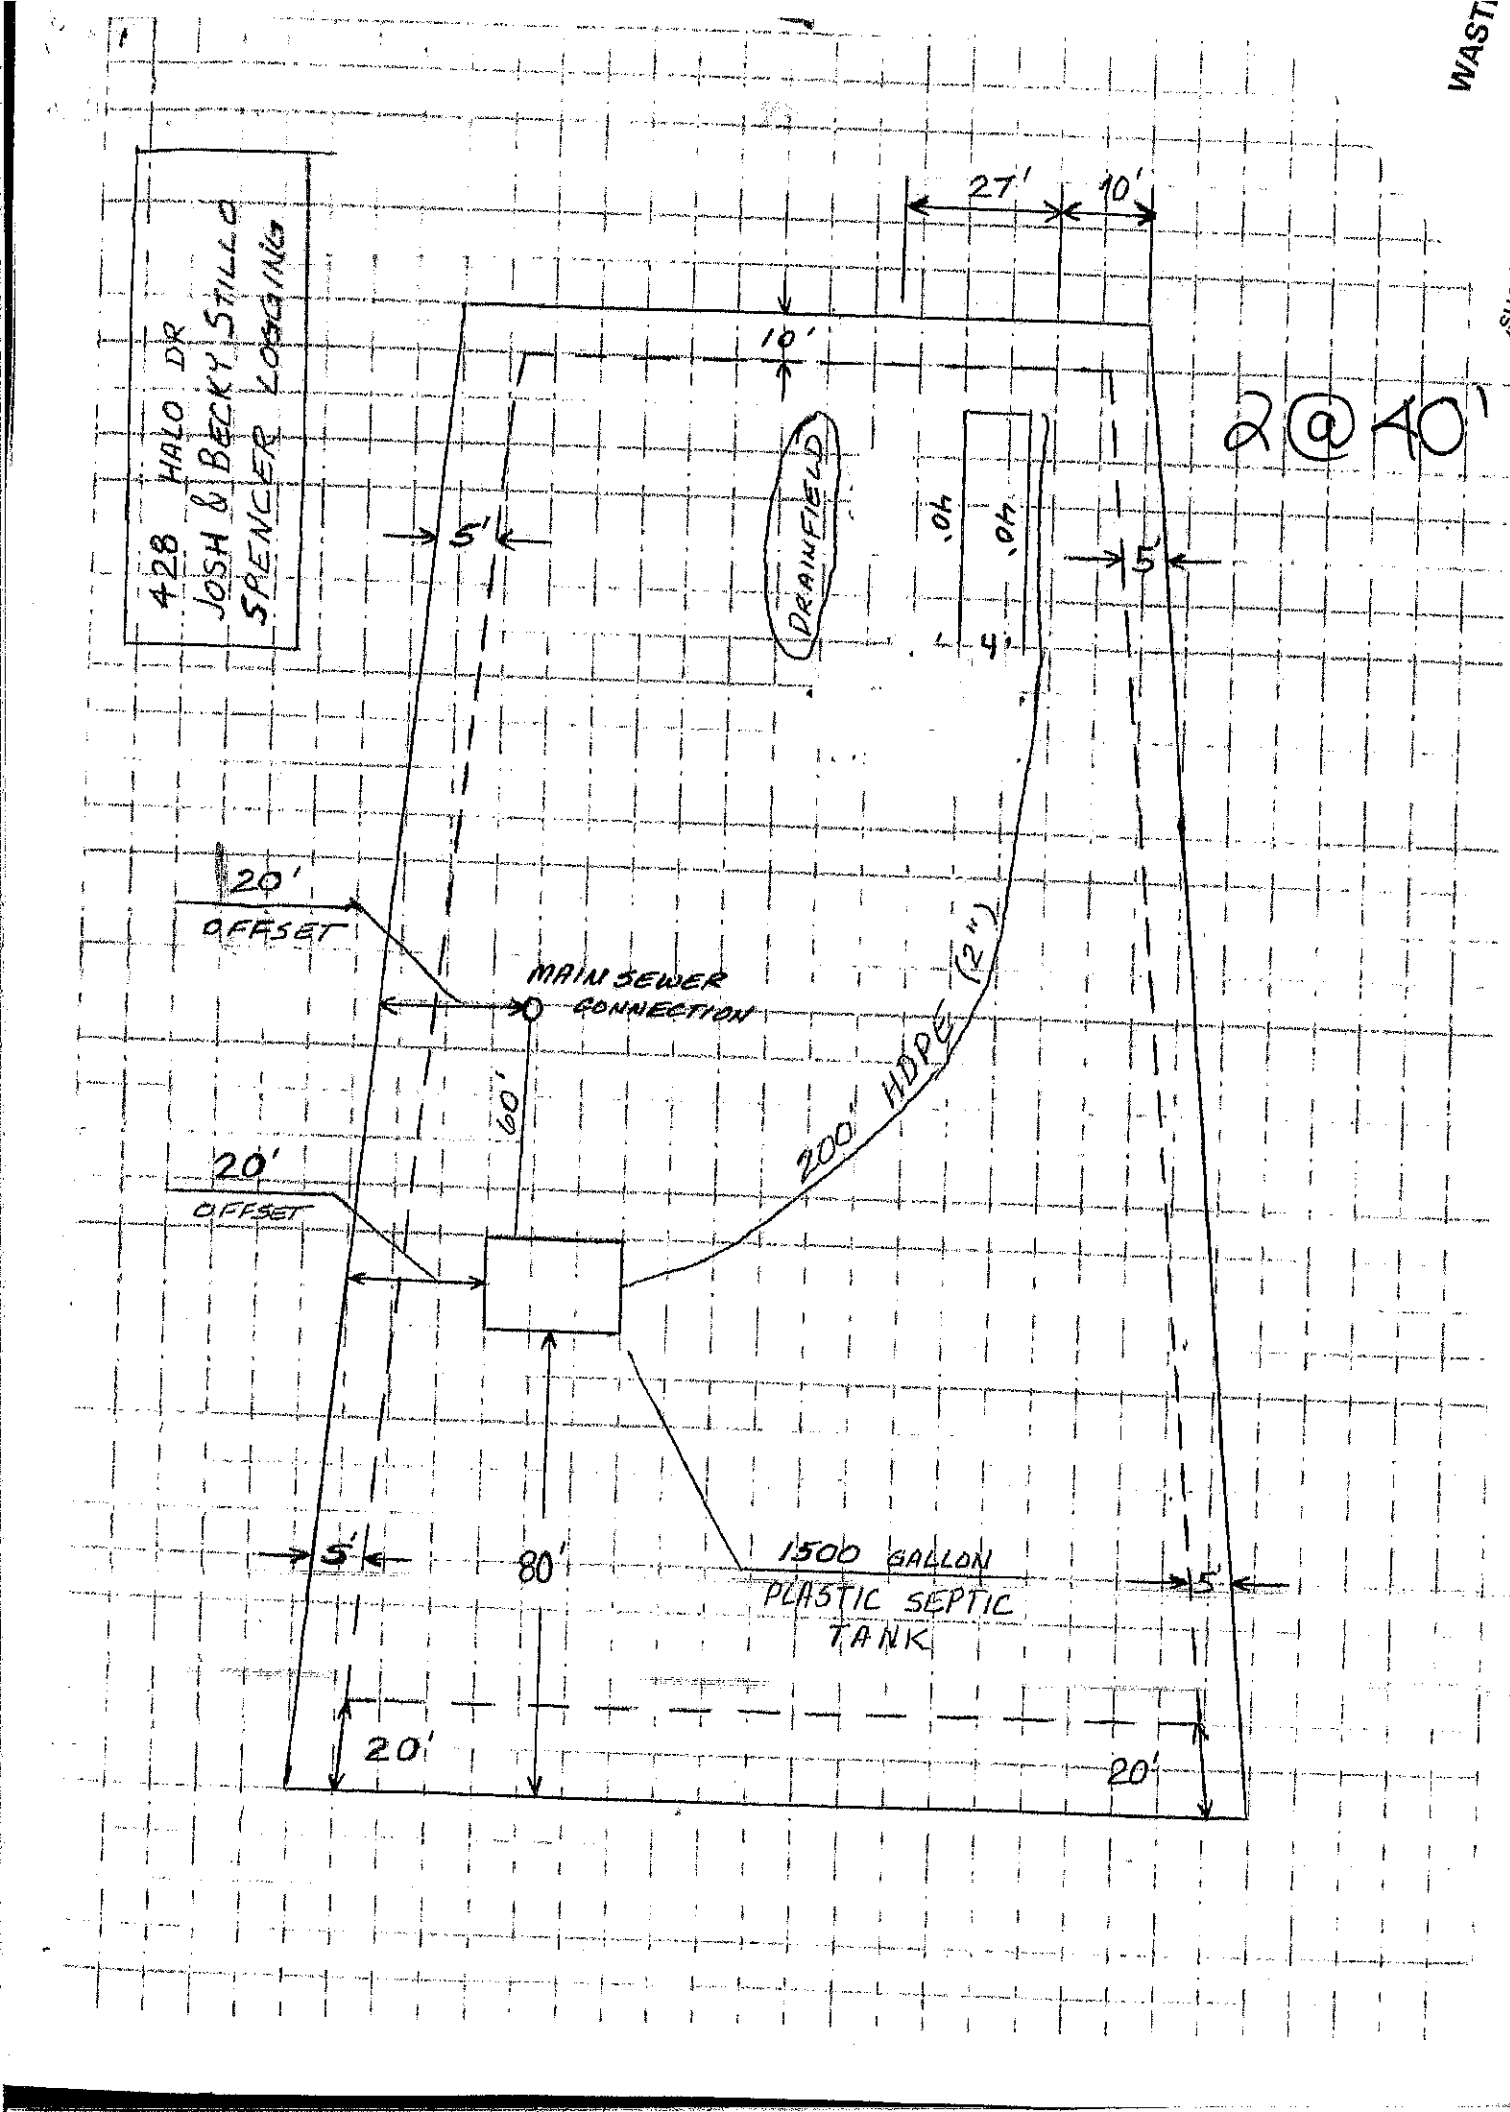

WASTE

Issue Date: 08/02/2022 (re

Property Owner:

Mailing A