LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 1/9/2023 Expiration Date: 1/8/2024

Property Owner: William and Cami Winslow

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Terry Oedewaldt License #: 2

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system for guest house with standard 2' wide trenches, using chambers

Parcel Description:

Legal: Angel Island, Block 3, Lot 24, S29 T29N R33W

Property Address: 473 Halo Dr, Troy, MT Assessment Code: 6088

Approved Design Criteria:

# of Bedrooms: 1 Septic Tank Size: 1000 gallons Drainfield Size: 144 square feet

# of Laterals: 3 Length of Laterals: 24 lineal feet Trench Depth: 24 - 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: _____ *Date:* 7/20/23

____ Lincoln County Health Department (LCHD) ✓ Licensed installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

WINSLOW SEPTIC SYSTEM 7/18/23

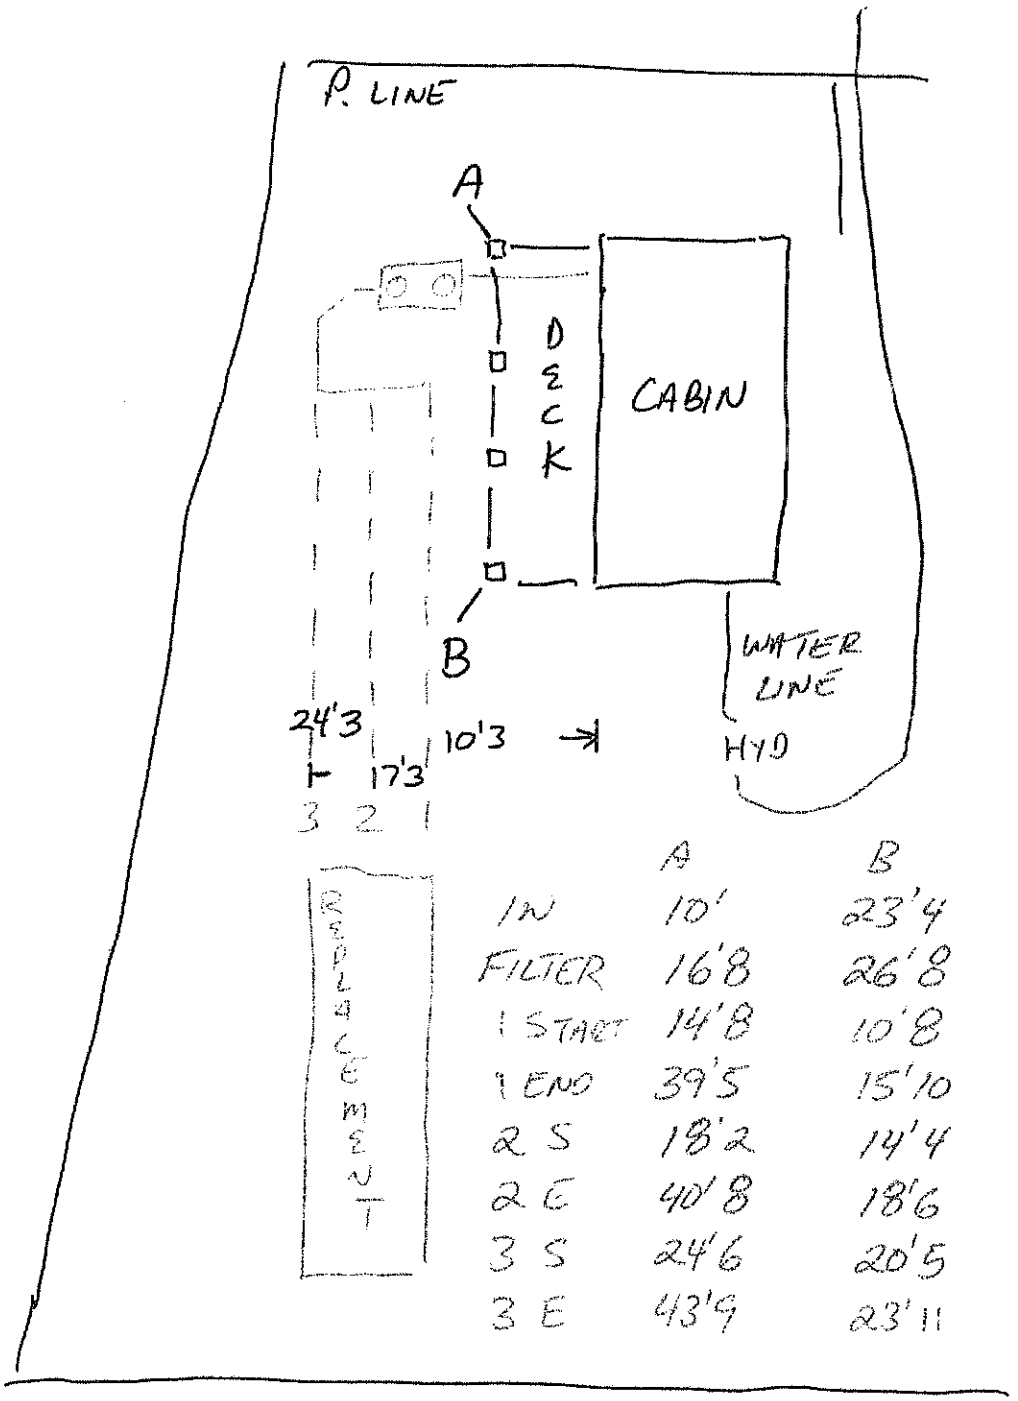

	A	B
IN	10'	23'4
FILTER	16'8	26'8
1 START	14'8	10'8
1 END	39'5	15'10
2 S	18'2	14'4
2 E	40'8	18'6
3 S	24'6	20'5
3 E	43'9	23'11