LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/21/17 Expiration Date: 4/21/2018

Property Owner: Ray Whitmer c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Self License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 65' sandlined trenches using perfpipe and drainrock.

Parcel Description:

Legal: S28 T29 R33

Address or Location: Spring Estates Lot 1

Geo/Assessors code: 0000013748

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 130 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, J. MERTES, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 7/17/2017

Title: County Sanitarian

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5

AMENDED LOT LAYOUT


LOT 1 SPRINGS ESTATES SUBDIVISION

W1/2 SE1/4 NW 1/4, SECTION 28, TWP29N, R33W, MPM
LINCOLN COUNTY, MONTANA

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality/ PCD

Local Reviewer — Date 5/24/2017

Accepted under contract
N/A
DEQ Representative — Date

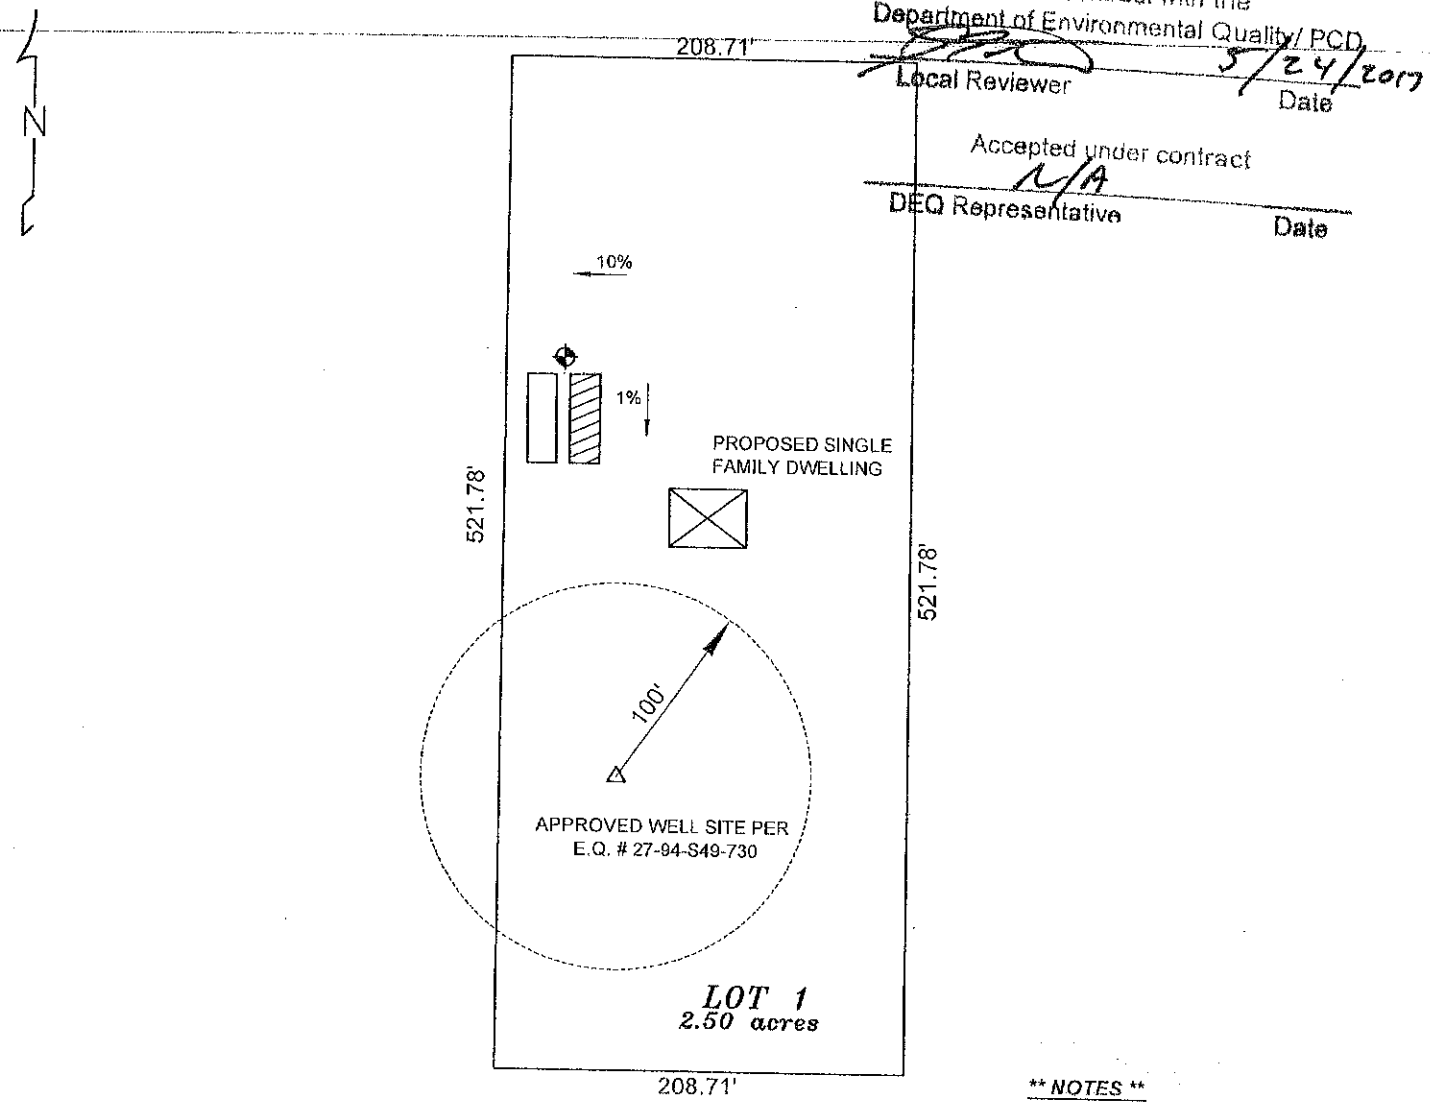

** NOTES **

NO WELLS OR DRAINFIELDS WITHIN 100' OF PROPERTY BOUNDARY OTHER THAN SHOWN.

LEGEND

- PROPOSED OR EXISTING WELL SITE
- SOIL TEST SITE
- PROPOSED SINGLE FAMILY DEWELLING
- PROPOSED DRAINFIELD AND REPLACEMENT AREA

SCALE

0 50 100 200

IN FEET

RECEIVED
MAY 19 2017
BY:

KOOTENAI SURVEYORS, INC.
314 CALIFORNIA AVE. LIBBY, MONTANA (406)293-4354