LINCOLN COUNTY HEALTH DEPARTMENT Permit # 24-55842
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/31/2024 Expiration Date: 07/30/2025

Property Owner: Earl Ancker

Mailing Address: [redacted]

Installer: Barry Roose License #: 205

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for a 3 Bedroom House.

Legal: EDA ESTATES, S26, T36 N, R26 W, LOT 2, ACRES 2.23, PM 6978

Property Address: Lot2 EDA Estates Glen Lake Rd., Eureka, MT 59917 Assessment Code:55842

DEQ COSA: E.Q.#07-2799 Date: 06/14/24

Approved Design Criteria: Installation of new pressure dosed system for a 3 Bedroom House with 4 Laterals @ 84'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width:36"

# of Laterals: 4 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 11/8/24


✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

91.3045%

For: Barry Roose
Owner: Earl D Ancker
Date: 2024-05-28
Purpose: Easement Modification/Partial Retracement

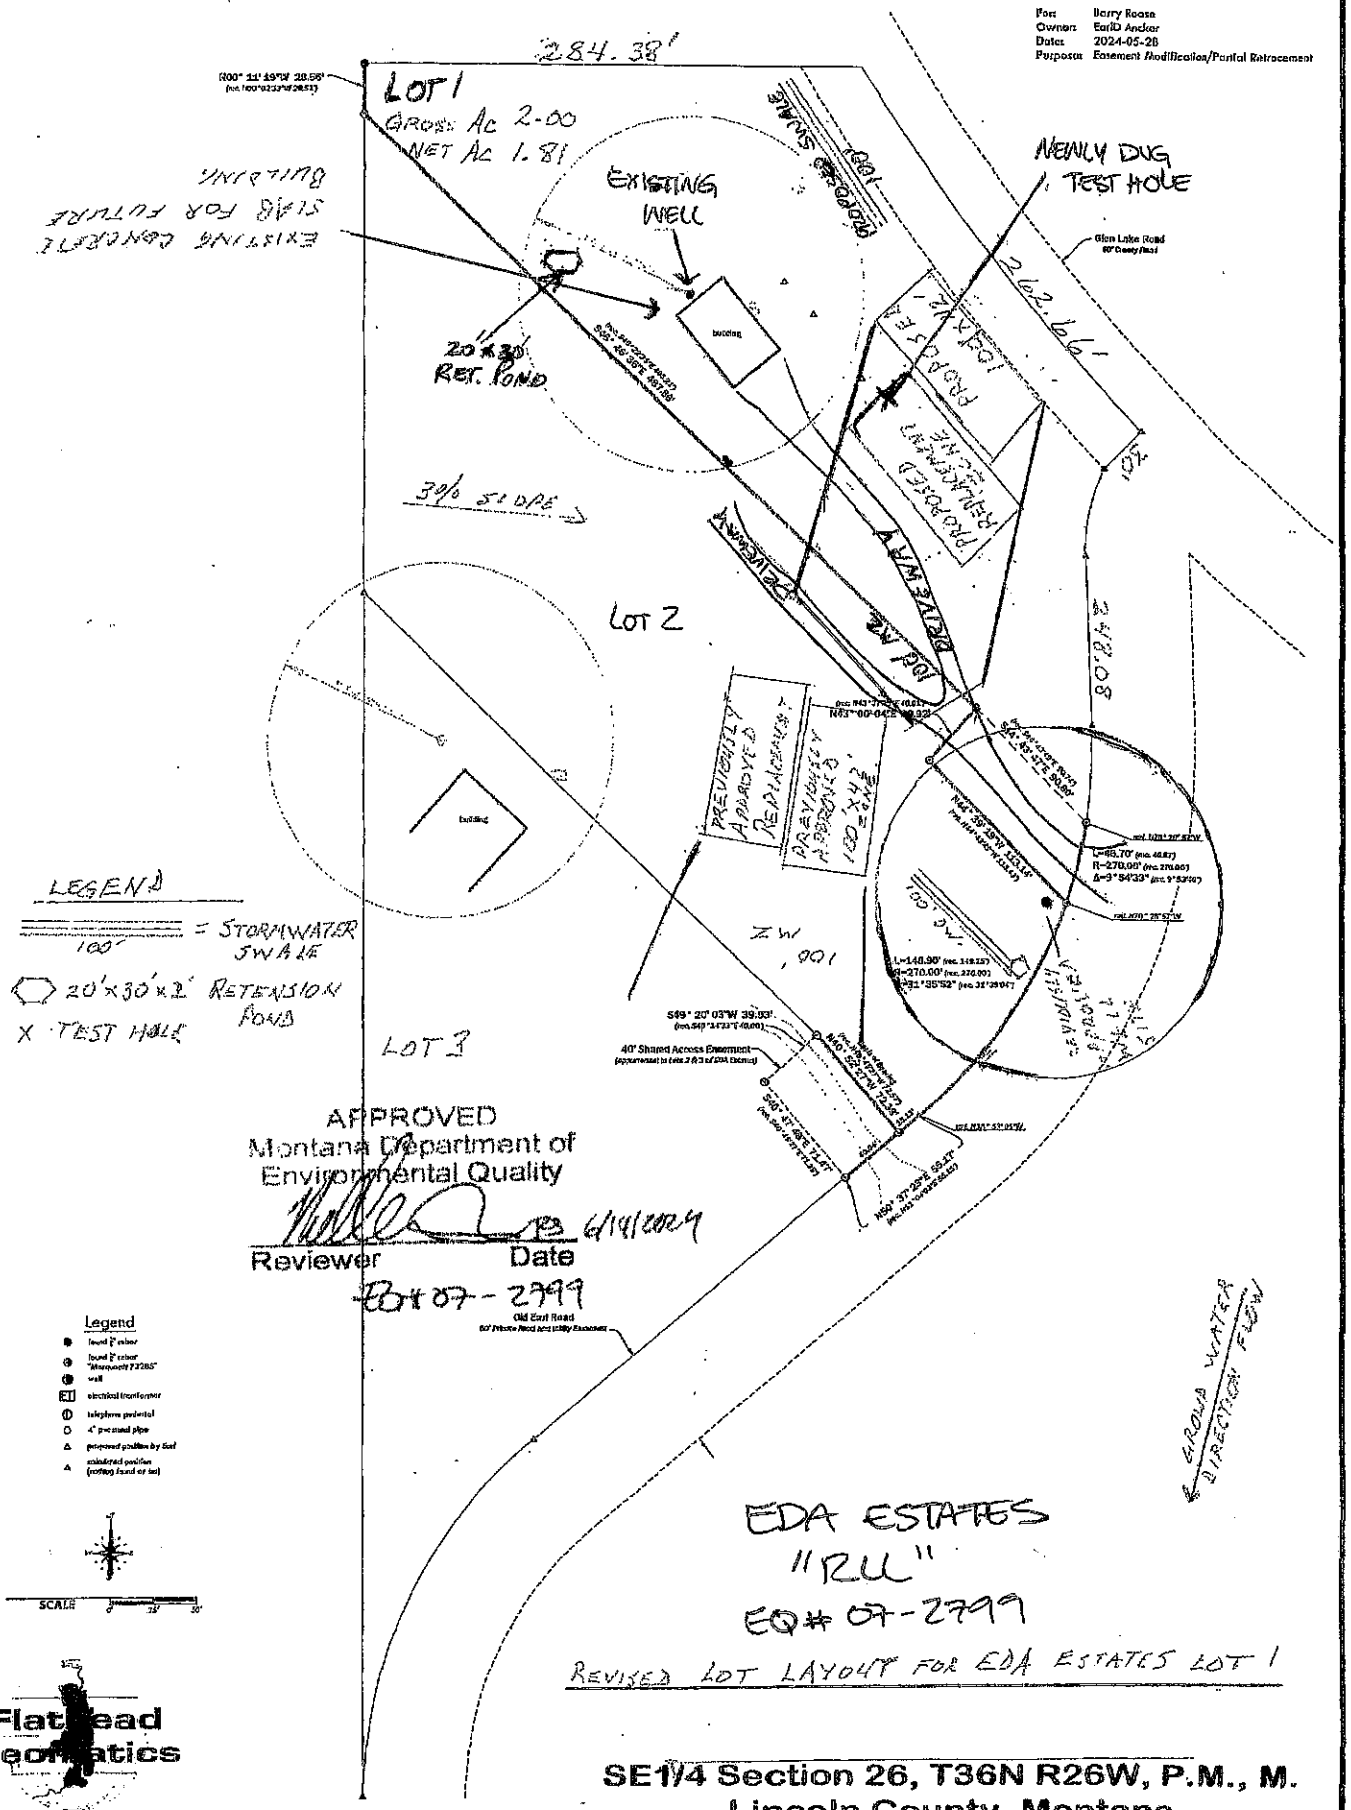

LEGEND

= STORMWATER SWALE

20'x30'x2' RETENSION POND

X TEST HOLE

APPROVED
Montana Department of
Environmental Quality
Reviewer
6/19/2024
Date
EQ# 07-2799

Legend
- found 2" rebar
- found 2" rebar "illegible" 7726S"
- well
- electrical transformer
- telephone pedestal
- 4" pvc stand pipe
- perpetual position by Surf
- calculated position (nothing found or set)

SCALE 0 25' 50'

Flathead Geomatics

236 Wisconsin Ave.
Whitefish, MT 59937
311 SW Jefferson Avenue
Corvallis, OR 97333

SE1/4 Section 26, T36N R26W, P.M., M.
Lincoln County, Montana

NOTE: No search has been made for easements effecting this property and this survey does not purport to show all appurtenant easements.