LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/18/2025 Expiration Date: 03/17/2026 Permit# 25-6179

Property Owner: Steven and Renee Baumann

Mailing Address: [redacted]

Installer: Logan Munts License #: 160

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: S32, T30 N, R33 W, ACRES 20, S2NWNE OR TR 4G

Property Address: 25309 Bull Lake Rd., Troy, MT 59935 Assessment Code: 6179

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 3 Laterals @ 85' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 85' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the Lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(if applies). Reduction for chambers given. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

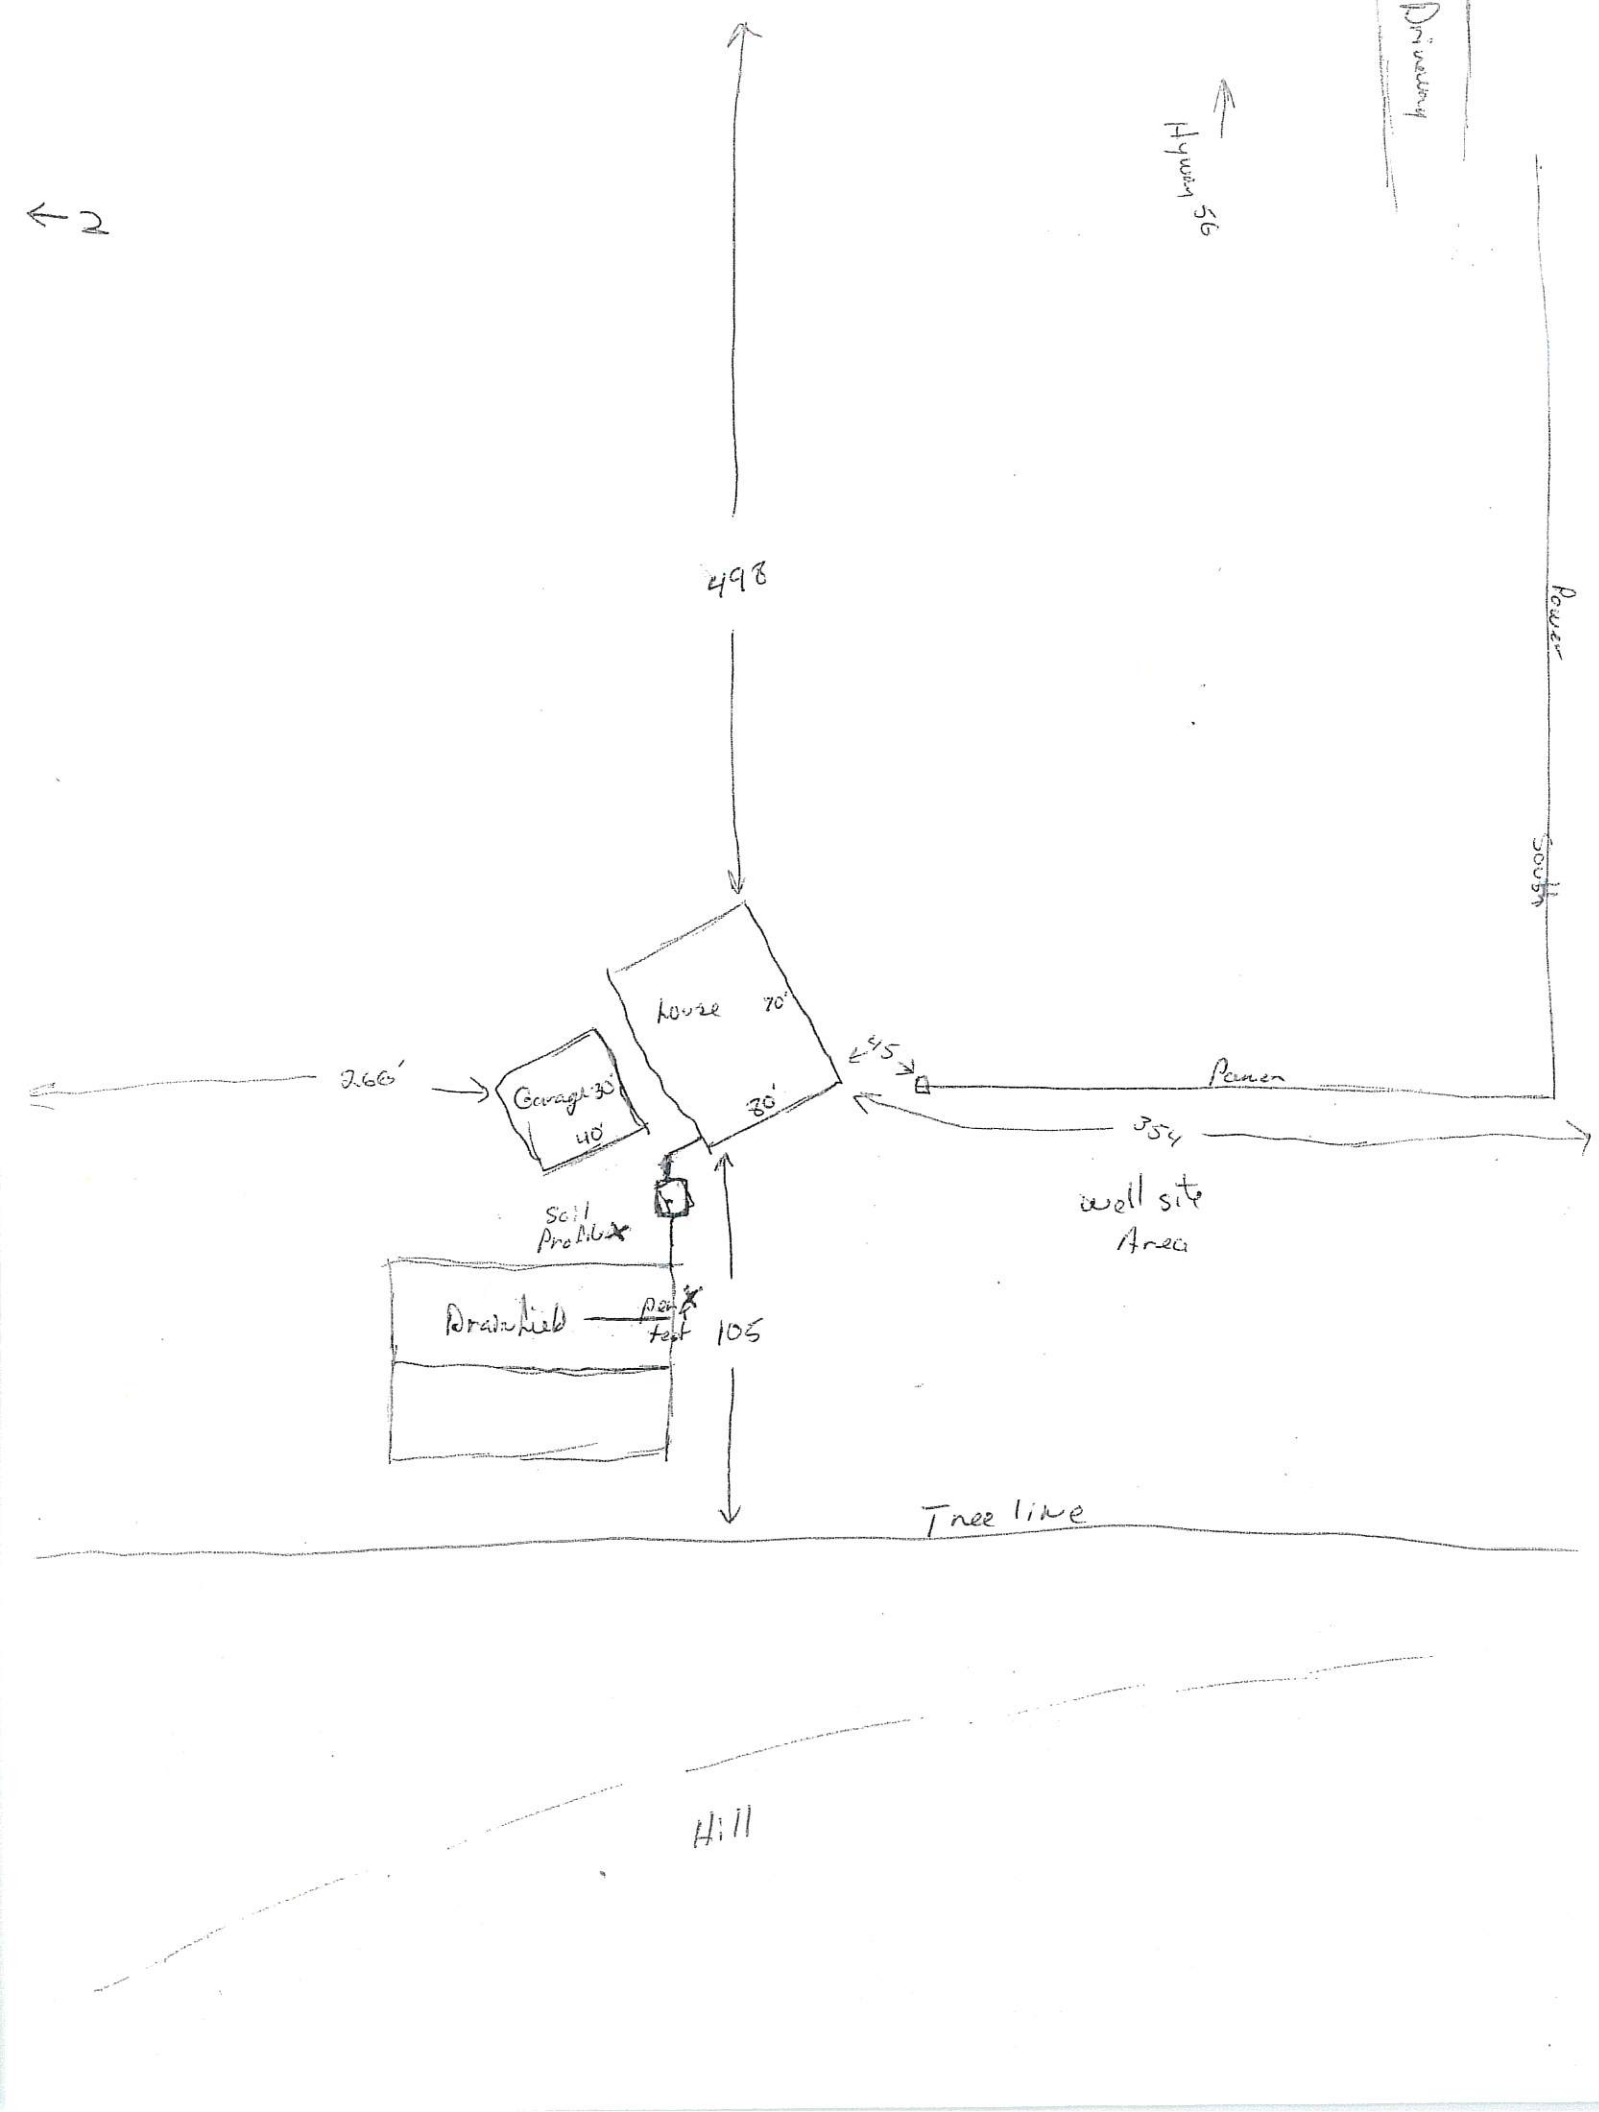
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


N
Driveway
Hyway 56
498
Power
South
House
70'
30'
Garage 30'
40'
266'
45
Power
354
well site
Area
Soil
Probe
Drainfield
Repair
Area
105
Tree line
Hill