LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/16/2020

Expiration Date: 06/16/2021

Property Owner: Michael & Deborah Beaty

c/o:

Address: [redacted]

Telephone: 406-293-2525 (Home)

(Work)

Installer: Thompson Contracting Inc

License No. 76

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 50' laterals

Parcel Description:

Legal: COLLINSON TRACTS, S35, T31 N, R31 W, Lot 003, PLAT 872

Address or Location: LOT 3

Geo/Assessors code: 0000008571

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 140 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Levi Thompson, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 3/18/25

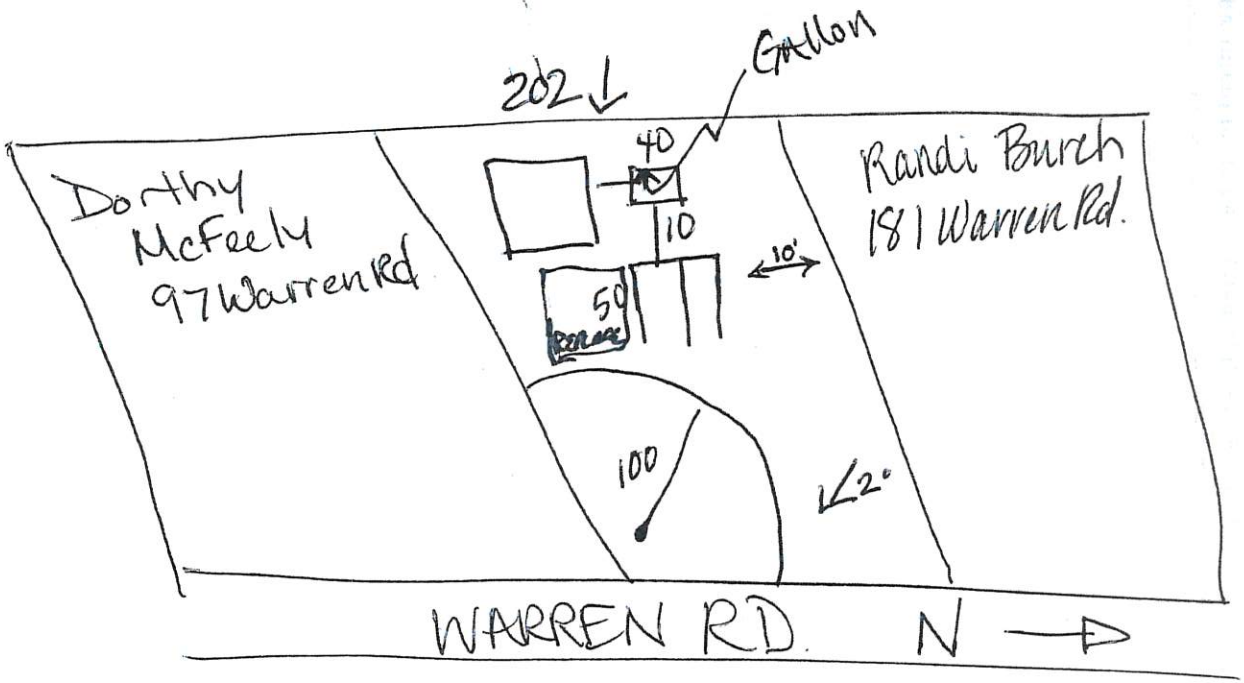
Title: VP OF TCI

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


202
Gallon
40
10
10'
50
Dorthy
McFeely
97 Warren Rd
Randi Burch
181 Warren Rd.
100
12°
WARREN RD.
N