LINCOLN COUNTY HEALTH DEPARTMENT Permit#24-52515
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/23/2024 Renewal 06/08/2023 Expiration Date: 7/22/2025

Property Owner: Eric and Tyann Bender

Mailing Address: P.O. Box 755 Troy, MT 59935

Installer: Terry Oedewaldt License #: 2

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system with chambers and 2 laterals @ 72'.

Parcel Description:

Legal: SHANNON FLATS, S21, T31 N, R33 W, LOT6, ACRES 22, PM 6641

Property Address: 1251 Overview Drive Troy, MT 59935 Assessment Code: 52515

DEQ COSA: Date:

Approved Design Criteria: Installation of gravity system with chambers and 2 laterals @ 72'.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 72' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: _____ *Date:* 7/24/24

____ Lincoln County Health Department (LCHD) ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

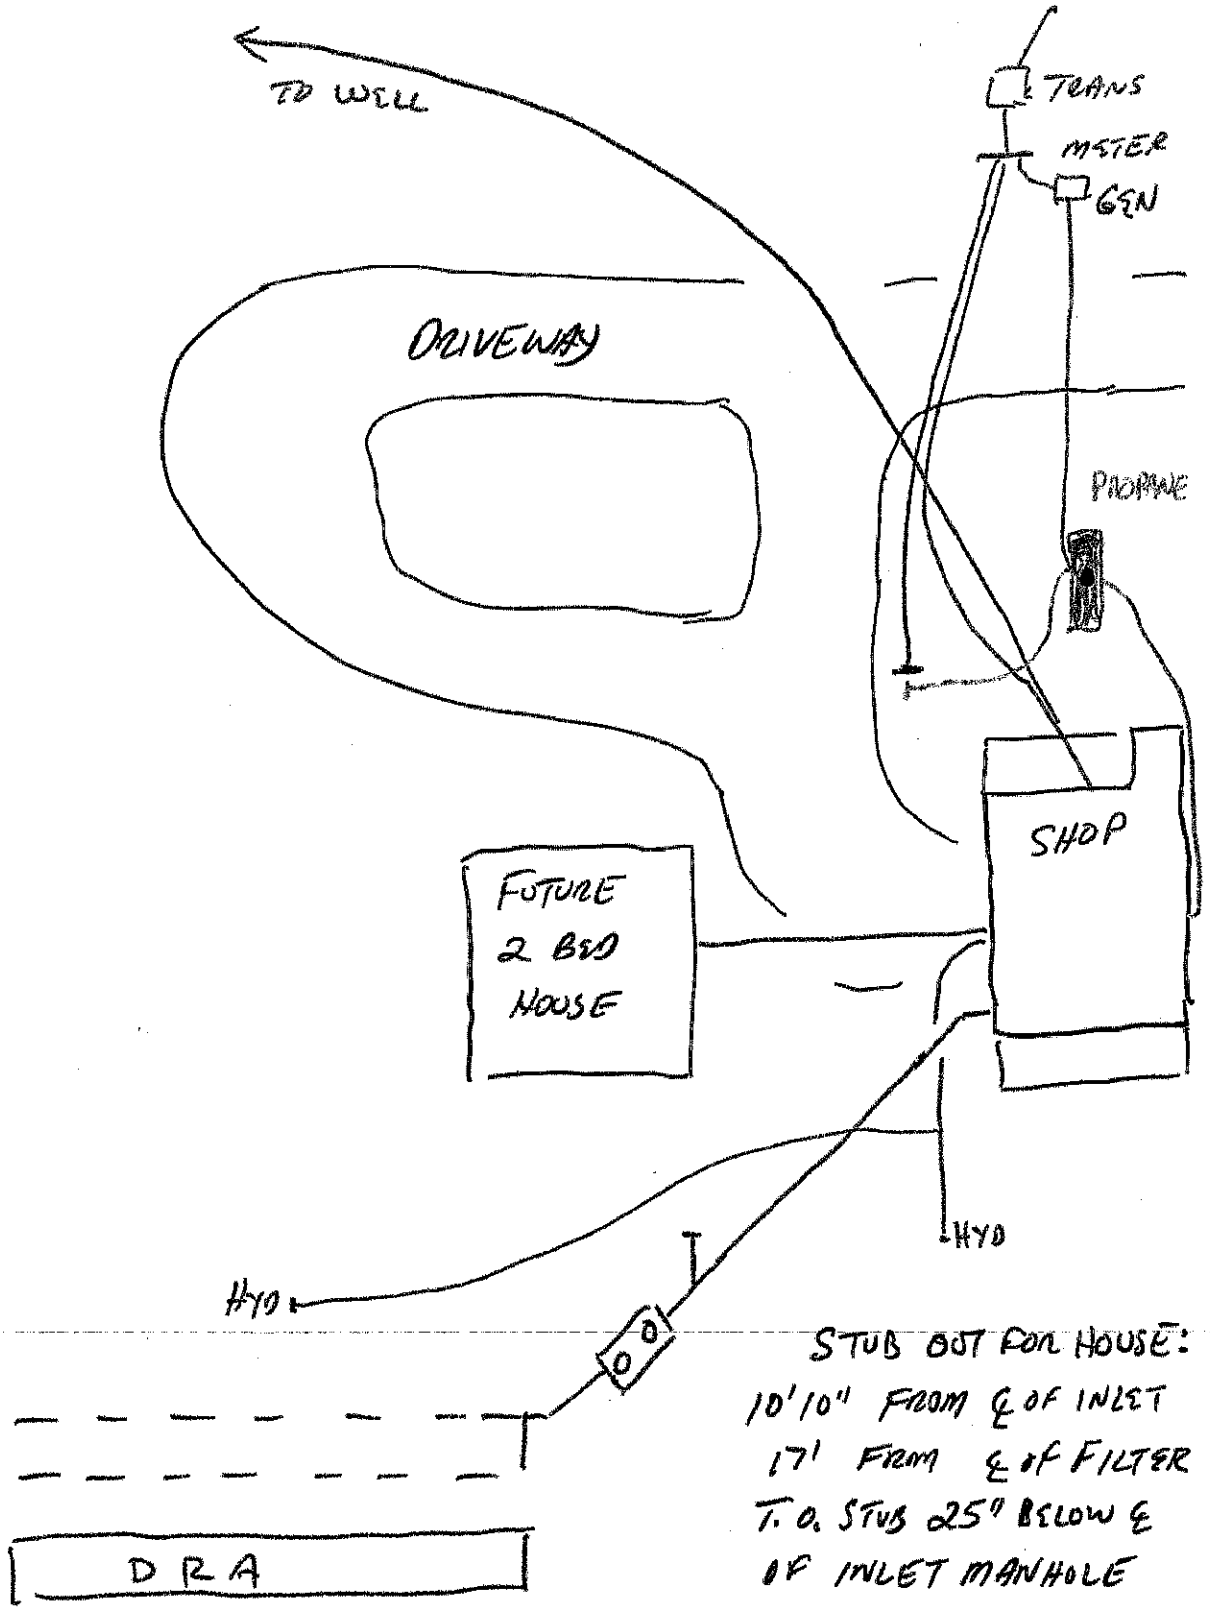

STUB OUT FOR HOUSE:
10'10" FROM ℄ OF INLET
17' FROM ℄ OF FILTER
T. O. STUB 25" BELOW ℄
OF INLET MANHOLE