LINCOLN COUNTY HEALTH DEPARTMENT Permit # 24-8355
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/02/2024 Expiration Date: 10/01/2025

Property Owner: Sally Rae Fahland TTEE/ Jackie Norman

Mailing Address: [redacted]

Installer: Tom Cole License #: 1

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Replacing old system.

Parcel Description:

Legal: S33, T31 N, R31 W, COS 132, ACRES 6, TR36AA 3FF 3FE & 3FAA IN SW

Property Address: 31425 US Hwy 2 Libby, MT 59923 Assessment Code: 8355

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of replacement gravity system for 2 Bedroom House with 2 Laterals @ 70' with reduction for chambers.

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 70' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

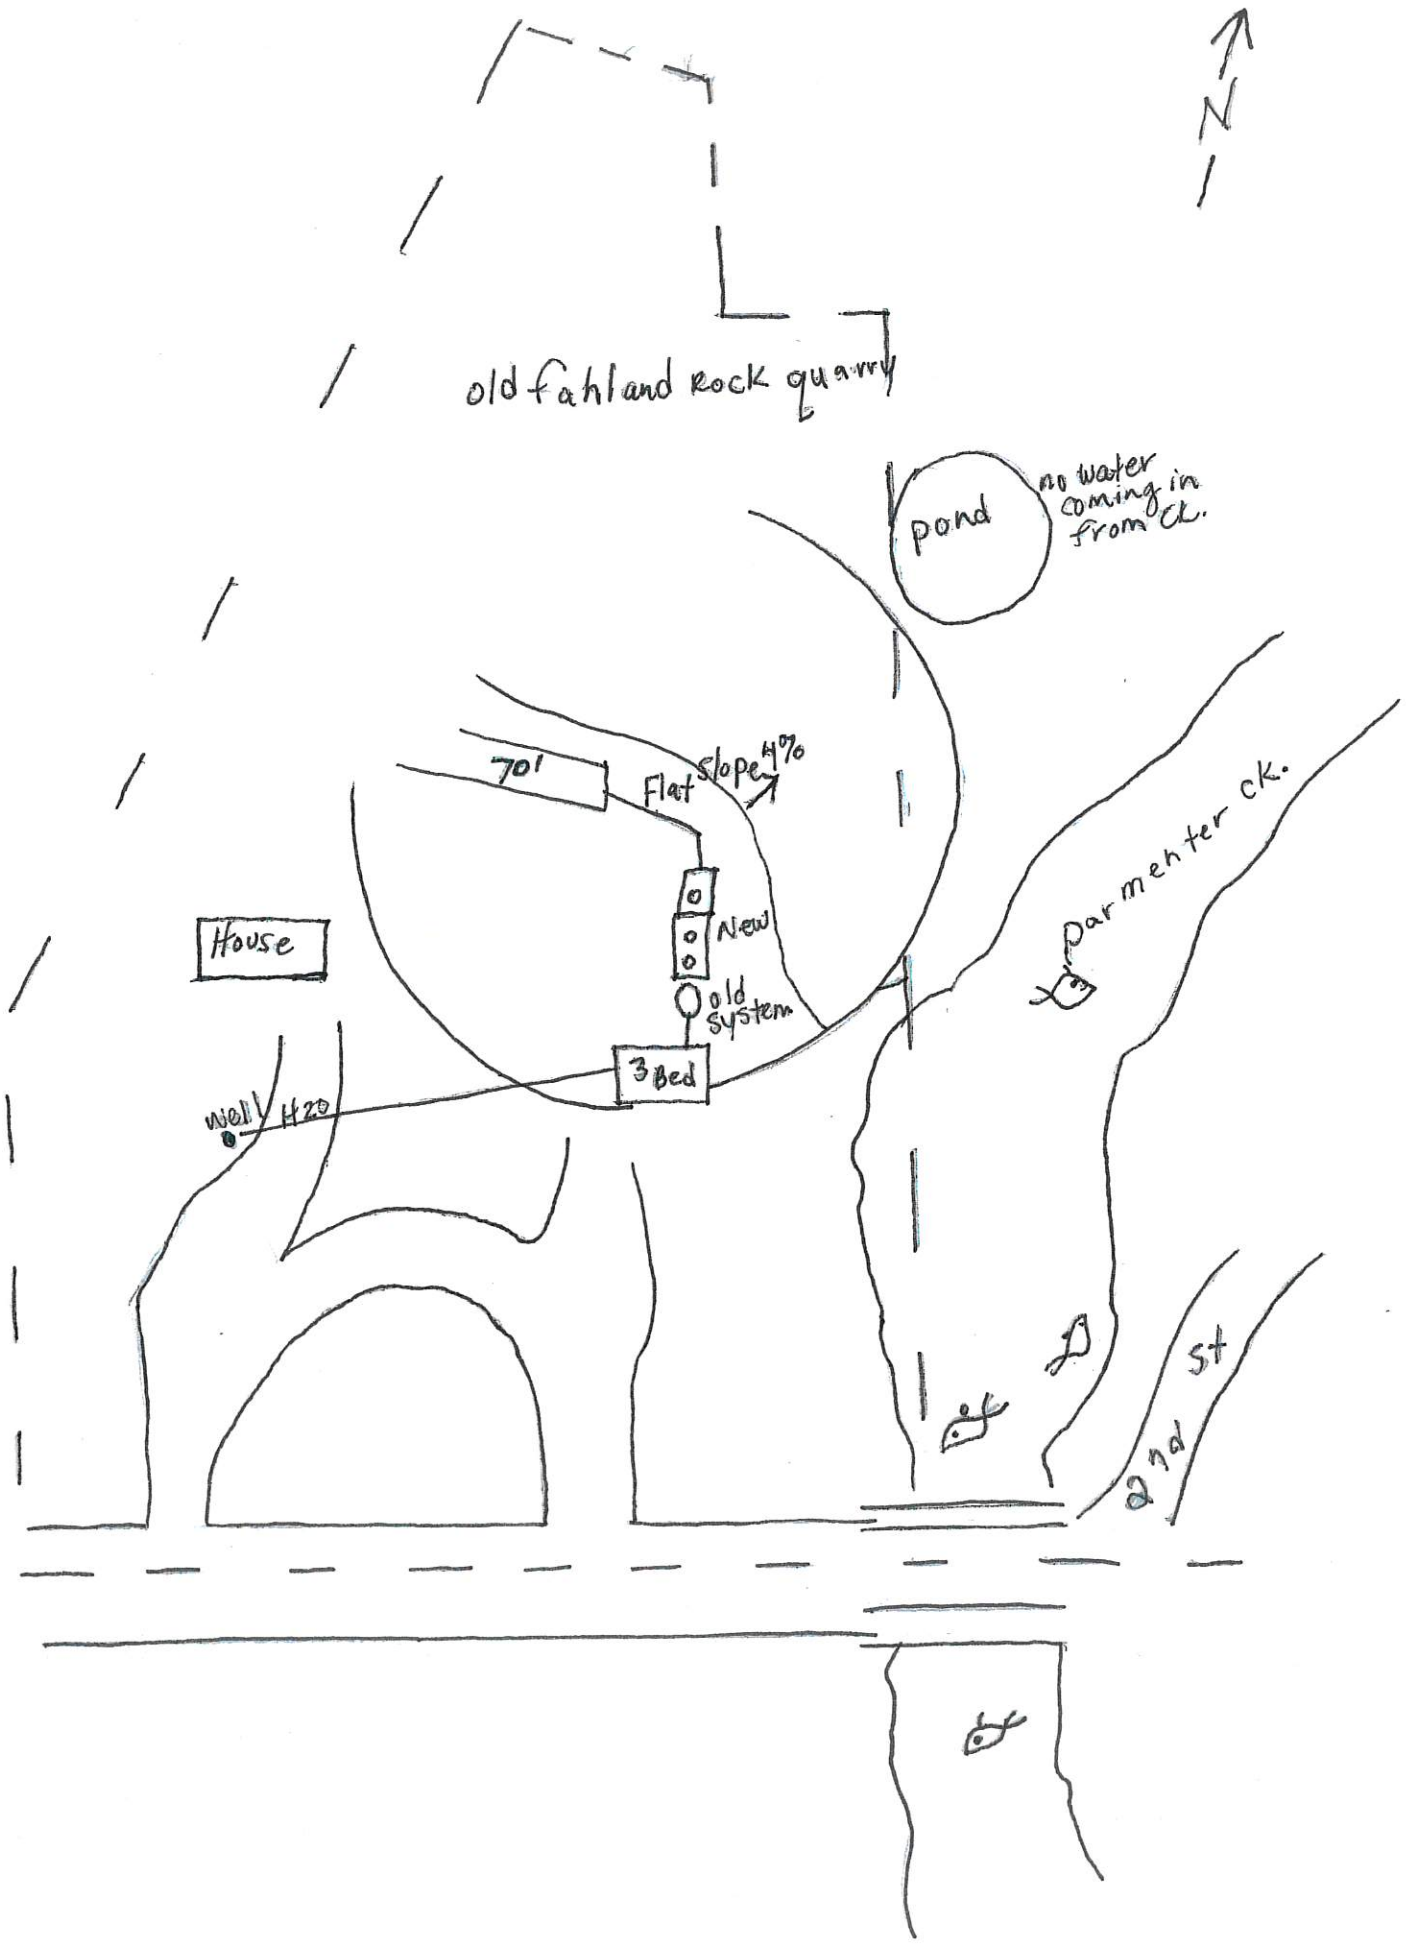
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/10/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


N
old fahland rock quarry
pond
no water coming in from ck.
70'
Flat
Slope 4%
New
old system
3 Bed
House
well
H20
Parmenter ck.
1st
2nd