Permit# 24-59800

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/27/2024 Expiration Date: 09/26/2025

Property Owner: Theron Humphrey, Jr.

Mailing Address: [redacted]

Installer: David Hull Jr. License #: 169

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 2 Bedroom House and 1 Bedroom Accessory Building (No laundry or Kitchen) with 3 laterals @ 64' with reduction for chambers.

Parcel Description:

Legal: LICK LAKE 2, S26, T36 N, R26 W, ACRES 7.76, LOT 1 PM 7213

Property Address: 3105 Glen Lake Rd., Eureka, MT 59917 Assessment Code: 59800

DEQ COSA: EQ# 24-2304 Date: 09/12/24

Approved Design Criteria: Installation of new pressure dosed system for 2 Bedroom House and 1 Bedroom Accessory Building (No laundry or Kitchen) with 3 laterals @ 64' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 36"

# of Laterals: 3 Length of Laterals: 64' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg *Date:* 10/3/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

5

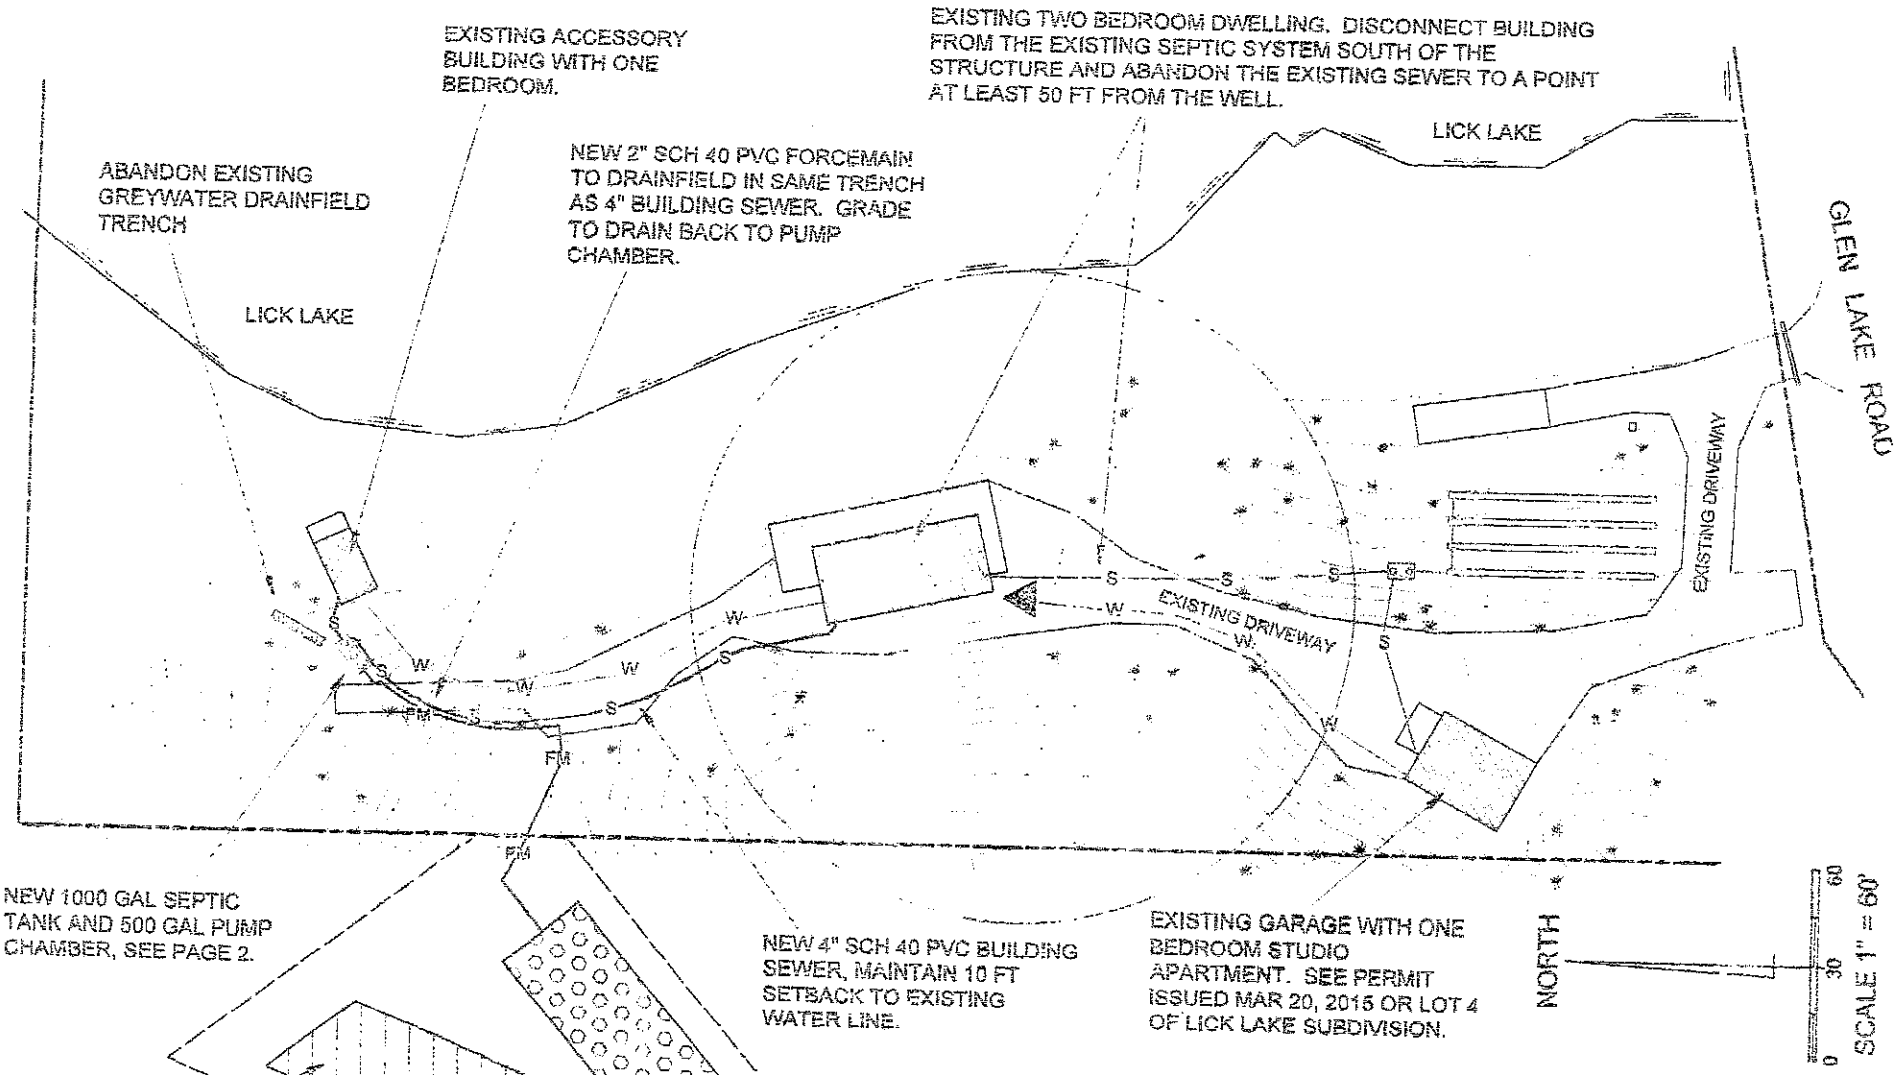

CONTOUR INTERVAL 2 FT

NOTE: ALL WORK SHALL CONFORM WITH CURRENT LINCOLN COUNTY AND MONTANA DEPARTMENT OF ENVIRONMENTAL QUALITY REGULATIONS.

DRAWN BY: DREW PASLAWSKY SEPTEMBER 2021

1

SITE PLAN
NEW SEPTIC SYSTEM

LOT 1 OF LICK LAKE II SUBDIVISION
3105 GLEN LAKE RD, EUREKA, MT
NW 1/4 NW 1/4 S26-T36N-R26W
LINCOLN COUNTY

Andrew Paslawsky, PE
PO Box 4592 Whitefish, MT 59937
406-862-1647