LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit #24-55413

Issue Date: 08/16/2024(3rd Renewal) 07/13/2023(2nd) Expiration Date: 08/15/2025(Renewal)

Property Owner: Michael D Johnson 1st permit issued 06/08/2010

Mailing Address: [redacted]

Installer: Clasen Enterprises License #: 181

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Install Pressure Dosed System. Four Laterals @ 65'.

Parcel Description:

Legal: S22, T36 N, R27 W, CS 3889, TRACT 2 IN S2N2, 8.434 ACRES

Property Address: 219 Primrose Lane Rexford, MT 59930 Assessment Code: 55413

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of pressure dosed system with 4 laterals @ 65'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 4 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 8/21/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER


This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

RECEIVED
JUL

JOHNSON PROPERTY

SE4 NW4 SECTION 22-T36N-R27W
LINCOLN COUNTY

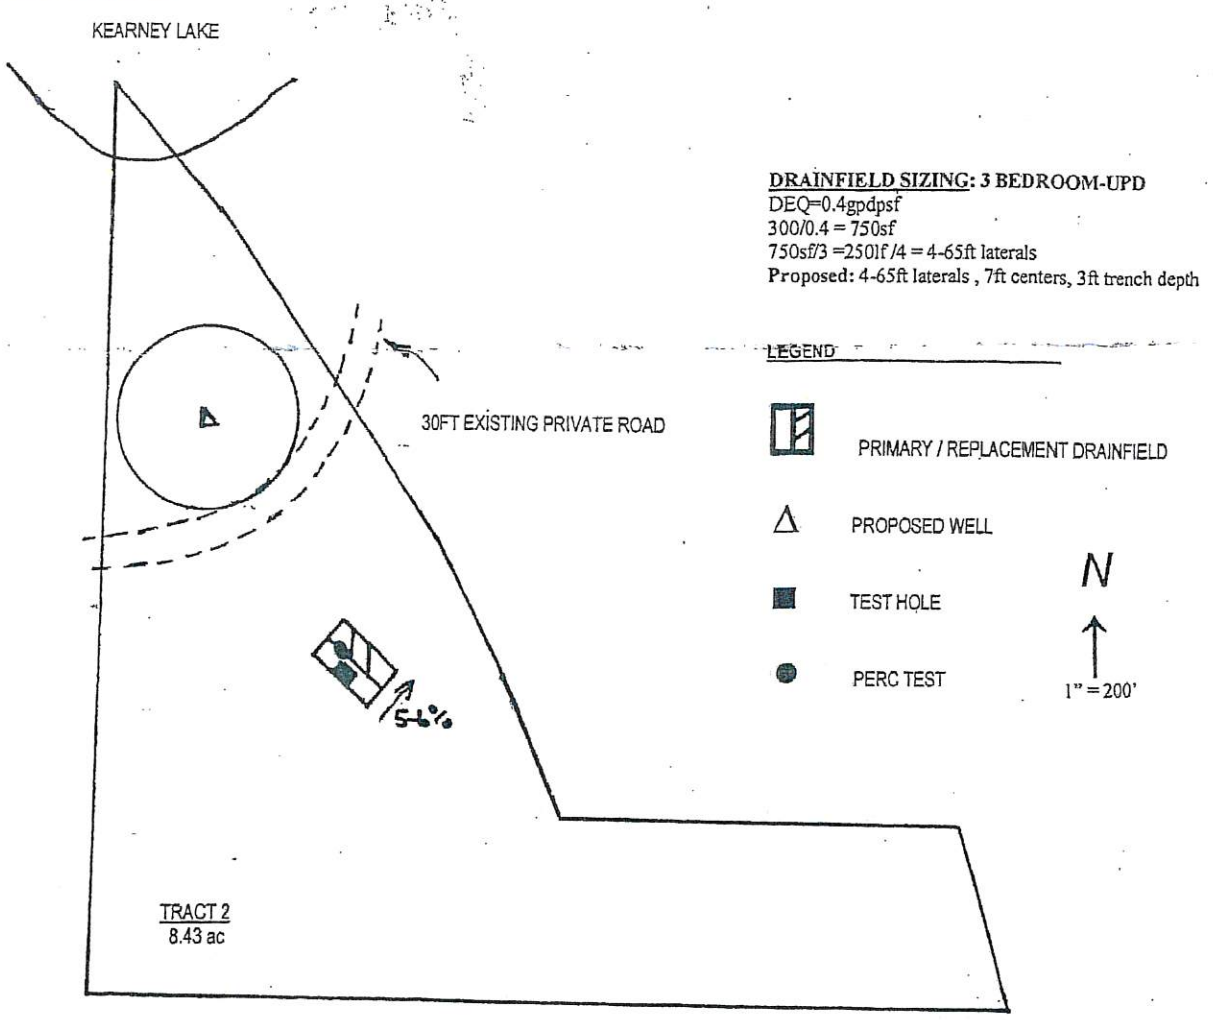

DRAINFIELD SIZING: 3 BEDROOM-UPD
DEQ=0.4gpdpsf
300/0.4 = 750sf
750sf/3 =250lf /4 = 4-65ft laterals
Proposed: 4-65ft laterals , 7ft centers, 3ft trench depth

LEGEND

- PRIMARY / REPLACEMENT DRAINFIELD
- PROPOSED WELL
- TEST HOLE
- PERC TEST

N

1" = 200'

Jere Johnson, R.S
Environmental Health Consulting
4572 Whitefish Stage Road
Whitefish MT 59937