NEW

file

SEPTIC TANK PERMIT
for
LINCOLN COUNTY

Permit Sent _____

Phone _____

Date 4-28-81

Property Owner JOHN MILLER Address [redacted]


Lot, Block Number, or legal description of Property Bl 1 Lot 67 Angel Island

To be built by: _____ Square feet absorption area. 260

Septic Tank Size 750 gal Min. # of bedrooms 1 Water Supply Community


Description of Absorption Area: Dig a ditch 130' long x 2½-3' deep x 2' wide according to lot layout and ditch diagram. Slope of pipe should not exceed a 1% drop.

Sketch; Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

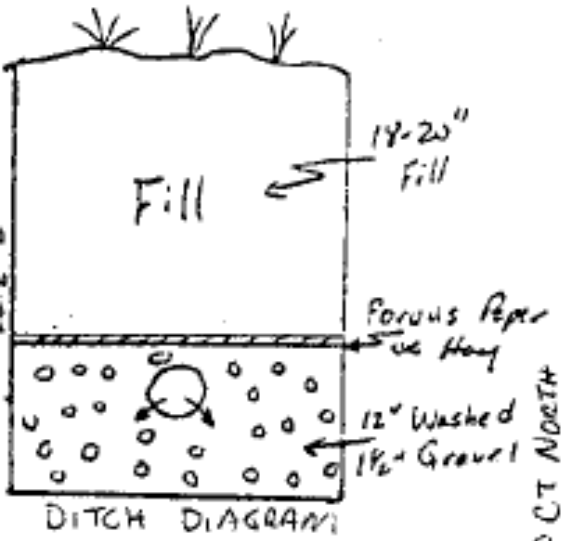

DITCH DIAGRAM

LOT LAYOUT

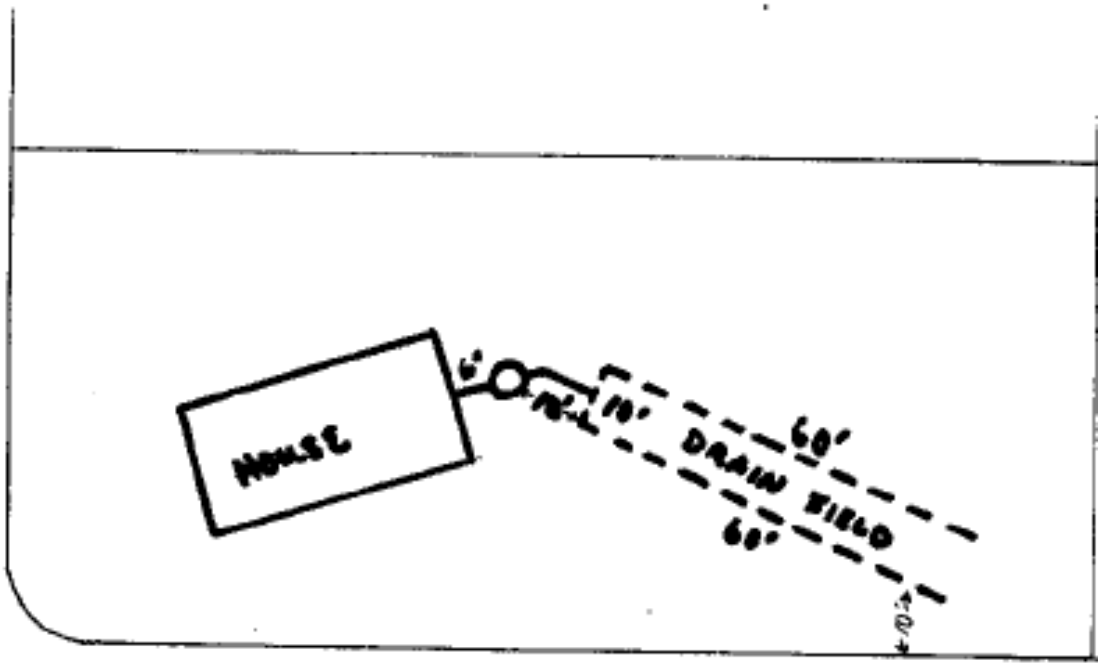

SOIL: Sandy Silt

SLOPE: 0%

Issued by John W. Peterson, R.S. Inspected by _____

Date 4-28-81