Permit # 24-5536

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/08/24 (Renewal) 07/03/2023 Expiration Date: 10/07/2025

Property Owner: Lisa Miller

Mailing Address: [redacted]

Installer: Royden Caldwell License #: 171

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system with chambers.

Parcel Description:

Legal: PINE BAY NO 2, S15, T36 N, R28 W, ACRES 0.91, LOT 43 SEC15&22

Property Address: 68 Pine Cone Ln., Rexford, MT 59930 Assessment Code: 5536

DEQ COSA: EQ#27-77-K855 Date: 08/17/77

Approved Design Criteria: Installation of new gravity system with chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 64' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

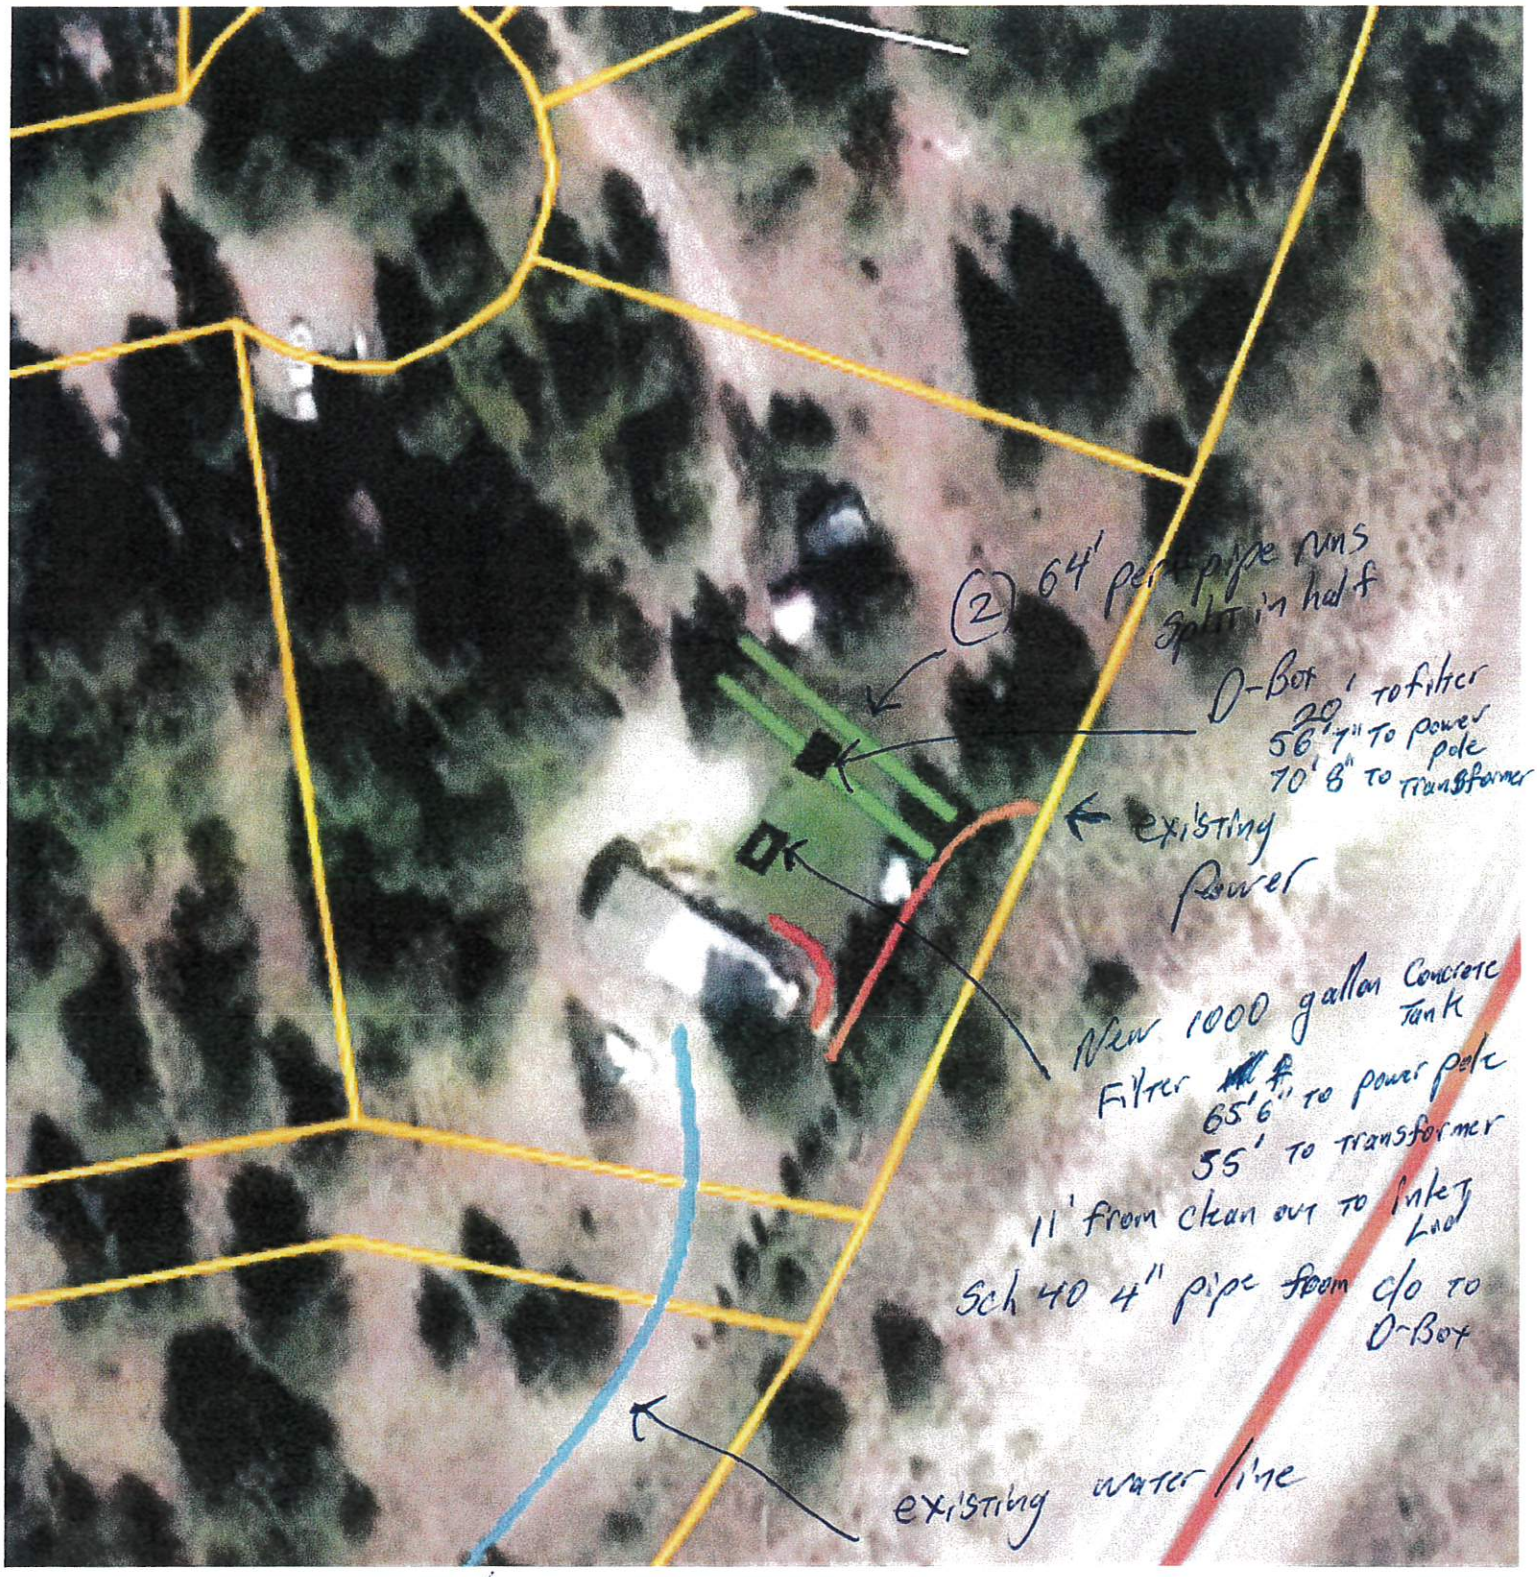
Signed: Robin Blumberg *Date:* 10/17/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


(2) 64' perf pipe runs split in half
O-Bot
20' to filter
56' 7" to power pole
70' 8" to transformer
existing power
New 1000 gallon Concrete Tank
Filter
65' 6" to power pole
55' to transformer
11' from clean out to Inlet Lid
Sch 40 4" pipe from c/o to O-Bot
existing water line

RC 10/16-18/24