LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/02/2008 Expiration Date: 06/03/2009

Property Owner: Raymond & Kelli Nelson

Address: [redacted]

Telephone: [redacted] [redacted]

Installer: Bill Merritt License No. 76

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing pressure-dosed system.

Parcel Description:

Legal: Block 3 Lot 9 of Angel Island

Address or Location: Bethel Drive

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 100 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

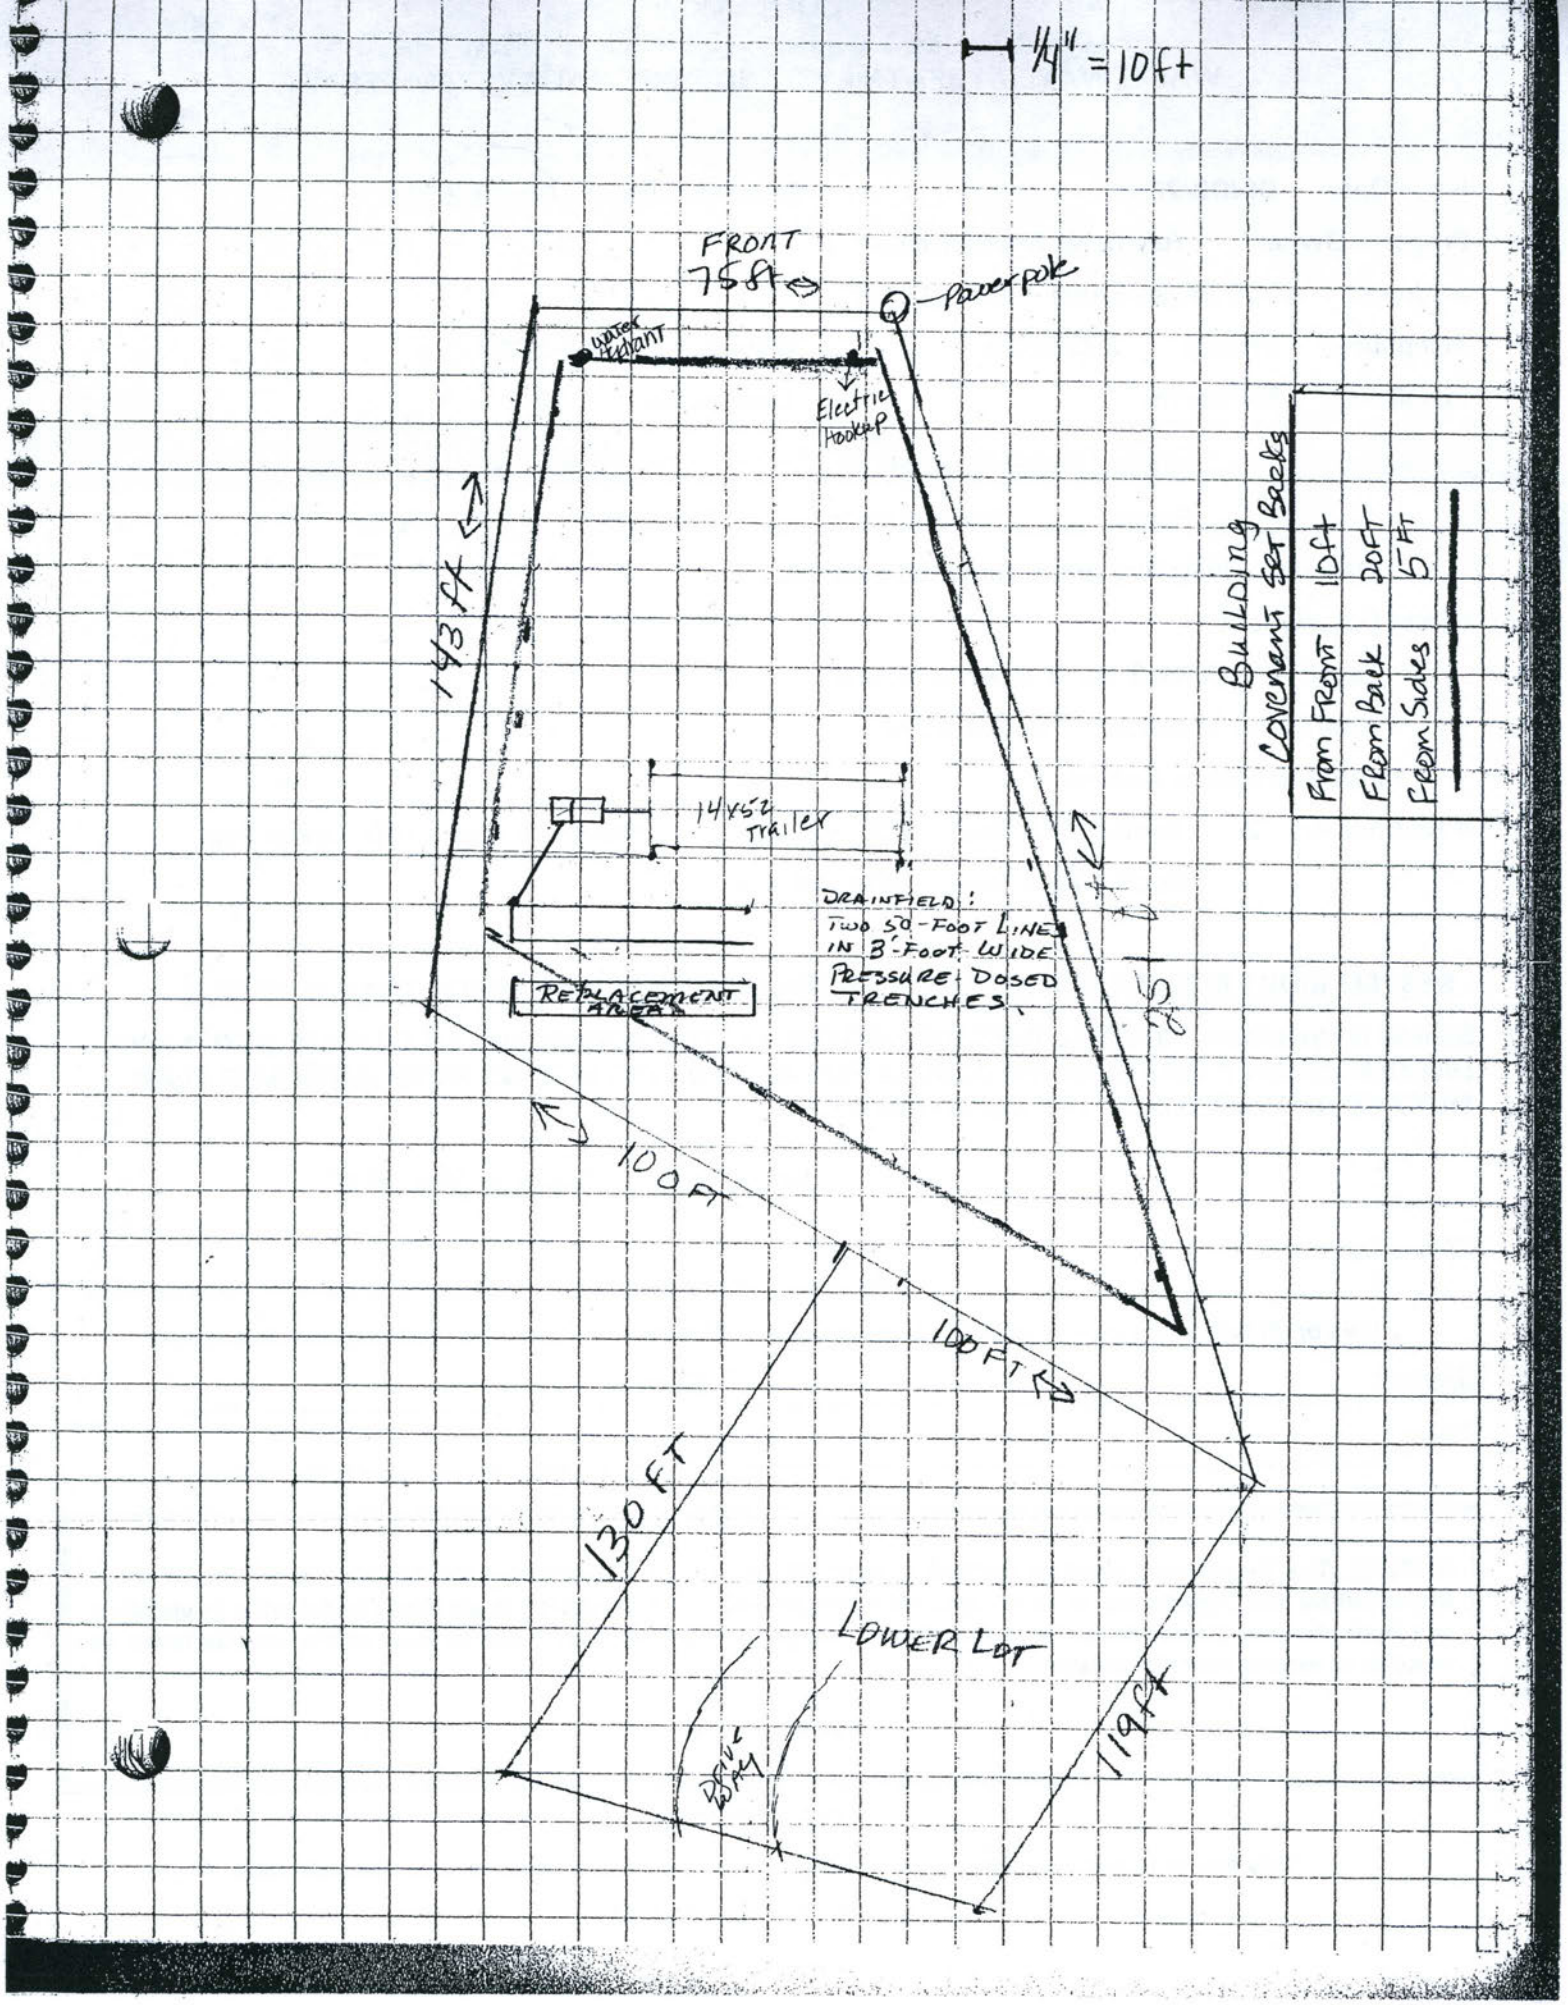
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


1/4" = 10ft
FRONT
75ft
Power pole
Water Hydrant
Electric Hookup
143ft
14x52 Trailer
DRAINFIELD:
TWO 50-FOOT LINES
IN 3-FOOT WIDE
PRESSURE DOSED
TRENCHES.
REPLACEMENT AREA
100 FT
100 FT
130 FT
LOWER LOT
119ft
BUILDING
COVENANT SET BACKS
From Front 10ft
From Back 20ft
From Sides 5ft