LINCOLN COUNTY HEALTH DEPARTMENT Permit #25-6037
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/09/2025 Expiration Date: 01/08/2026

Property Owner: Karen Riedlinger

Mailing Address: [redacted]

Installer: Logan Munts License #: 160

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House with a failed system.

Legal: S20, T30 N, R33 W, COS 4748, PARCEL B, ACRES 44.55

Property Address: 27279 Bull Lake Rd., Troy, MT 59935 Assessment Code: 6037

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 3 Laterals @ 70' to replace failed system. Drainfield must be at least 205' from Twin Creek.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 3 Length of Laterals: 70' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

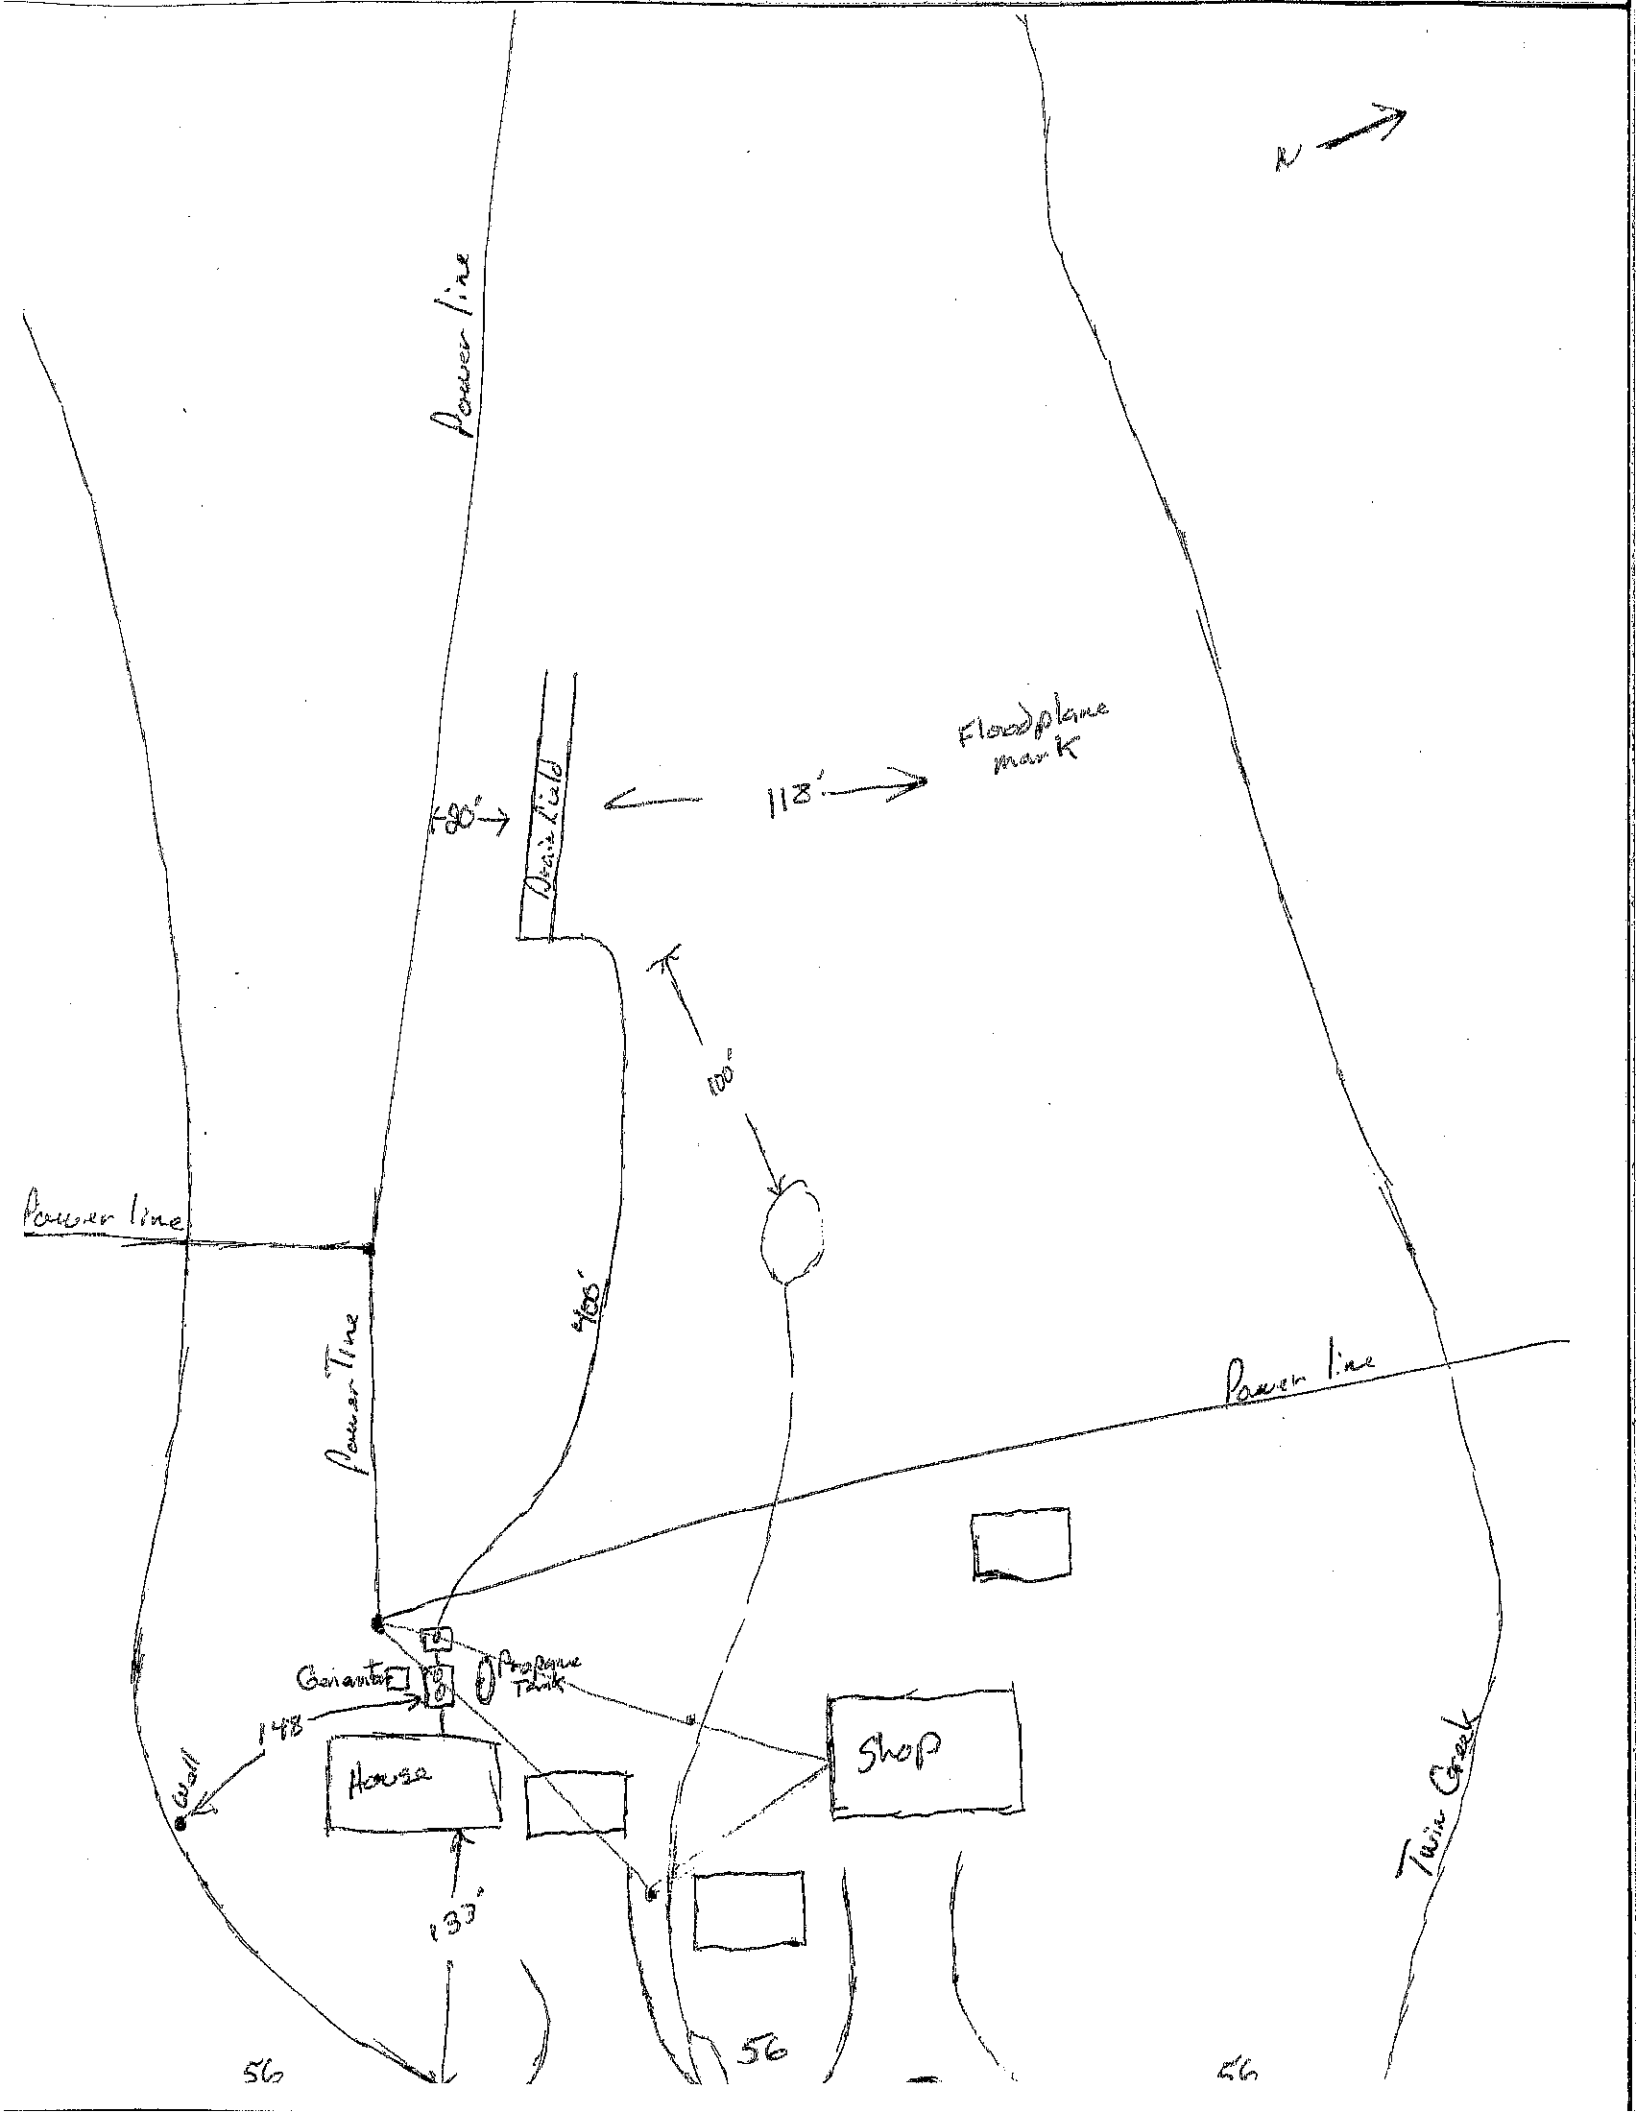
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 1/17/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


N
Power line
Power line
Power line
Power line
Power line
Dirt Rd
80'
118'
Floodplain mark
100'
400'
Generator
Propane Tank
148
Well
House
133'
Shop
Twin Creek
56
56
56