LINCOLN COUNTY HEALTH DEPARTMENT Permit # 24-54568
ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 8/1/2024

Property Owner: Mary Lou Stamper

Mailing Address: [redacted]

Telephone: [redacted]

Who Installed System Being Reviewed: Jack Stamper Date Installed: 1990

Type of System Work Reviewed:

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Use of System: Three bedroom home

Property Description:

Legal: S03 T36N R27W, C.O.S. 5062 Parcel B, 11.32 acres

Address or Location: 94 Indian Meadows Ln, Eureka, MT 59917

Reviewed System Components:

# of Bedrooms: 3	Septic Tank: 1000 gallons	Drainfield Construction: pipe & rock
# of Laterals: 3	Length of Laterals: 100'	Trench Width: 24 inches

Comments: Gravity system using 1000 gallon tank and 2' wide trenches with perf pipe and drain rock. Tank was pumped 7/25/23 and no problems were noted. Statement signed 7/10/24 reported system functioning properly and sized appropriately for the three bedroom house. No floodplain or setback violations noted. Any future extension, repair, replacement or change of use must be reviewed and permitted by Lincoln County Health Department.

System Review Documentation Statement:

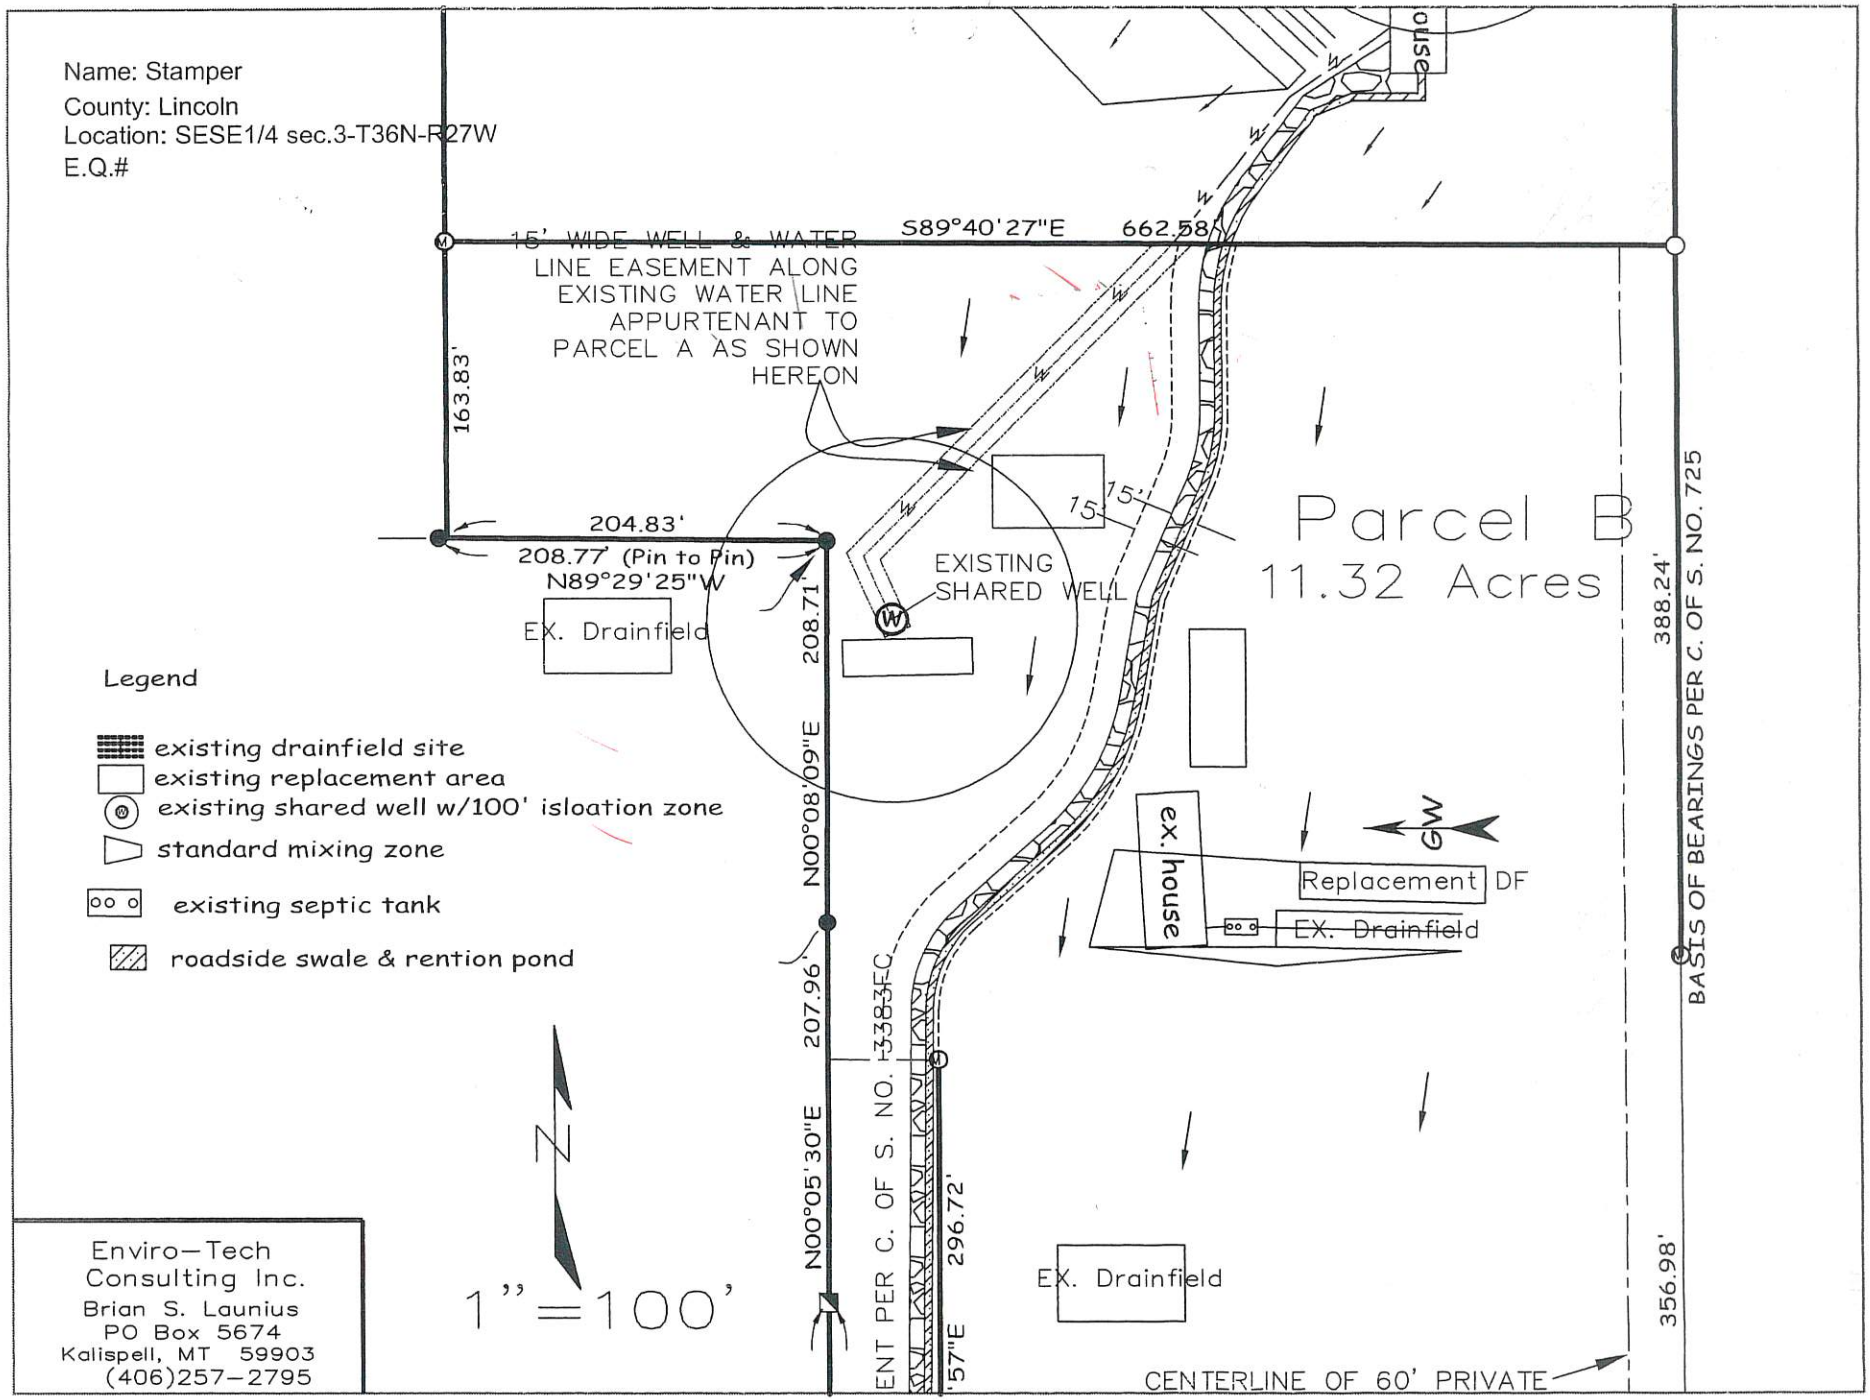
I, Kathi Hooper *, have reviewed the components of this system as listed above and found it to be in compliance with the requirements of A.R.M. Chapter 17.36 Subchapter 9, Circular DEQ-4 and Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 8-1-24

Title: Director

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment and disposal system. It is a statement that the Department has conducted a review of this system and found it to be in compliance with applicable requirements, making it a legal system for the use described above. The Department does not guarantee that this system will continue to function properly for any period of time.

SV


Name: Stamper
County: Lincoln
Location: SESE1/4 sec.3-T36N-R27W
E.Q.#
15' WIDE WELL & WATER LINE EASEMENT ALONG EXISTING WATER LINE APPURTENANT TO PARCEL A AS SHOWN HEREON
S89°40'27"E
662.58'
163.83'
204.83'
208.77' (Pin to Pin)
N89°29'25"W
EX. Drainfield
EXISTING SHARED WELL
15'
15'
Parcel B
11.32 Acres
208.71'
N00°08'09"E
207.96'
N00°05'30"E
296.72'
388.24'
BASIS OF BEARINGS PER C. OF S. NO. 725
ex. house
GW
Replacement DF
EX. Drainfield
EX. Drainfield
CENTERLINE OF 60' PRIVATE
Legend
existing drainfield site
existing replacement area
existing shared well w/100' isloation zone
standard mixing zone
existing septic tank
roadside swale & rention pond
1" = 100'
Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795