Permit# 25-9538

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/26/2025 Expiration Date: 02/25/2026

Property Owner: Ralph Taylor

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☐ New Installation ☐ Existing System

☐ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of replacement tank for 3 Bedroom House.

Legal: GLENWOOD PARK, S04, T30 N, R31 W, LOT 45, ACRES 0.3214

Property Address: 83 Crossway Ave., Libby, MT 59923 Assessment Code: 9538

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of replacement tank for 3 Bedroom House.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width:

# of Laterals: Length of Laterals: Trench Depth:

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the Lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(if applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 3/4/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Drainfield

~~SEPTIC TANK~~ PERMIT

for

LINCOLN COUNTY

Permit Sent _____

Date 7-12-76

Phone 3-6367

Property Owner Ralph Taylor Address RT. 3 Box 1143 Libby


Lot, Block Number, or legal description of Property Lot 45 Glenwood Park

To be built by: ORR Square feet absorption area. 200 sq. ft.

Septic Tank Size 1000 gal # of bedrooms 3 Water Supply City

Description of Absorption Area: Dig a bed 20' x 10' x 2½ feet deep according to lot layout and bed diagram — Note - bed pipe must be level.

Sketch; Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

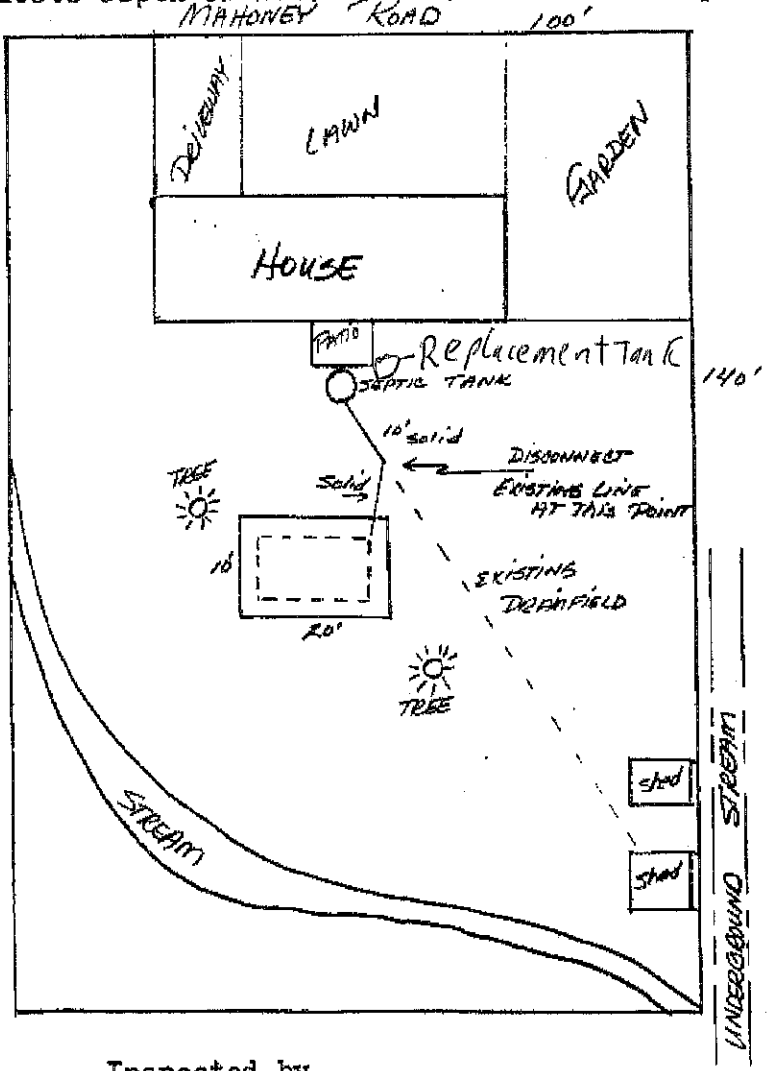

Issued by Tom Anderson Inspected by _____

Date 7-12-76