LINCOLN COUNTY HEALTH DEPARTMENT Permit #24-3188
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/30/2024 Expiration Date: 10/29/2025

Property Owner: Tungsten Holdings

Mailing Address: [redacted]

Installer: Dan Halvorson License #: 161

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of 1000 Gallon Replacement tank.

Parcel Description:

Legal: WHITEHAVEN, S23, T30 N, R31 W, BLOCK 1, ACRES 0.619, LOT 21 150X180

Property Address: 228 White Ave., Libby, MT 59923 Assessment Code: 3188

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of 1000 Gallon Replacement tank.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width:

# of Laterals: Length of Laterals: Trench Depth:

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

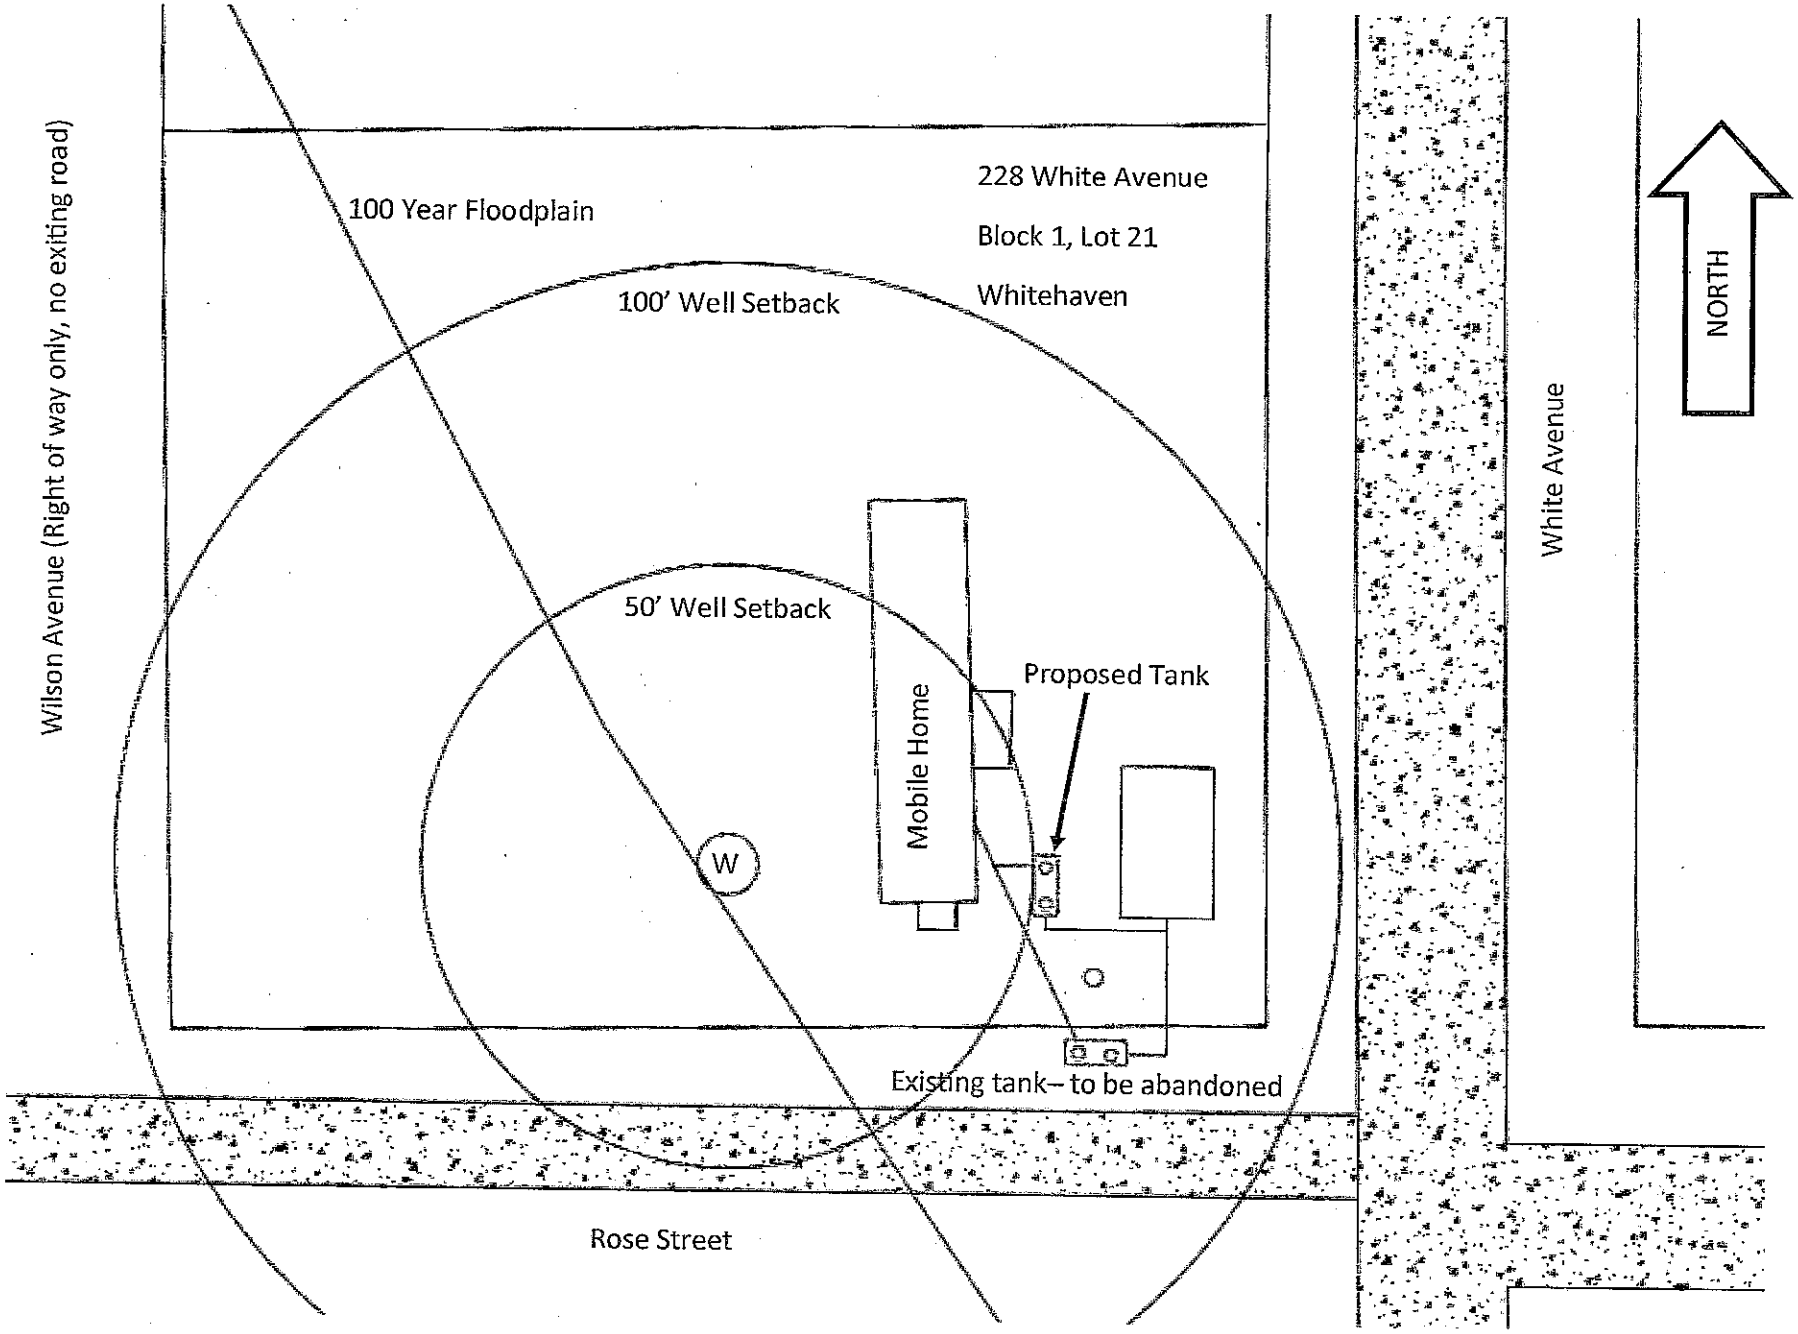
Signed: Robin Blumberg *Date:* 11/7/24

____ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SV


Wilson Avenue (Right of way only, no exiting road)
100 Year Floodplain
228 White Avenue
Block 1, Lot 21
Whitehaven
100' Well Setback
50' Well Setback
Mobile Home
Proposed Tank
W
Existing tank– to be abandoned
Rose Street
White Avenue
NORTH