Permit # 24-21003

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/16/2024 Expiration Date: 10/15/2025

Property Owner: Darrell and Pamela Willson

Mailing Address: [redacted]

Installer: Duane Smith License #: 99

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Parcel Description:

Legal: HARRELL'S, S05, T33 N, R34 W, LOT 2, ACRES 5, PM 6940

Property Address: 3828 Old US Hwy 2 N., Troy, MT 59935 Assessment Code: 21003

DEQ COSA: EQ#08-2388 Date: 07/27/2008

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 3 Laterals @ 100'.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 11/4/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD


This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

LOT LAYOUT
HARRELLS SUBDIVISION
SEC. 5 T33N R34W
LINCOLN COUNTY, MONTANA

EQ # 08-2388
Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality/ PCD
Local Reviewer — Date 07/27/2008

Accepted under contract
DEQ Representative — Date 7/28/08

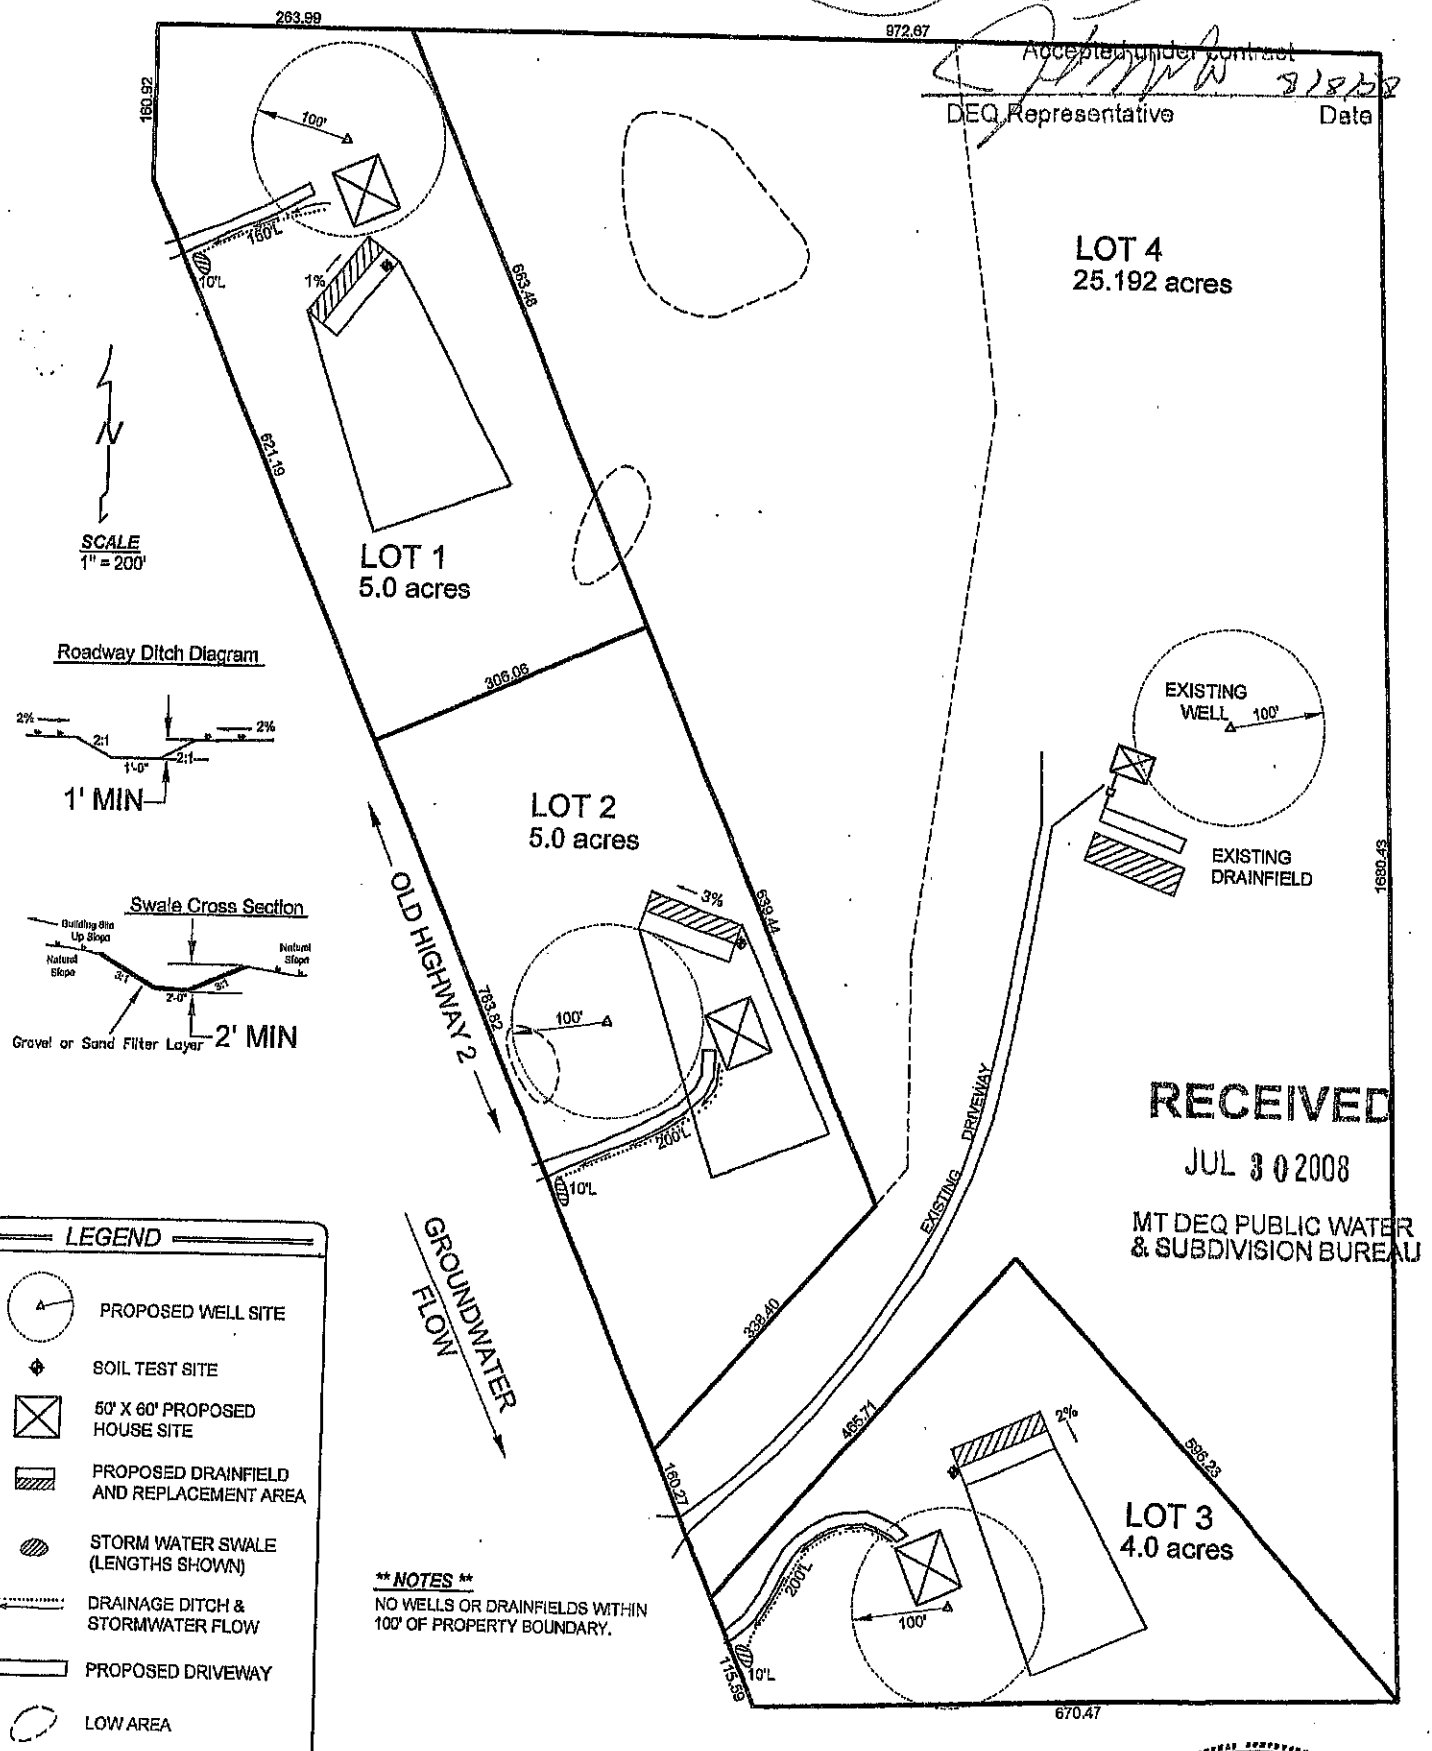

Roadway Ditch Diagram

Swale Cross Section

RECEIVED
JUL 30 2008
MT DEQ PUBLIC WATER & SUBDIVISION BUREAU

LEGEND

- PROPOSED WELL SITE
- SOIL TEST SITE
- 50' X 60' PROPOSED HOUSE SITE
- PROPOSED DRAINFIELD AND REPLACEMENT AREA
- STORM WATER SWALE (LENGTHS SHOWN)
- DRAINAGE DITCH & STORMWATER FLOW
- PROPOSED DRIVEWAY
- LOW AREA

**** NOTES ****
NO WELLS OR DRAINFIELDS WITHIN 100' OF PROPERTY BOUNDARY.

Prepared by John W.Peterson