LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/17/2023 Expiration Date: 04/16/2024

Property Owner: Jim & Wendy Anderson

Mailing Address: [redacted]

Telephone: [redacted] E-mail: mds@eurekadsl.net (Buck)

Installer: Dale Schmidt (inspected by MDS) License #: 135

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: New Pressure Dosed system with 36" trenches

Parcel Description:

Legal: INDIAN CREEK HILLS, S03 T36N R27W, Lot 5, ACRES 2.17 PM 6882

Property Address: 435 Hollenback Circle, Eureka, MT 59917 Assessment Code: 55381

DEQ COSA: EQ 08-1365 Date: 02/01/08

Approved Design Criteria: Pressure-Dosed, Shallow Capped System

# of Bedrooms: 2 Septic Tank Size: 1000/500 gallons Trench Width: 36 inches

# of Laterals: 3 Length of Laterals: 64 lineal feet Trench Depth: 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg Date: 10/18/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

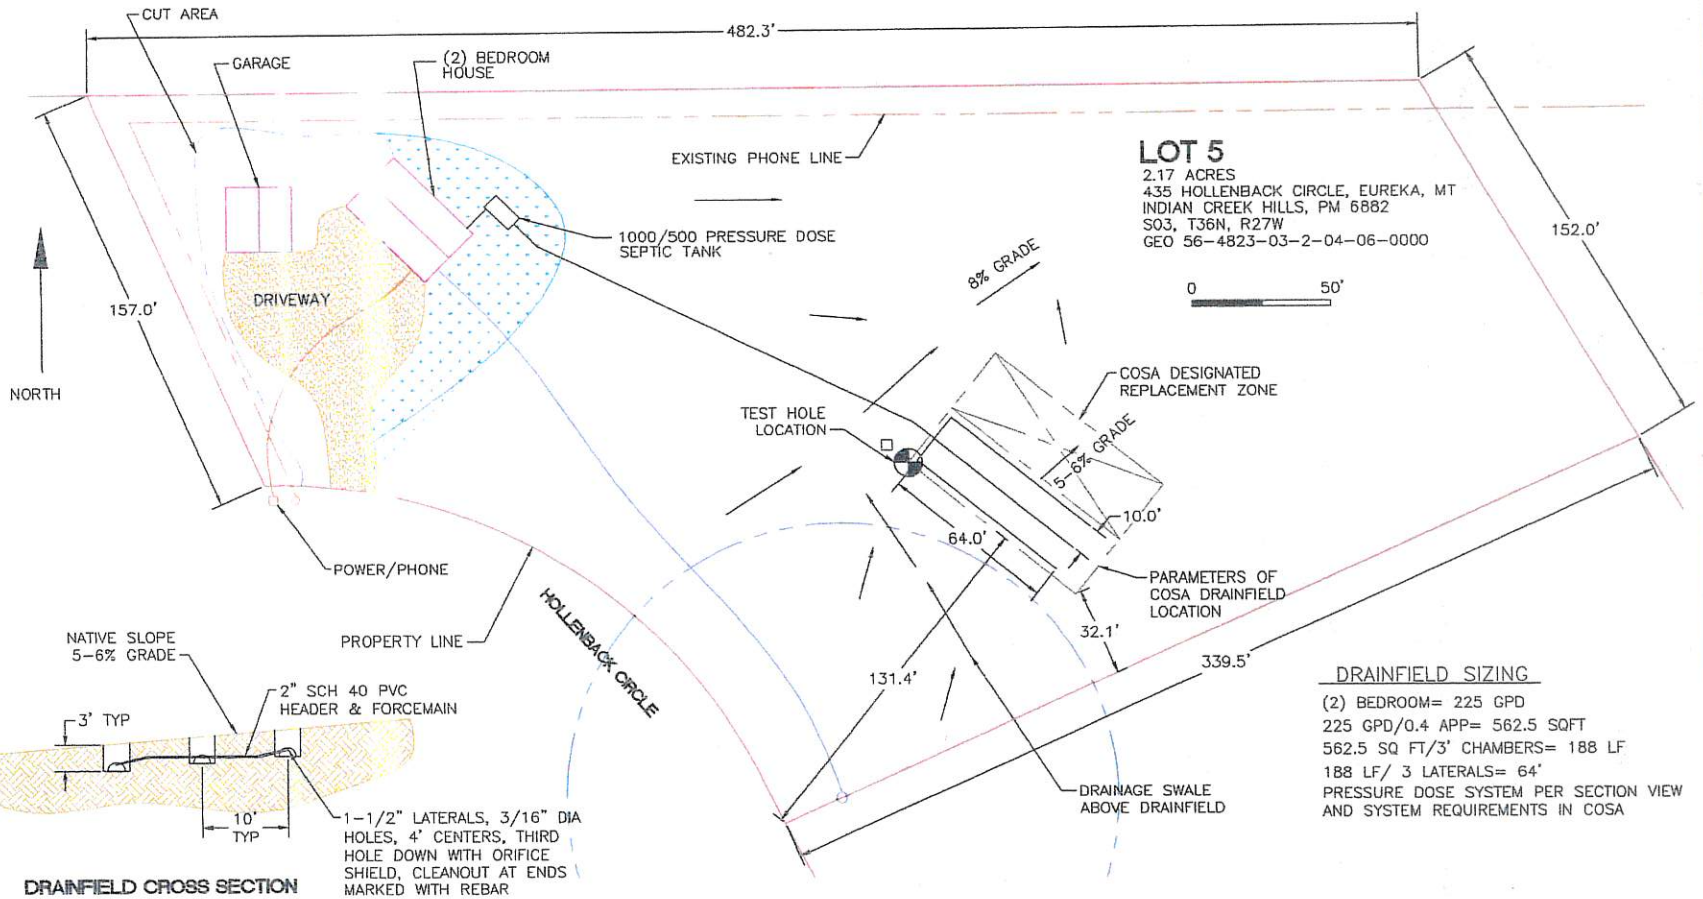

JIM ANDERSON SITE LAYOUT

REV	DESCRIPTION	BY/DATE	APPD/DATE

COMPANY	DSHE
SCALE	1/10 & NOTED
CONTRACT	
DATE	
VERBAL	4/2023
PLOT FILE	PML-0001
WEIGHT	
FINISH	
SCHMIDT HAULING & EXCAVATION	ANDERSON SEPTIC
SITE LAYOUT	
DRAWING NO.	401-001
DRAWN	3/14/23
CHECKED	3/15/23
REV	1

THIS DRAWING IS PROPERTY OF SCHMIDT HAUL CONTRACT HAS BEEN DESIGNED BETWEEN OWNER & SCHMIDT IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM THIS MANAGEMENT