Issue Date: 05/27/2020 Expiration Date: 05/27/2021

Property Owner: Jared Bean c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Renkema License No. 78

__XX__ New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Three 84' Laterals using gravelless chambers

Parcel Description:

Legal: IOLA RIDGE, S28, T36 N, R27 W, ACRES 31.45, LOT 1 PM 6821

Address or Location: Lot 1

Geo/Assessors code: 0000055260

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 252 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

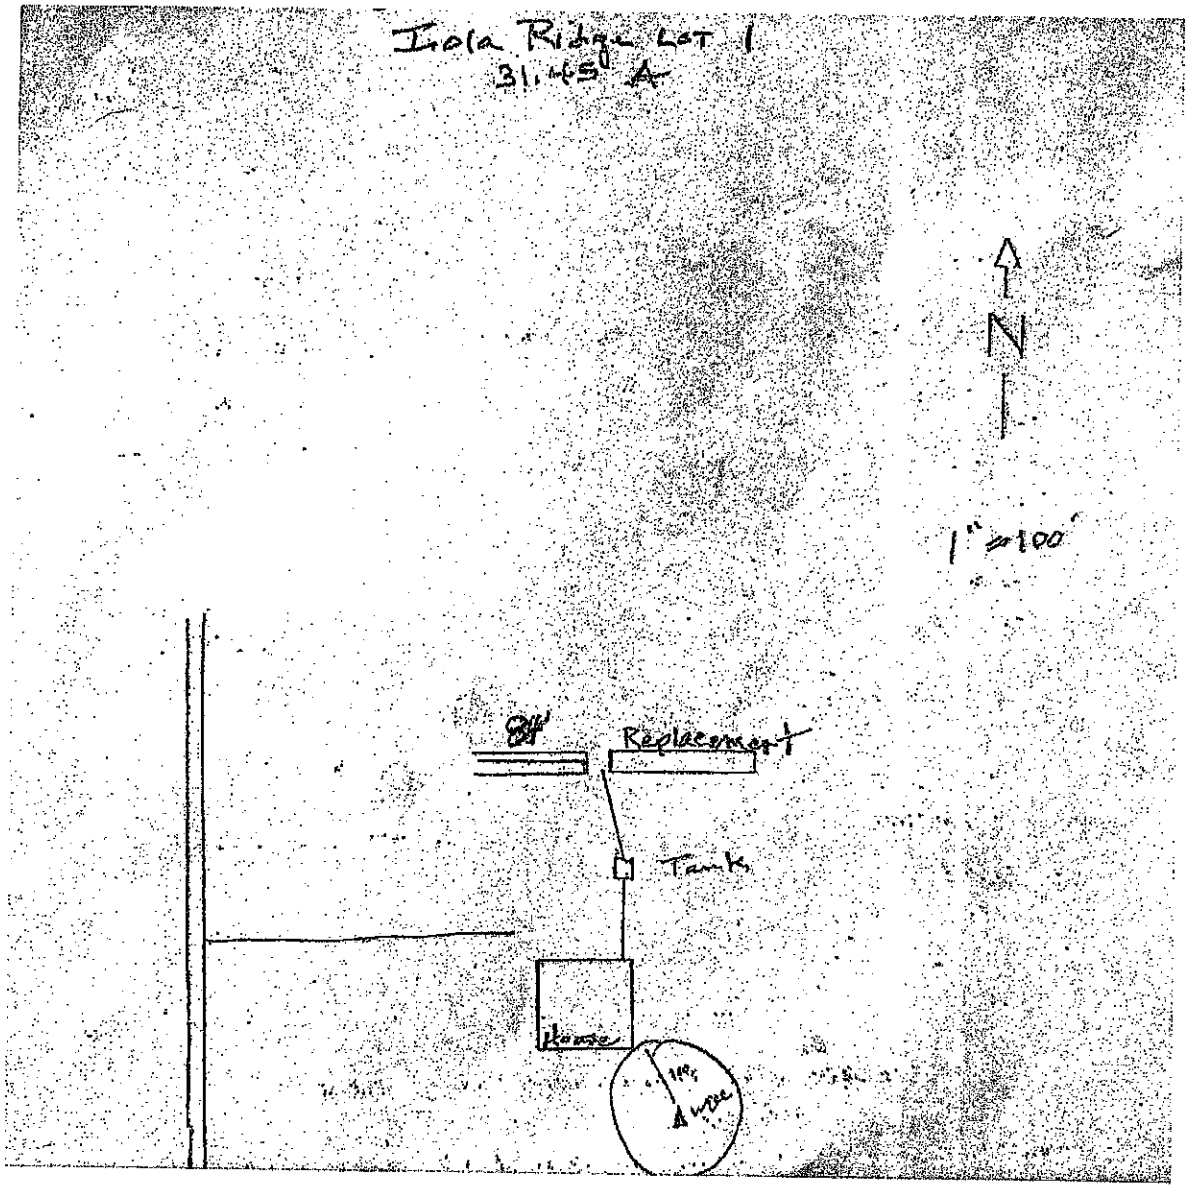
Closure Statement:

I, Dale Schmidt, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Dale Schmidt *Date:* 7-25-23

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


Iola Ridge Lot 1
31.45 A
N
1" = 100'
Replacement
Tank
House