LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/08/2010 Expiration Date: 06/09/2011

Property Owner: Konrad Bender & Steve Lister c/o: Jere Johnson

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Shared pressure-dosed system for two (2) single-family, 3-bedroom residences.

Parcel Description:

Legal: S28 T36 R27 Parcel A Assess. 17940

Address or Location: Briggs Shadow Drive – Eureka, MT *Approved Design Criteria*:

Bedrooms: 6 Septic Tank Size: 2000 gallons Drainfield Size: 400 Linear Feet

Dosing Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DETAIL PLANS BY JERE JOHNSON, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, BUCK SCHERMERHORN, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8-11-11


Title: LIC #135 PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

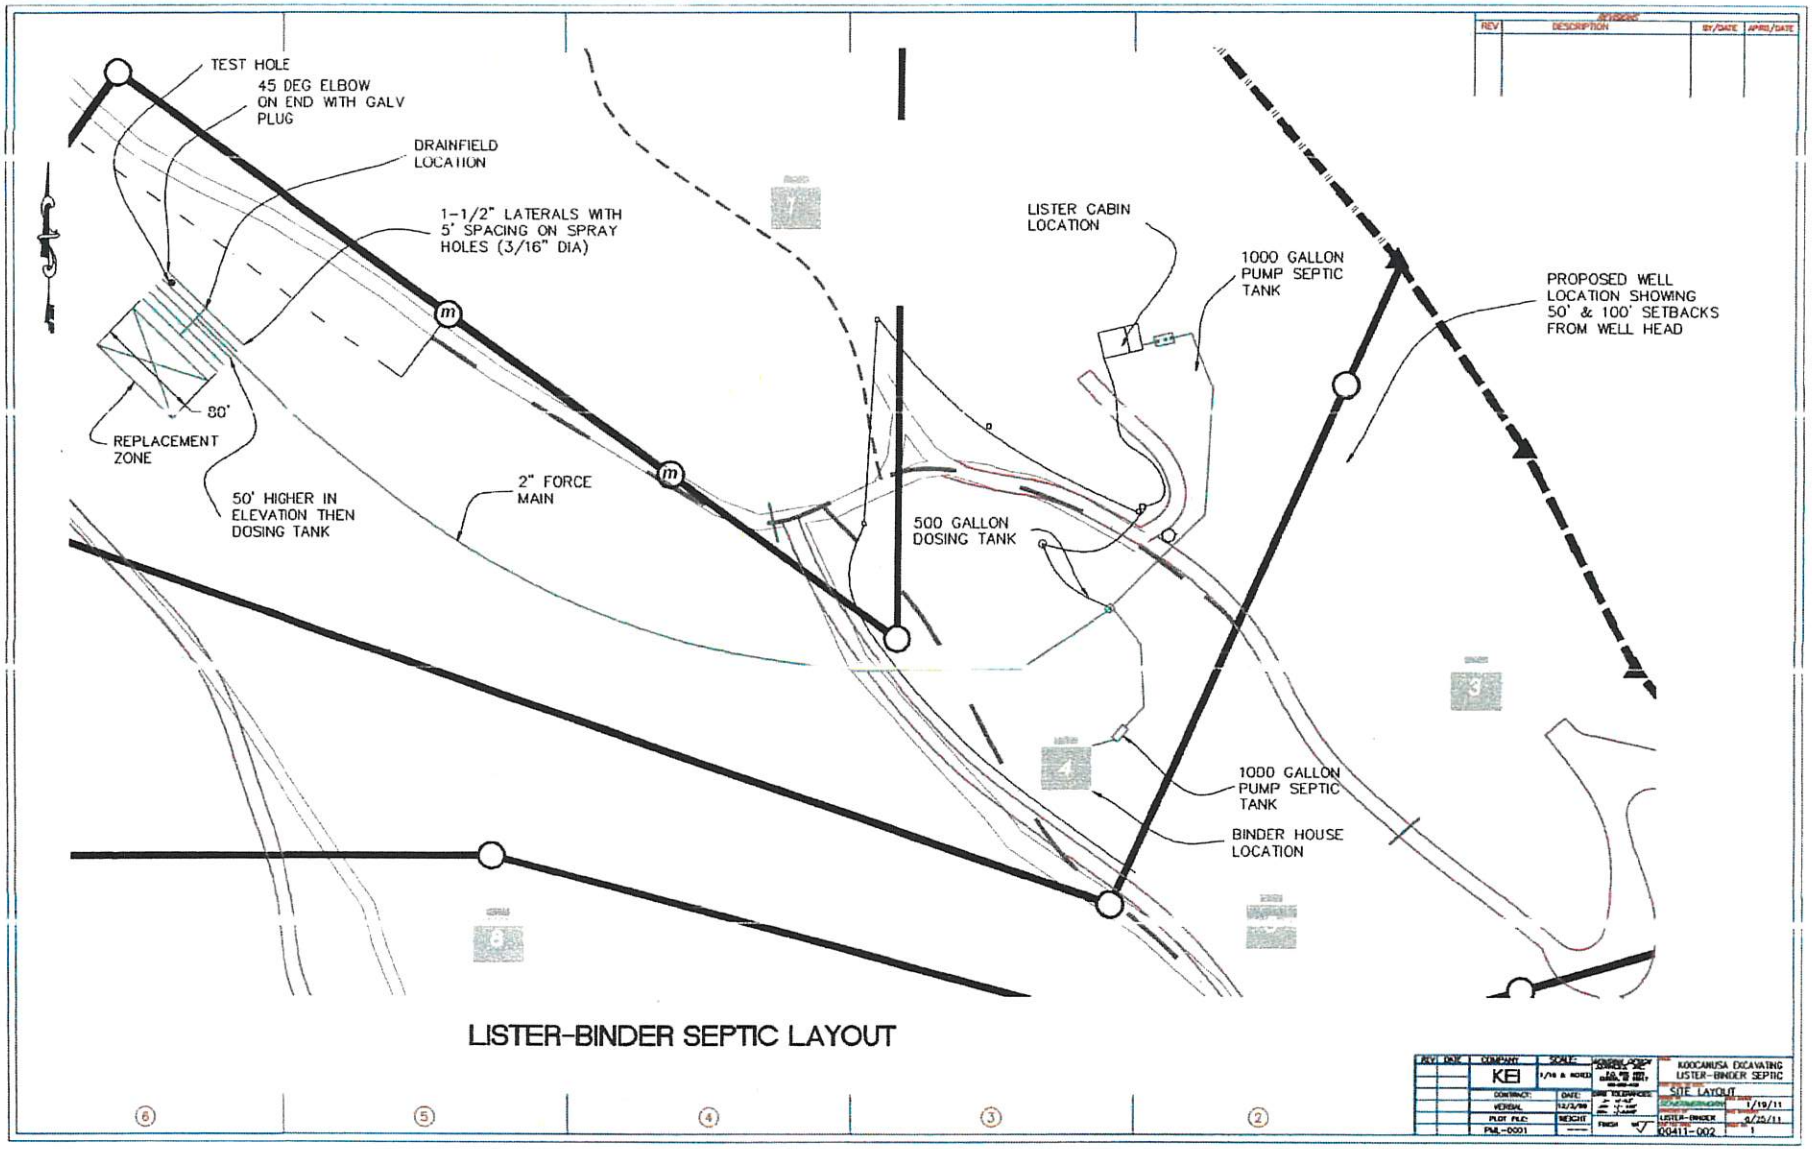

LISTER-BINDER SEPTIC LAYOUT