LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/6/2018 Expiration Date: 6/6/2019

Property Owner: Patti Ann Bennett c/o: Koocanusa Plumbing

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Plumbing License No. 169

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 75' trenches using gravelless chambers, size reduced per application rate.

Parcel Description:

Legal: S19 T35 R25

Address or Location: Crystal Lakes Unit 1 Lot 75

Geo/Assessors code: 0000000677

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 150 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, David Uhl, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: David Uhl *Date:* 12-3-2018


Title: owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

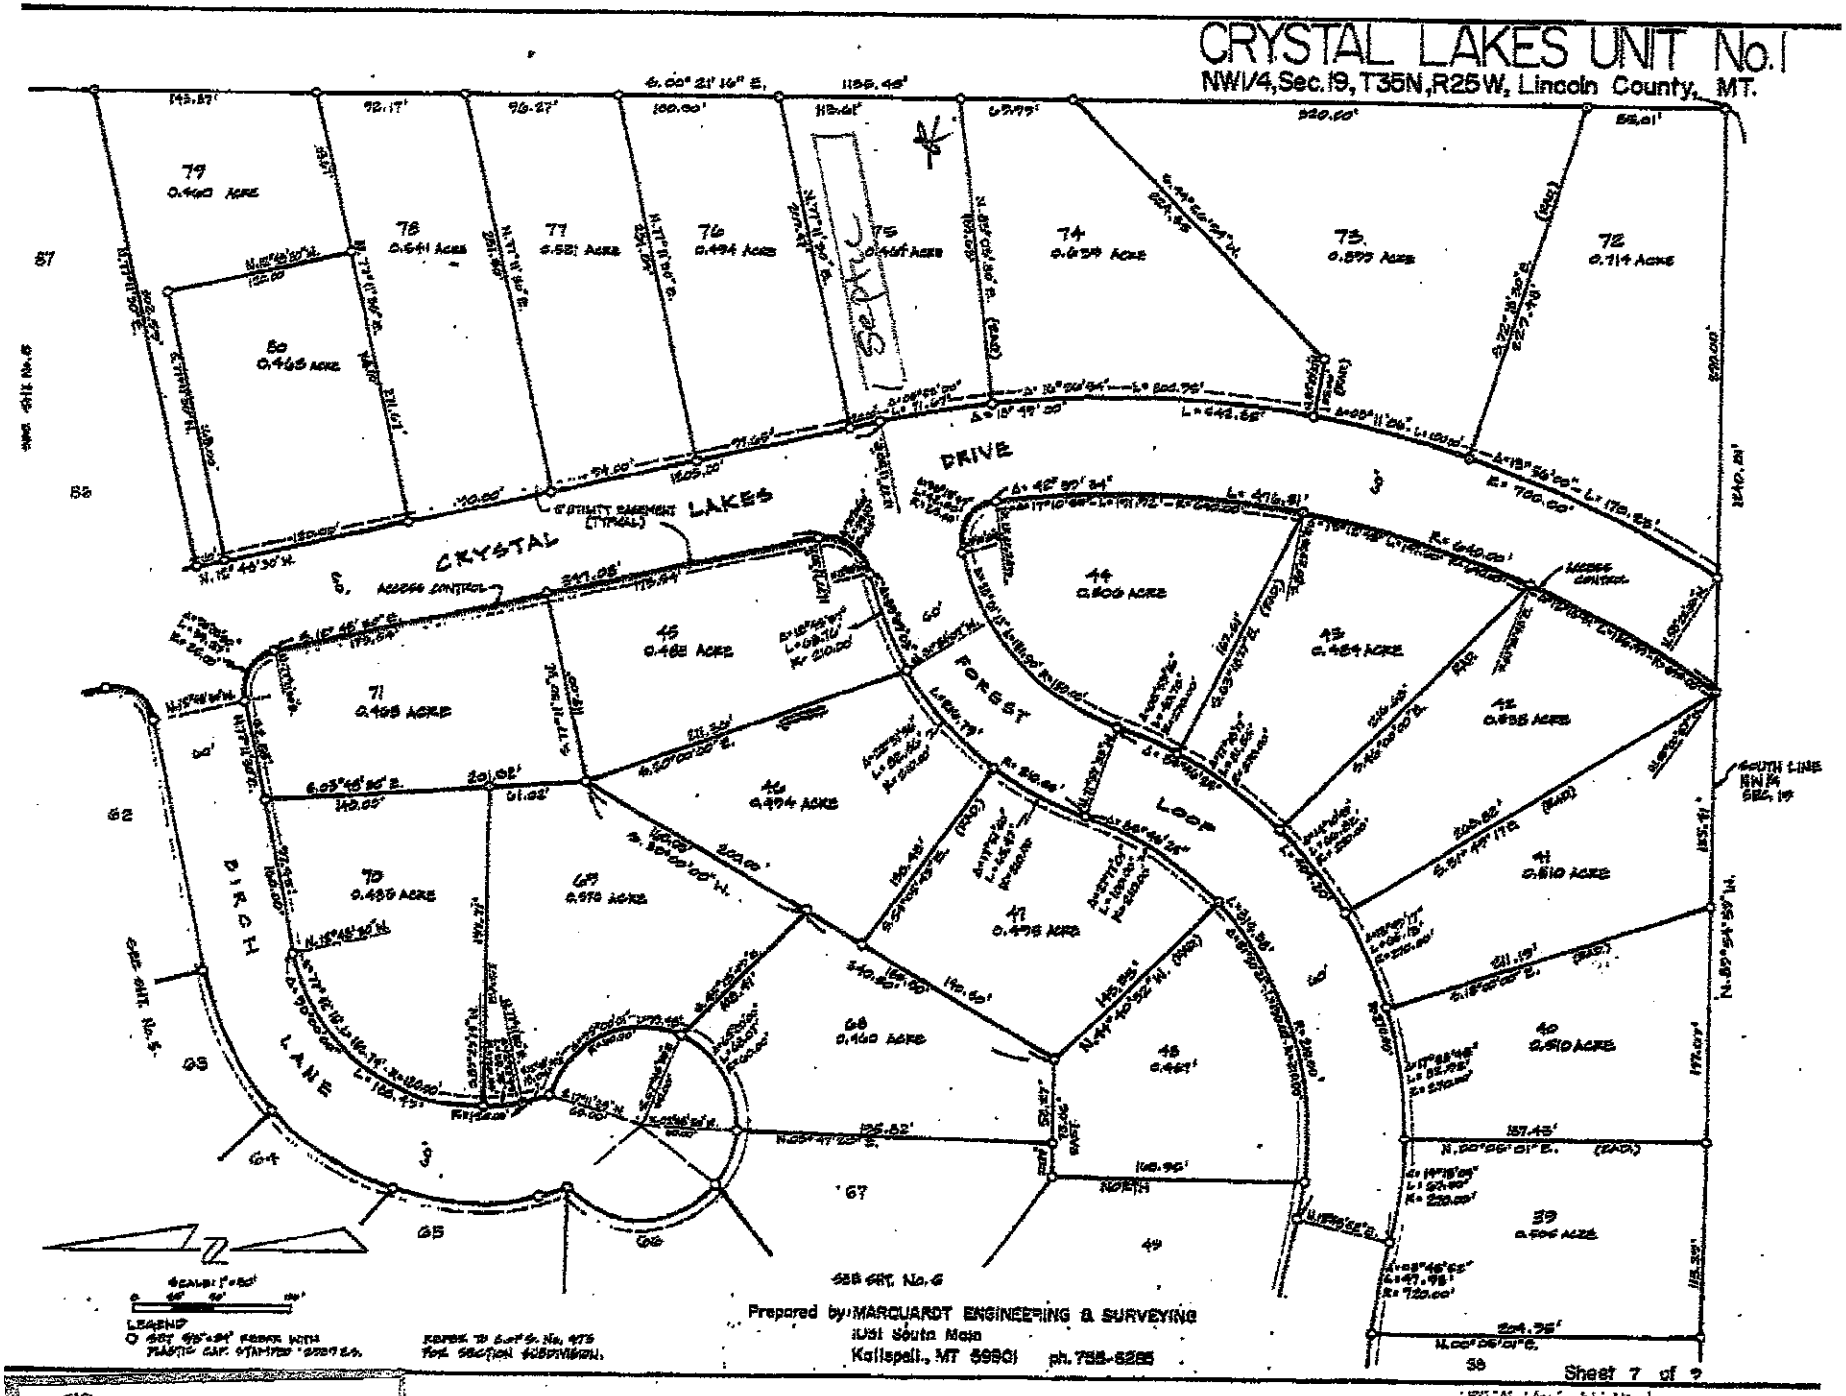

Pattiann Bennett
324 Terning Dr. W.
Eureka, MT 59917