LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/02/2022 (rev 8/10/2023) Expiration Date: 11/01/2023

Property Owner: Serge Bisson

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: *Licensed Installer Required* License #:

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Pressure dosed system with gravelless trenches

Parcel Description:

Legal: Glen Lake Hills, Lot 14, S27 T36N R26W, 4.08 acres

Property Address: 316 Evergreen Dr, Eureka, MT Assessment Code: 54726

Approved Design Criteria: One single family dwelling not to exceed 3 bedrooms per EQ #06-3180

# of Bedrooms: 3 Septic Tank Size: 2000/500 gallons Trench Width: 36 inches

# of Laterals: 5 Length of Laterals: 100 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: *Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.*

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

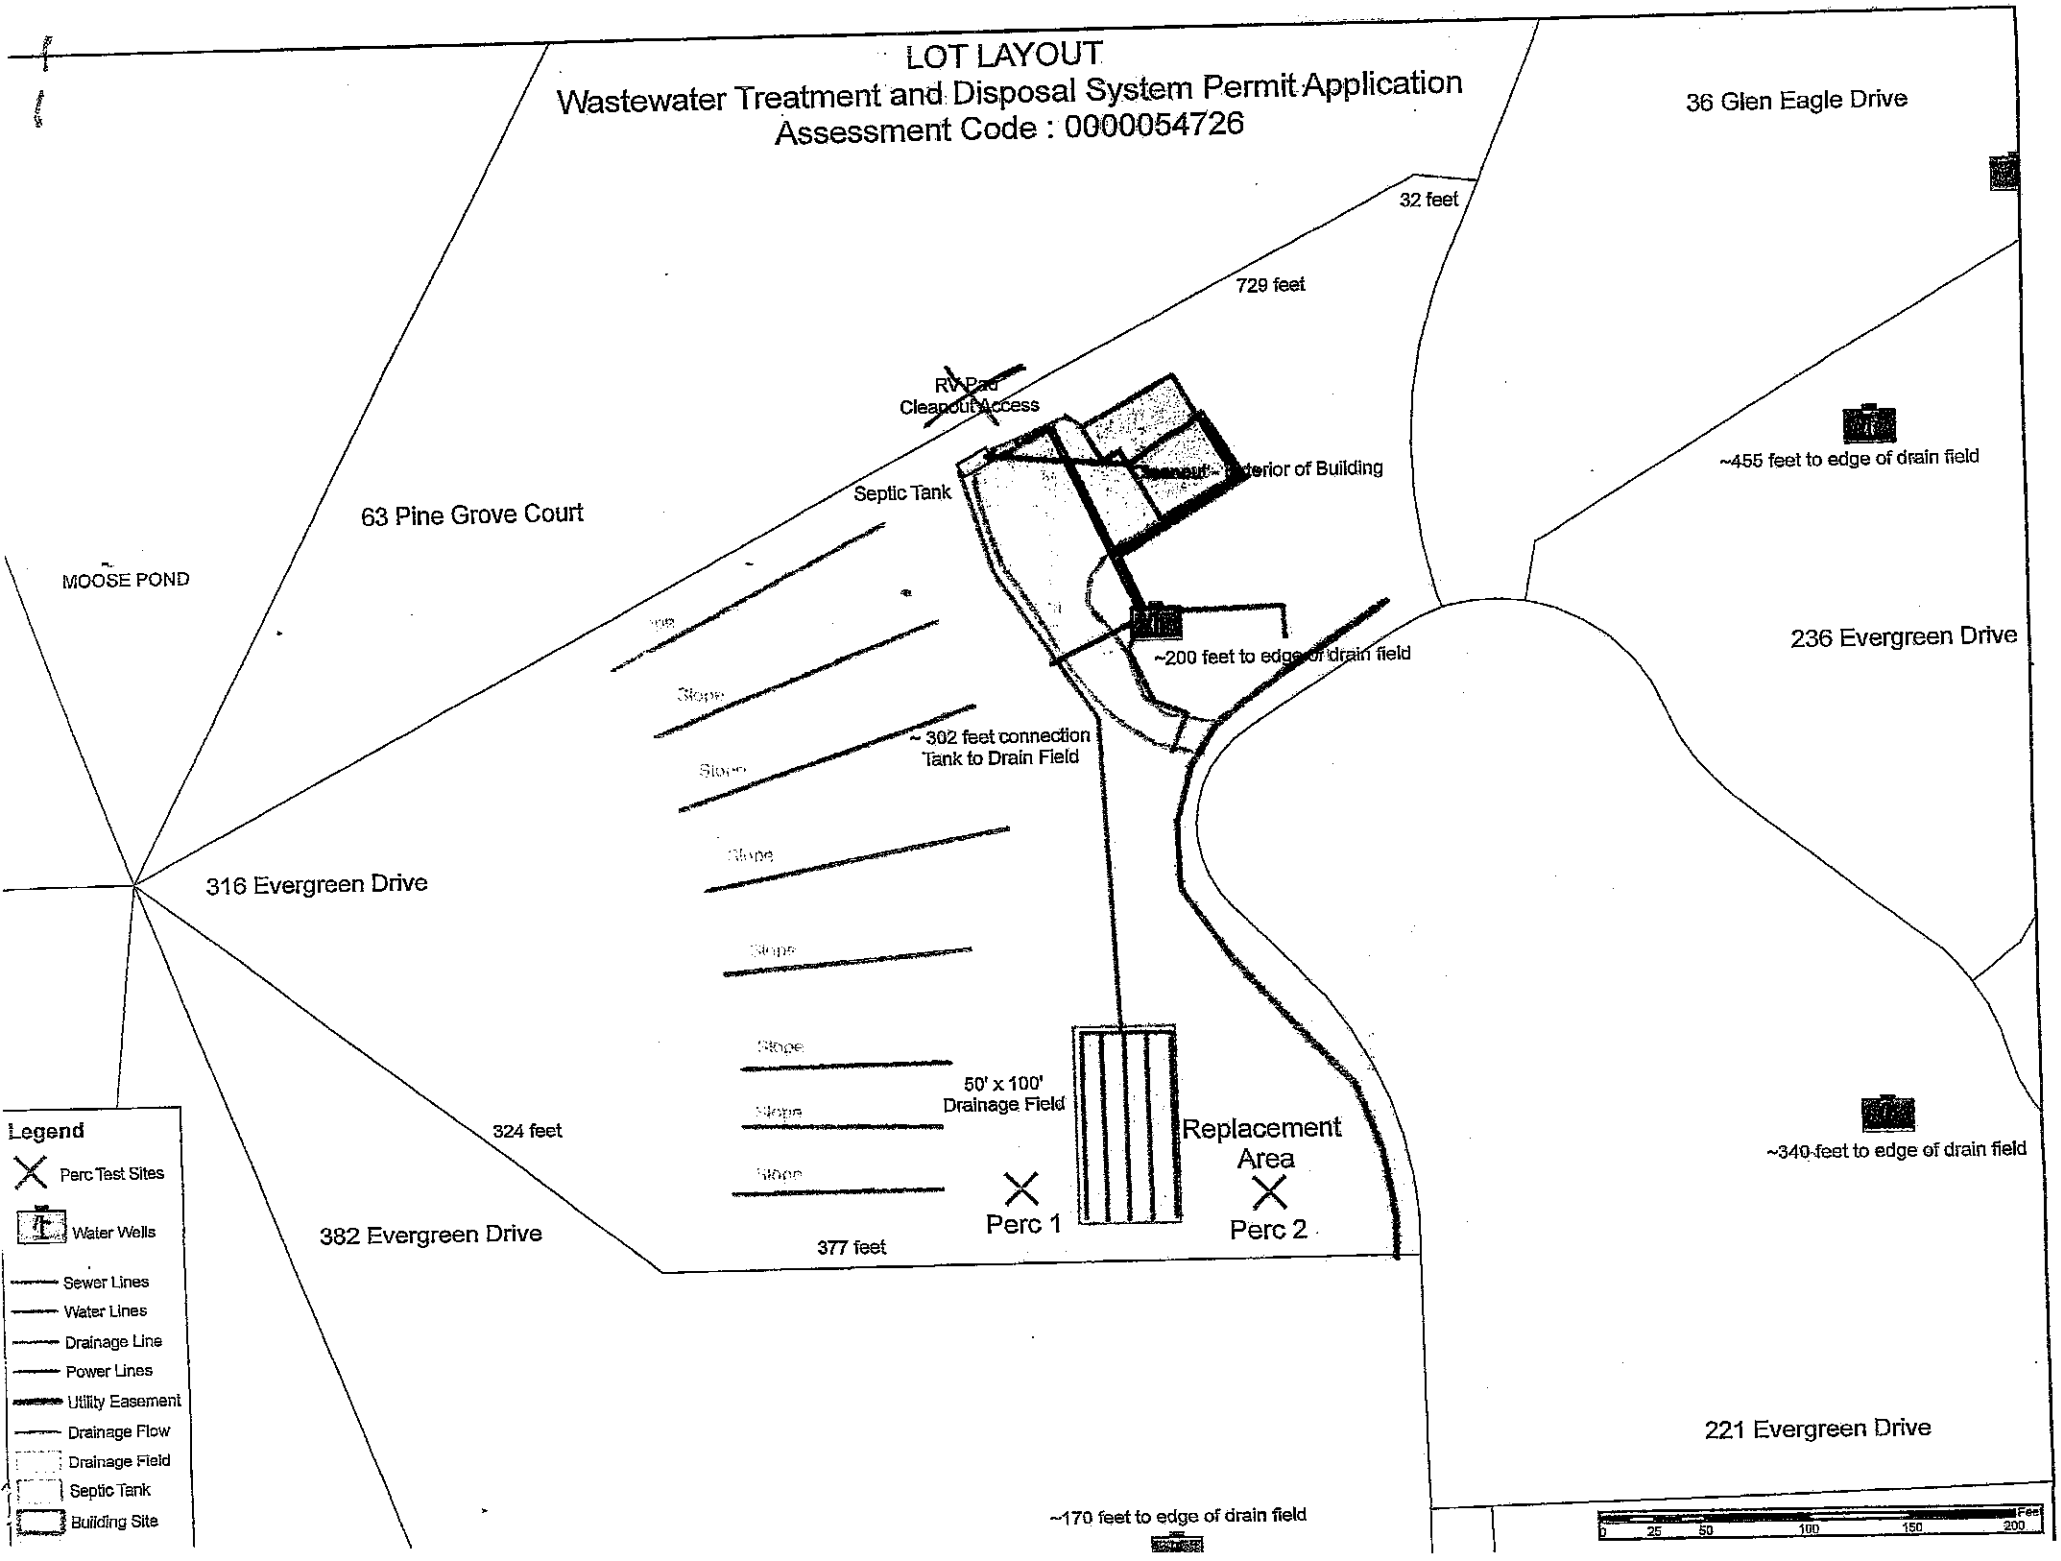
Signed: _____ *Date:* _____

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5


LOT LAYOUT
Wastewater Treatment and Disposal System Permit Application
Assessment Code : 0000054726
36 Glen Eagle Drive
32 feet
729 feet
RV Pad
Cleanout Access
Cleanout - Interior of Building
Septic Tank
63 Pine Grove Court
MOOSE POND
~455 feet to edge of drain field
236 Evergreen Drive
~200 feet to edge of drain field
~ 302 feet connection
Tank to Drain Field
316 Evergreen Drive
50' x 100'
Drainage Field
Replacement
Area
Perc 1
Perc 2
324 feet
382 Evergreen Drive
377 feet
~340 feet to edge of drain field
221 Evergreen Drive
~170 feet to edge of drain field
Legend
Perc Test Sites
Water Wells
Sewer Lines
Water Lines
Drainage Line
Power Lines
Utility Easement
Drainage Flow
Drainage Field
Septic Tank
Building Site
Feet
0
25
50
100
150
200