LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 23-54248

Issue Date: 07/13/2023 Expiration Date: 07/12/2024

Property Owner: Alvin Bontrager

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Junior Miller License #: 52

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system with chambers for 2nd dwelling with shared well and an individual drainfield.

Parcel Description:

Legal: S11, T37 N, R28 W, C.O.S. B275 P634, PARCEL B OR SENWSW *54248* SPLIT FROM 11617

Property Address: 669 Border Ln., Rexford, MT 59930 Assessment Code: 54248

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new gravity system with chambers and 4 laterals @ 100'.

# of Bedrooms: 4 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, S97*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Juan Miller Jr. *Date:* 7-27-2023

____ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Legend

- test hole
- proposed & existing drainfield site
- proposed & existing replacement area
- existing well w/100' isloation zone
- source specific mixing zone
- proposed & existing septic tank

Name: Bontrager- Parcel B
County: Lincoln
Location: SW¼ sec.11-T37N-R28W

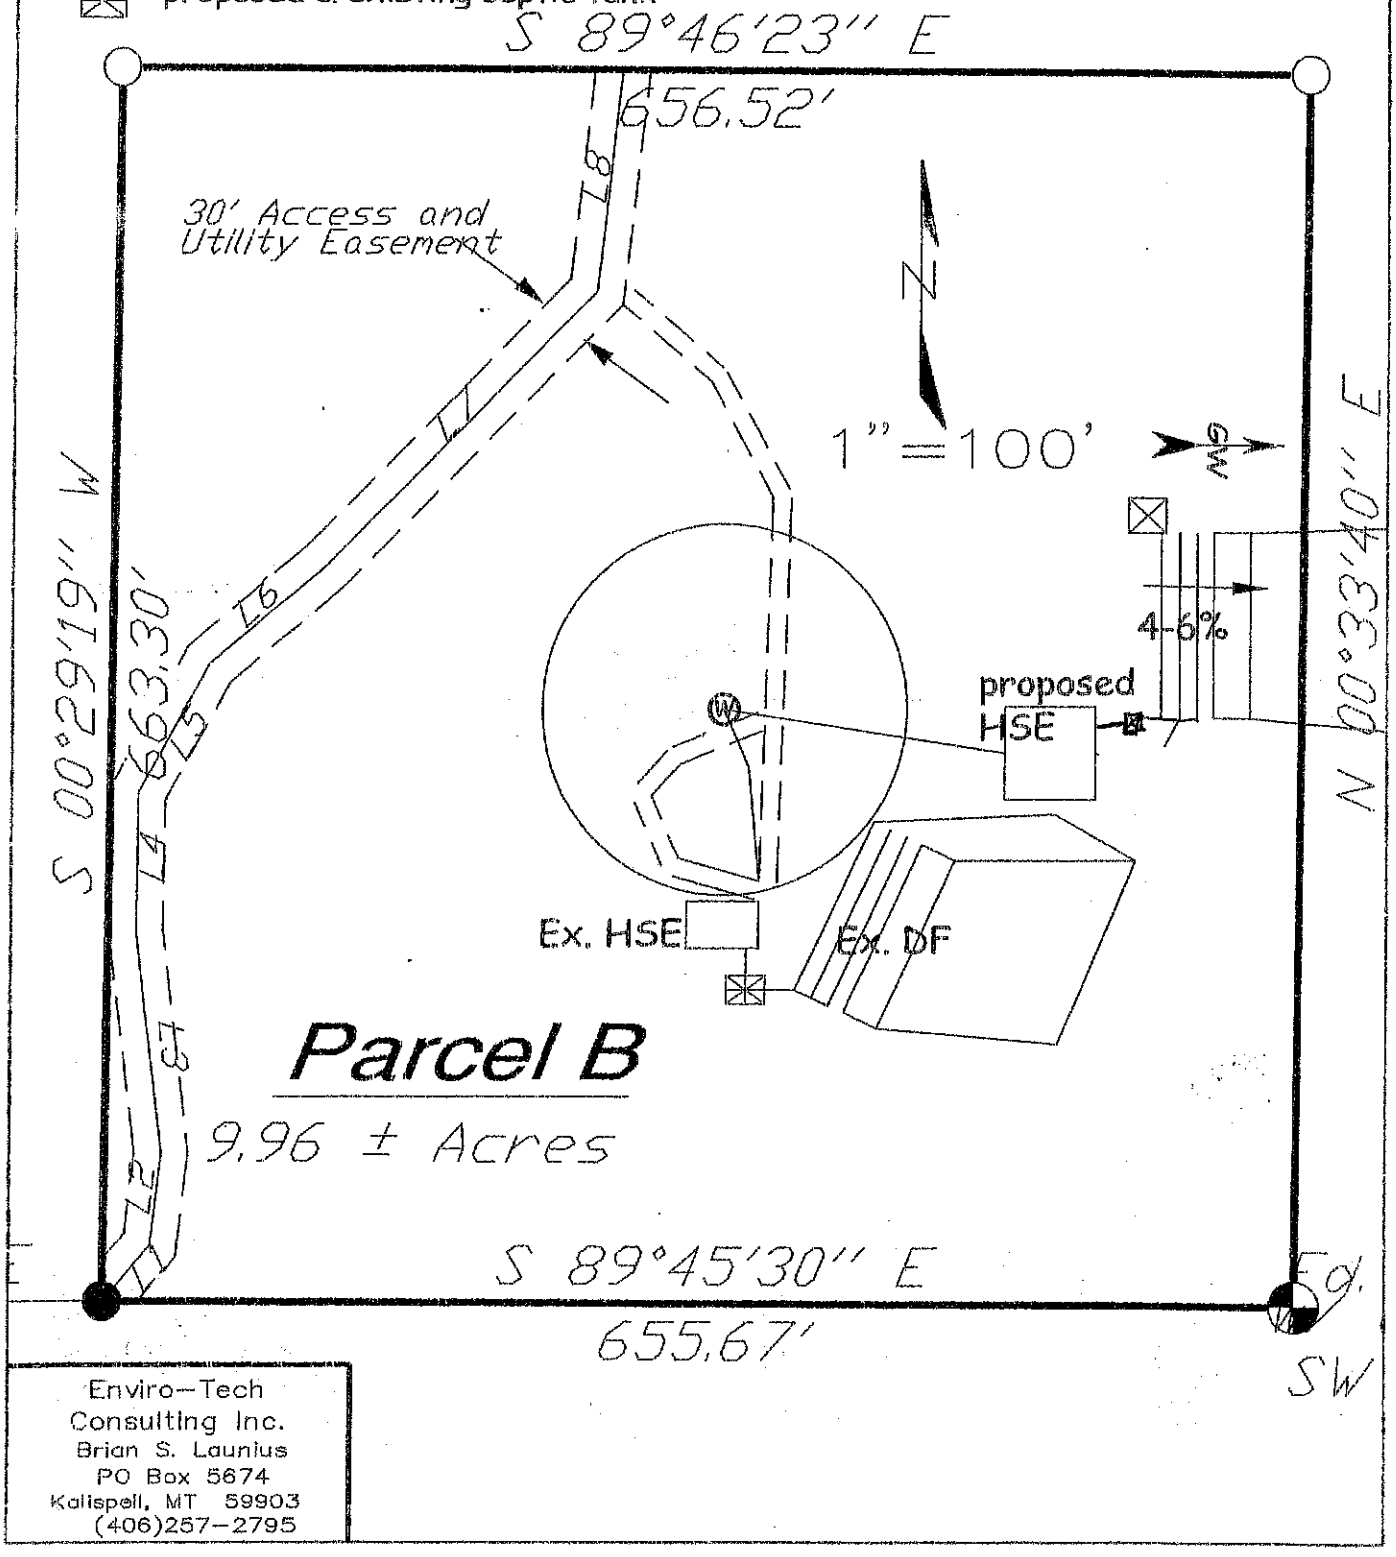

Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795