LINCOLN COUNTY HEALTH DEPARTMENT Permit # 23-52595
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/31/2023 Expiration Date: 10/31/2024

Property Owner: Paige Buchan and Mike Brown

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Homeowner License #:

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system with 3 Laterals@84'.

Parcel Description:

Legal: STANLEY VIEW, S05, T29 N, R33 W, ACRES 6.8, LOT 2B PM 6864

Property Address: 338 Campview Dr., Troy, MT 59935 Assessment Code: 52595

DEQ COSA: EQ#07-1934 Date: 08/15/2007

Approved Design Criteria: Installation of new gravity system with 3 laterals @84'

# of Bedrooms: 1 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

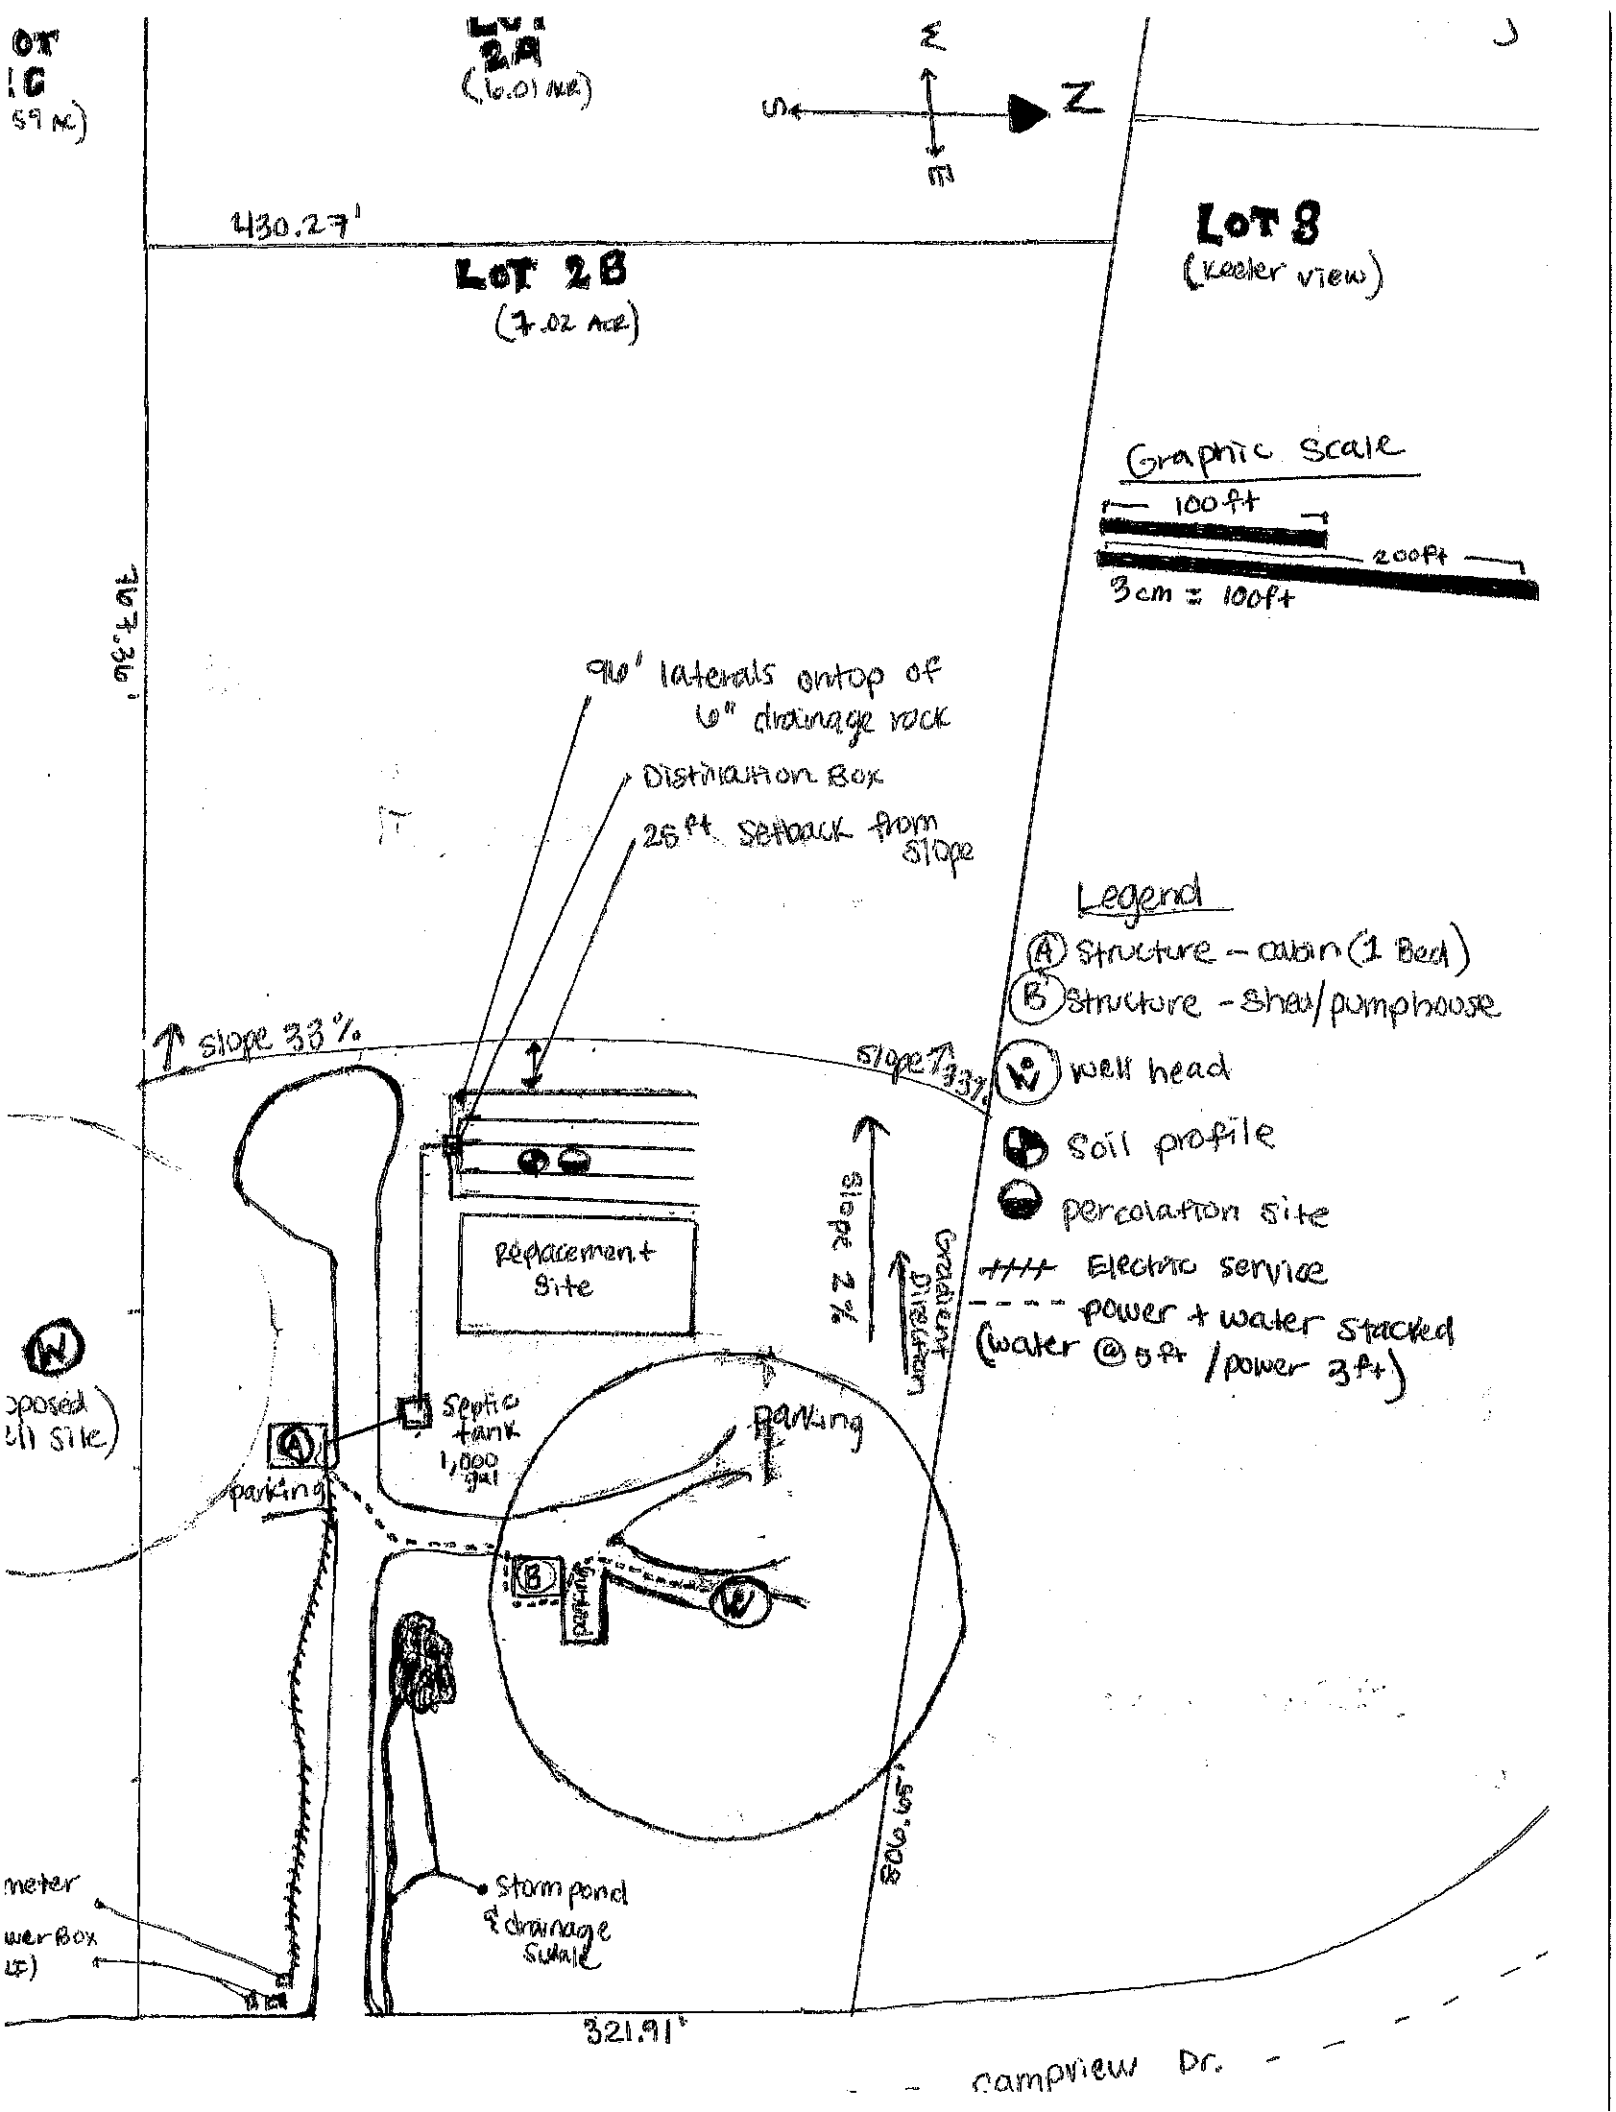
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/29/24

____ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT 2A
(6.01 ACR)
N
S
Z
E
430.27'
LOT 2B
(7.02 ACR)
LOT 3
(keeler view)
Graphic Scale
100ft
200ft
3cm = 100ft
90' laterals ontop of 6" drainage rock
Distribution Box
25ft setback from slope
Legend
A Structure - cabin (1 Bed)
B Structure - shed/pumphouse
W well head
soil profile
percolation site
Electric service
power + water stacked (water @ 5ft / power 3ft)
slope 33%
slope 33%
slope 2%
Gradient direction
Replacement Site
Septic tank 1,000 gal
parking
parking
Storage
Storm pond & drainage swale
meter
water Box
up)
321.91'
Campview Dr.