LINCOLN COUNTY HEALTH DEPARTMENT Permit # 24-1053
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/20/2024 Expiration Date: 05/19/2025

Property Owner: Douglas Conners

Mailing Address: [redacted]

Installer: Kootenai Sand and Gravel, Inc. License #: 109

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new elevated sand mound for 3 Bedroom House.

Parcel Description:

Legal: WHISPERING PINES KOOCANUSA 6, S06, T34 N, R26 W, ACRES 5.011, LOT 27

Property Address: 288 Roberts Creek Rd., Fortine, MT 59918 Assessment Code: 1053

DEQ COSA: EQ# 27-74K157 Date: 10/18/1974

Approved Design Criteria: Installation of new elevated sand mound 16'x48' =768 sq ft drainfield for 3 Bedroom House.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width:

# of Laterals: ESM 16'x48' Length of Laterals: ESM 768 Sq. Ft. Trench Depth:

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg Date: 8/14/24


____ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

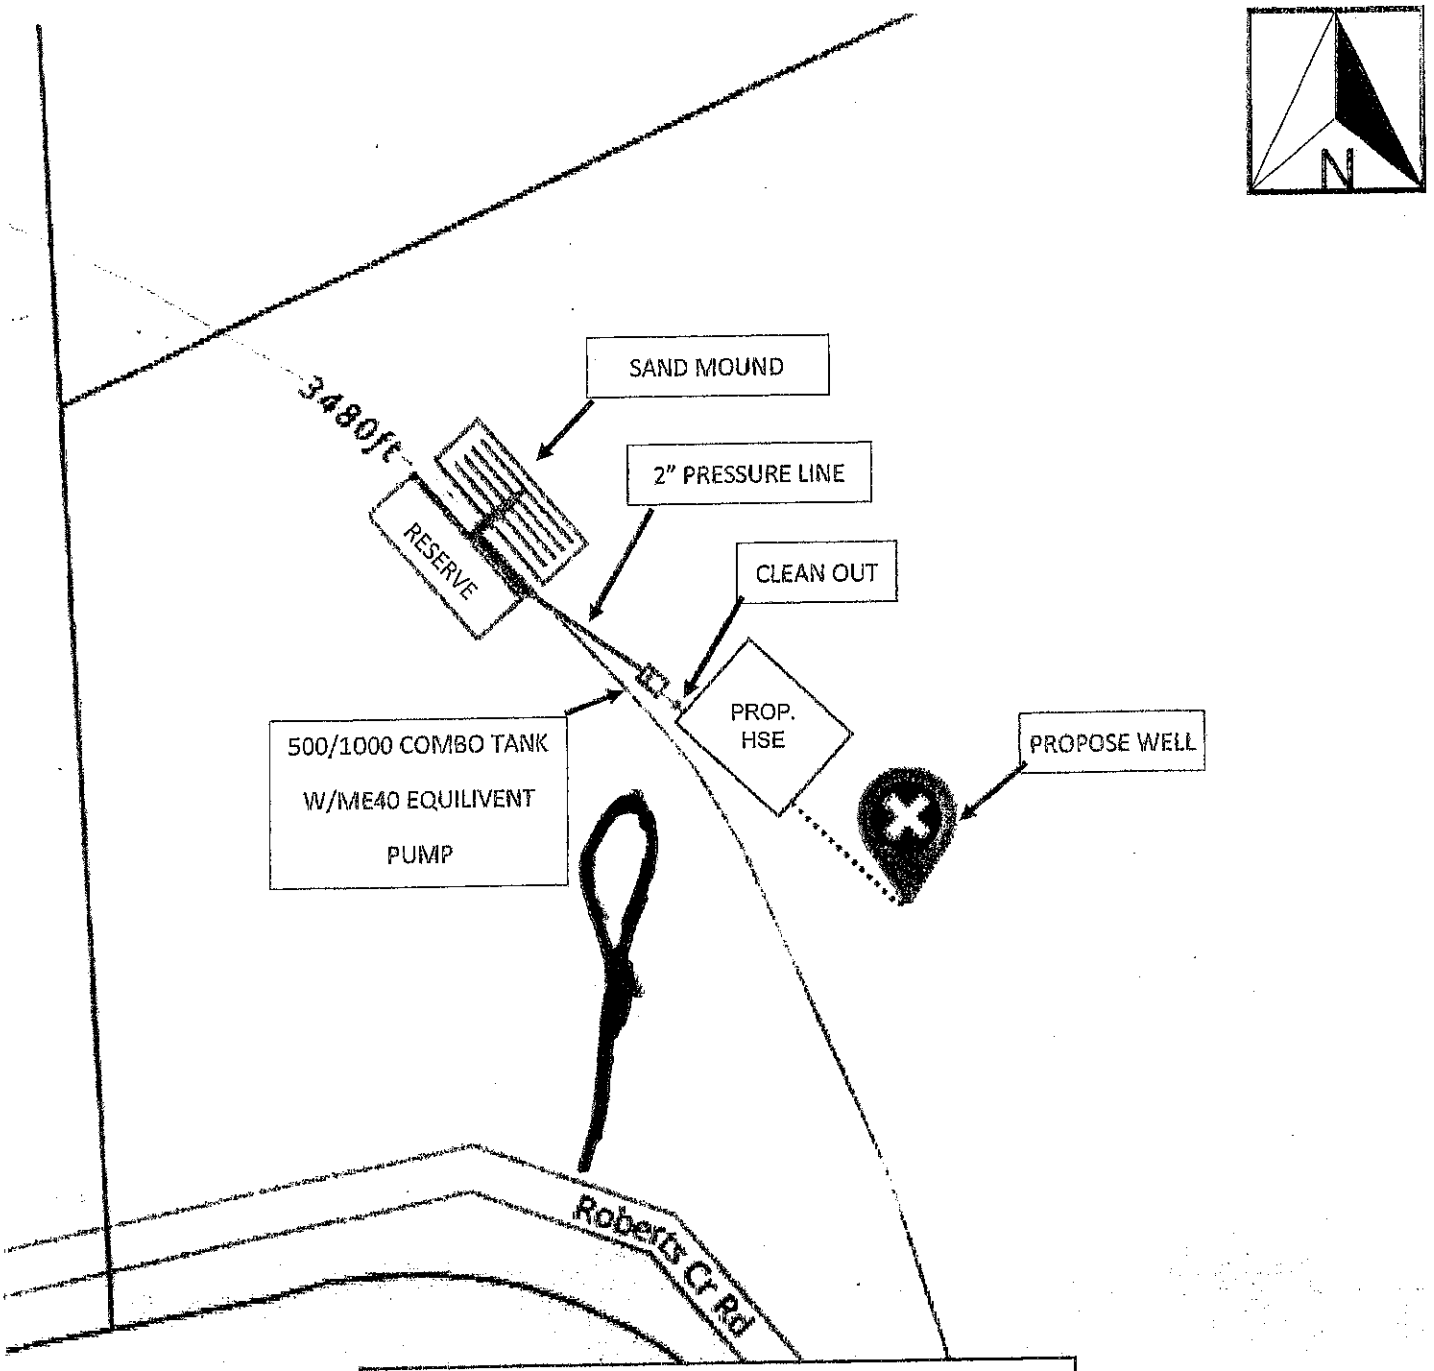

- **ELEVATED SAND MOUND**
- (4) 48' LATERALS - 4' CENTERS, 1 1/2 IN SCH 40 PVC
- 1/8 IN HOLES @ 5 FT SPACING
- SEPTIC FIELD DISTANCE FROM MEADOW CREEK ~ 489 FT

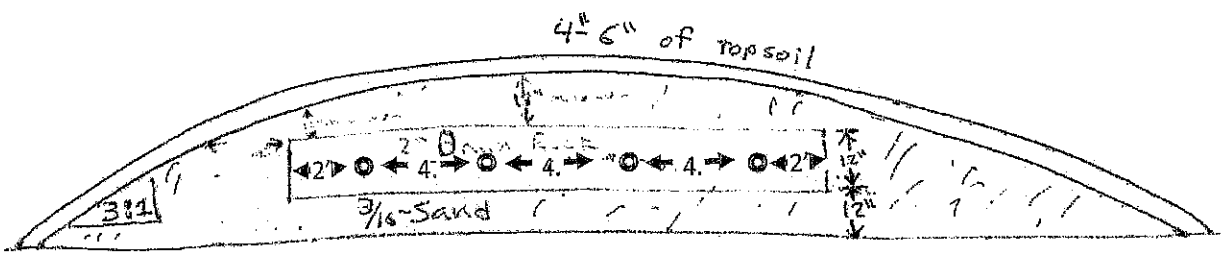

Whispering Pines Koocanusa Subdivision Number 6, Lot 27