LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/01/2023 Expiration Date: 04/30/2024

Property Owner: Richard Cosas

Mailing Address: [redacted]

Telephone: E-mail:

Installer: Buck Schermerhorn License #: 135

Approved Work: (Check One) ☐ New Installation ☐ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Replace system with pressure dosed system with chambers.

Parcel Description:

Legal: HARRISBURG 1ST ADDN, S25, T35 N, R26 W, BLOCK 2, LOT 1-2

Property Address: 31 1ST AVE S.,Fortine, MT, 59918 Assessment Code: 803/1065/1066

DEQ COSA: Date:

Approved Design Criteria: Pressure dosed system with chambers, 3 56' laterals.

# of Bedrooms: 2 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 3 Length of Laterals: 56' Trench Depth: 24-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. Variance to well setback issued 4/25/23. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S97

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 11/17/23


✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

VS

Name: Harrisburg 1st Addition
County: Lincoln
Location: sec.25-T35N-R26W

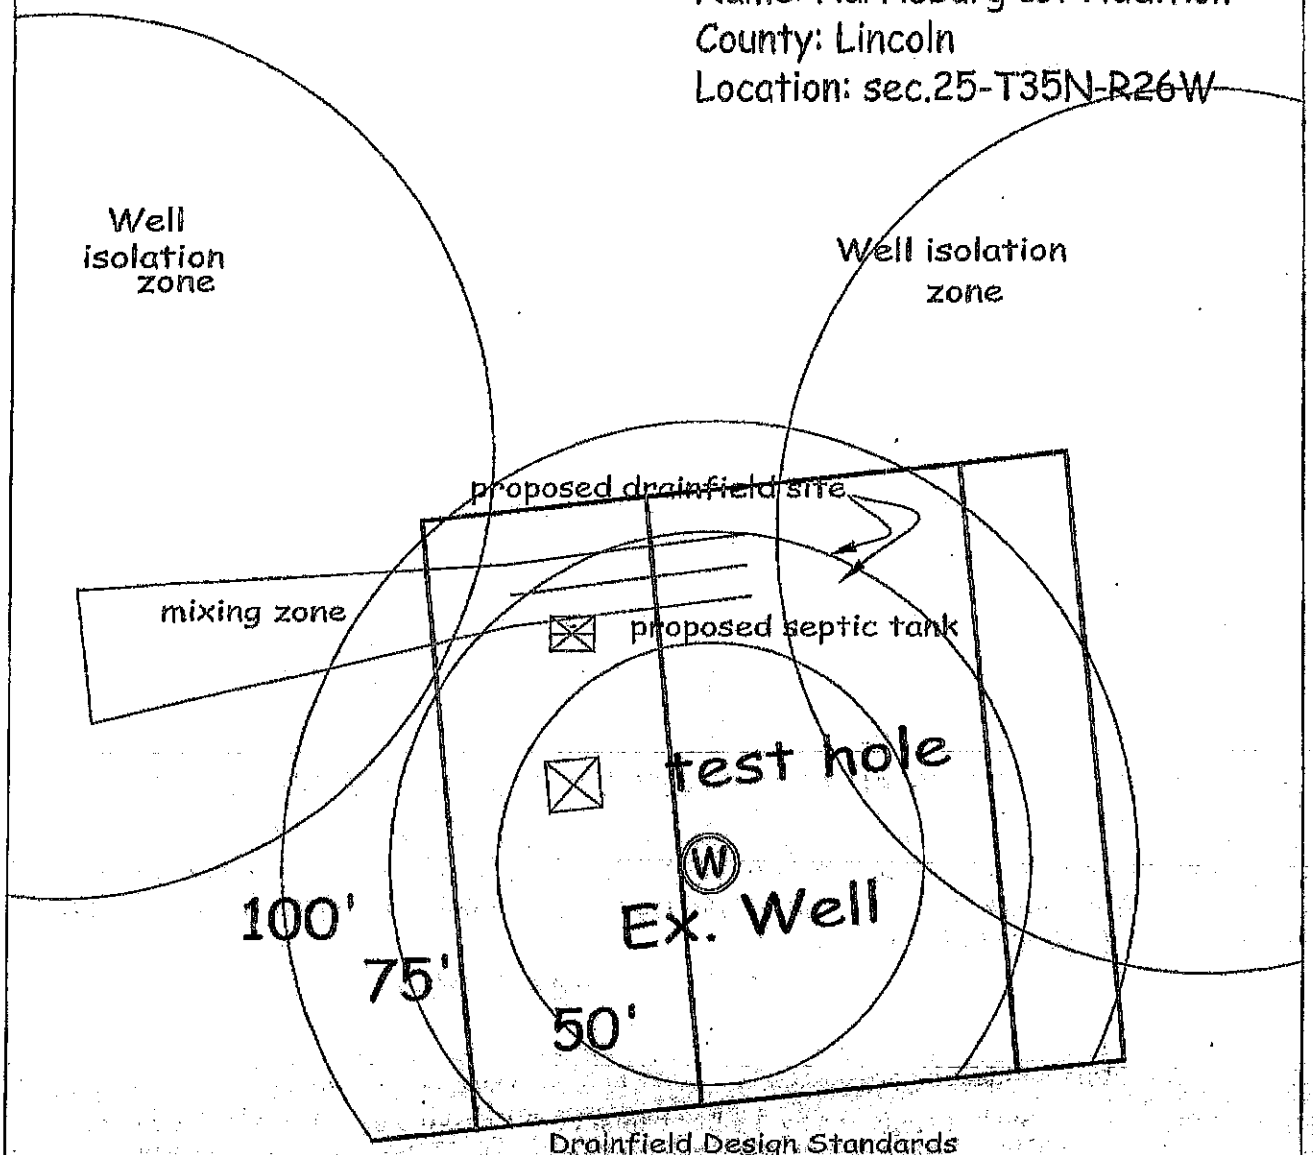

Drainfield Design Standards
for each proposed drainfield
2 bdrm. pressure dosed septic system
with Chambers
0.4 gpd/ft2- application rate
169 Lin. ft. x 3' wide trenches=
3 laterals @ 56.3 lin. ft. & 7 ft. on center
1,000 gal. septic tank

N

1" = 40'

Enviro-Tech
Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795