LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/13/2022 Expiration Date: 10/12/2023

Property Owner: Jacob DeLong

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Buck Schermerhorn License #: 135

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Pressure dosed system with standard trenches, chambers

Parcel Description:

Legal: Glen Lake Hills, Lot 9, S27 T36N R26W, 2.2 acres

Property Address: Evergreen Dr, Eureka Assessment Code: 54722

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36 inches

# of Laterals: 5 Length of Laterals: 100 feet Trench Depth: 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Robin Blumberg *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

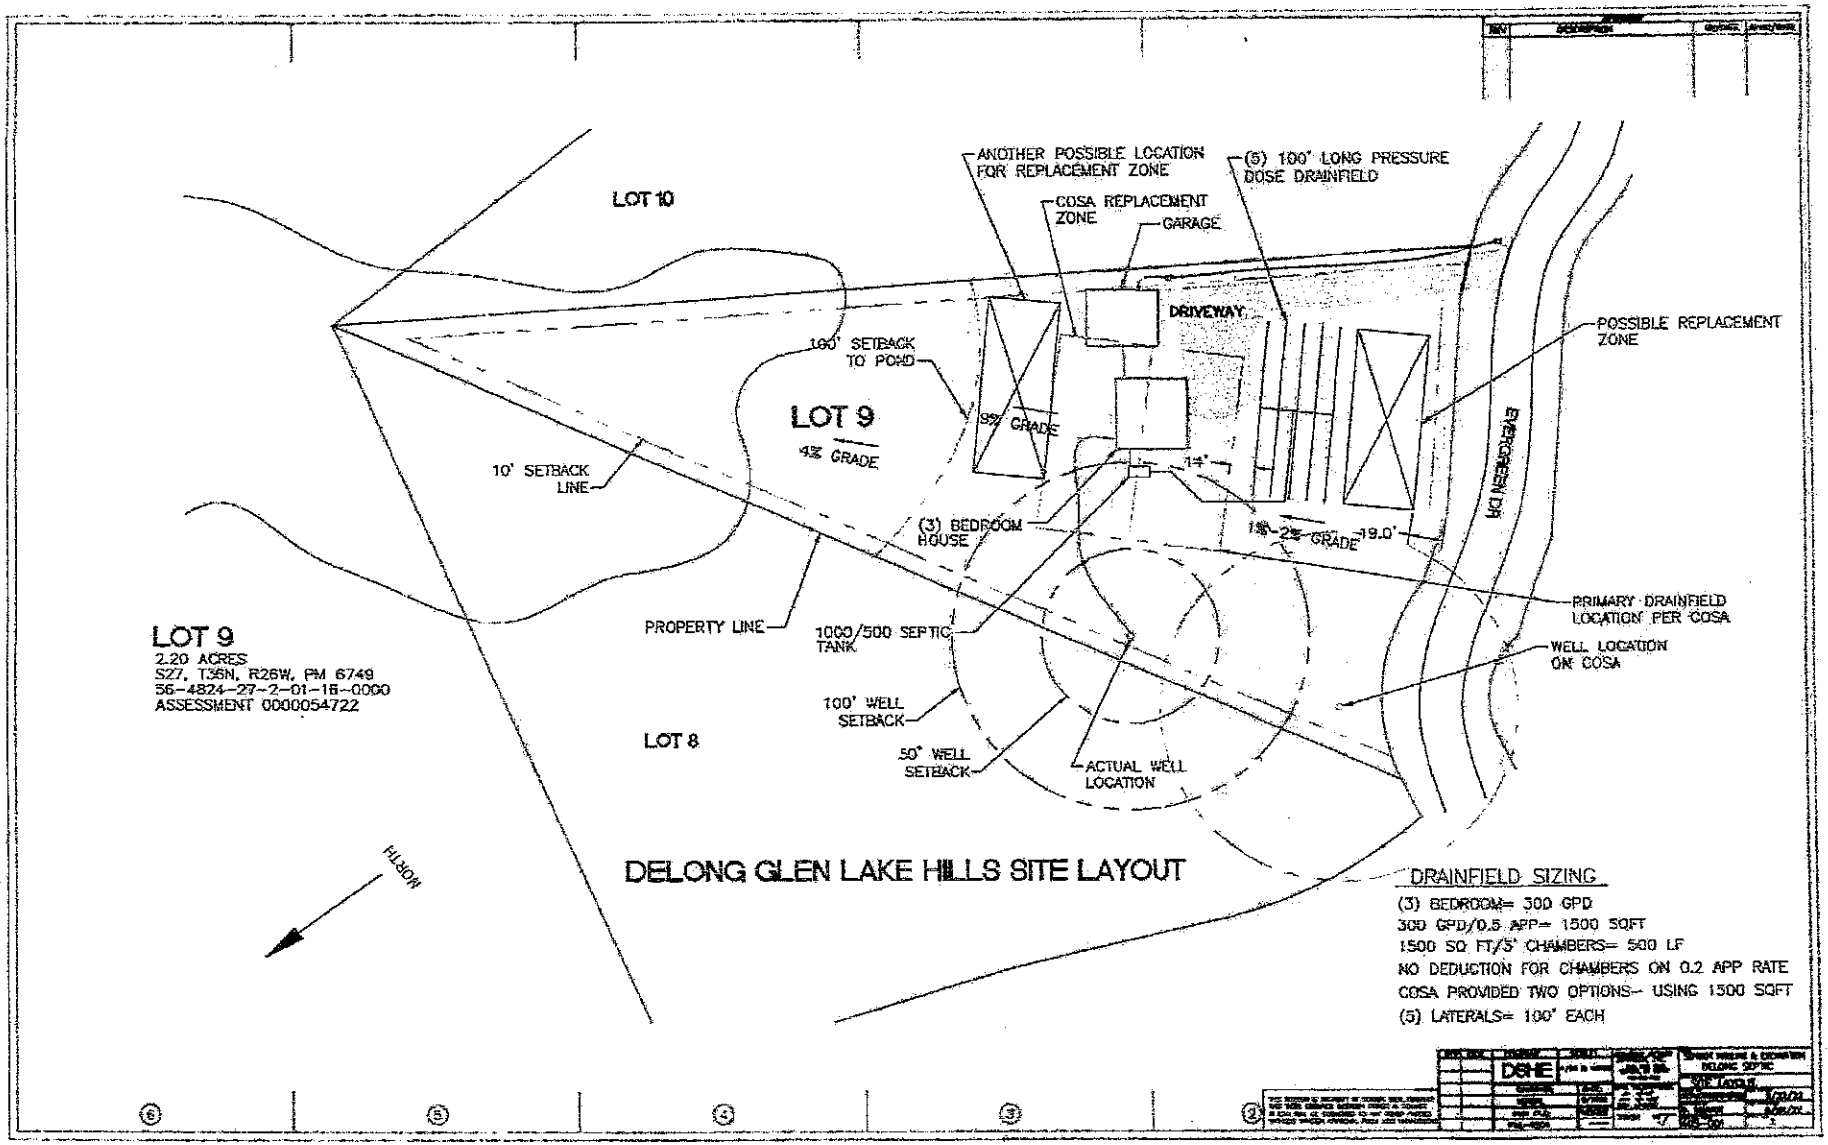
Signed: Robin Blumberg *Date:* 7/25/23

__✓__ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


LOT 10
ANOTHER POSSIBLE LOCATION FOR REPLACEMENT ZONE
(5) 100' LONG PRESSURE DOSE DRAINFIELD
COSA REPLACEMENT ZONE
GARAGE
DRIVEWAY
POSSIBLE REPLACEMENT ZONE
100' SETBACK TO POND
LOT 9
4% GRADE
9% GRADE
10' SETBACK LINE
14'
EVERGREEN DR
(3) BEDROOM HOUSE
1%-2% GRADE
19.0'
PRIMARY DRAINFIELD LOCATION PER COSA
PROPERTY LINE
1000/500 SEPTIC TANK
WELL LOCATION ON COSA
100' WELL SETBACK
LOT 8
50' WELL SETBACK
ACTUAL WELL LOCATION
LOT 9
2.20 ACRES
S27, T36N, R26W, PM 6749
56-4824-27-2-01-16-0000
ASSESSMENT 0000054722
NORTH
DELONG GLEN LAKE HILLS SITE LAYOUT
DRAINFIELD SIZING
(3) BEDROOM= 300 GPD
300 GPD/0.5 APP= 1500 SQFT
1500 SQ FT/5' CHAMBERS= 500 LF
NO DEDUCTION FOR CHAMBERS ON 0.2 APP RATE
COSA PROVIDED TWO OPTIONS-- USING 1500 SQFT
(5) LATERALS= 100' EACH