LINCOLN COUNTY HEALTH DEPARTMENT Permit # 23- 9200
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/31/2023 Expiration Date: 03/31/2024

Property Owner: Lee A. Disney

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Self- Homeowner License #: N/A

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity System w/ standard 2' wide trenches, perf pipe & gravel

Parcel Description:

Legal: S02 T30N R31W Riverdale Subdivision Lot 6

Property Address: 2202 E 5th Street Extension Assessment Code:

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Depth: 24- 36 Inches

# of Laterals: 3 Length of Each Lateral: 84 lineal feet Trench Width: 36 Inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installers responsibility to ensure all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

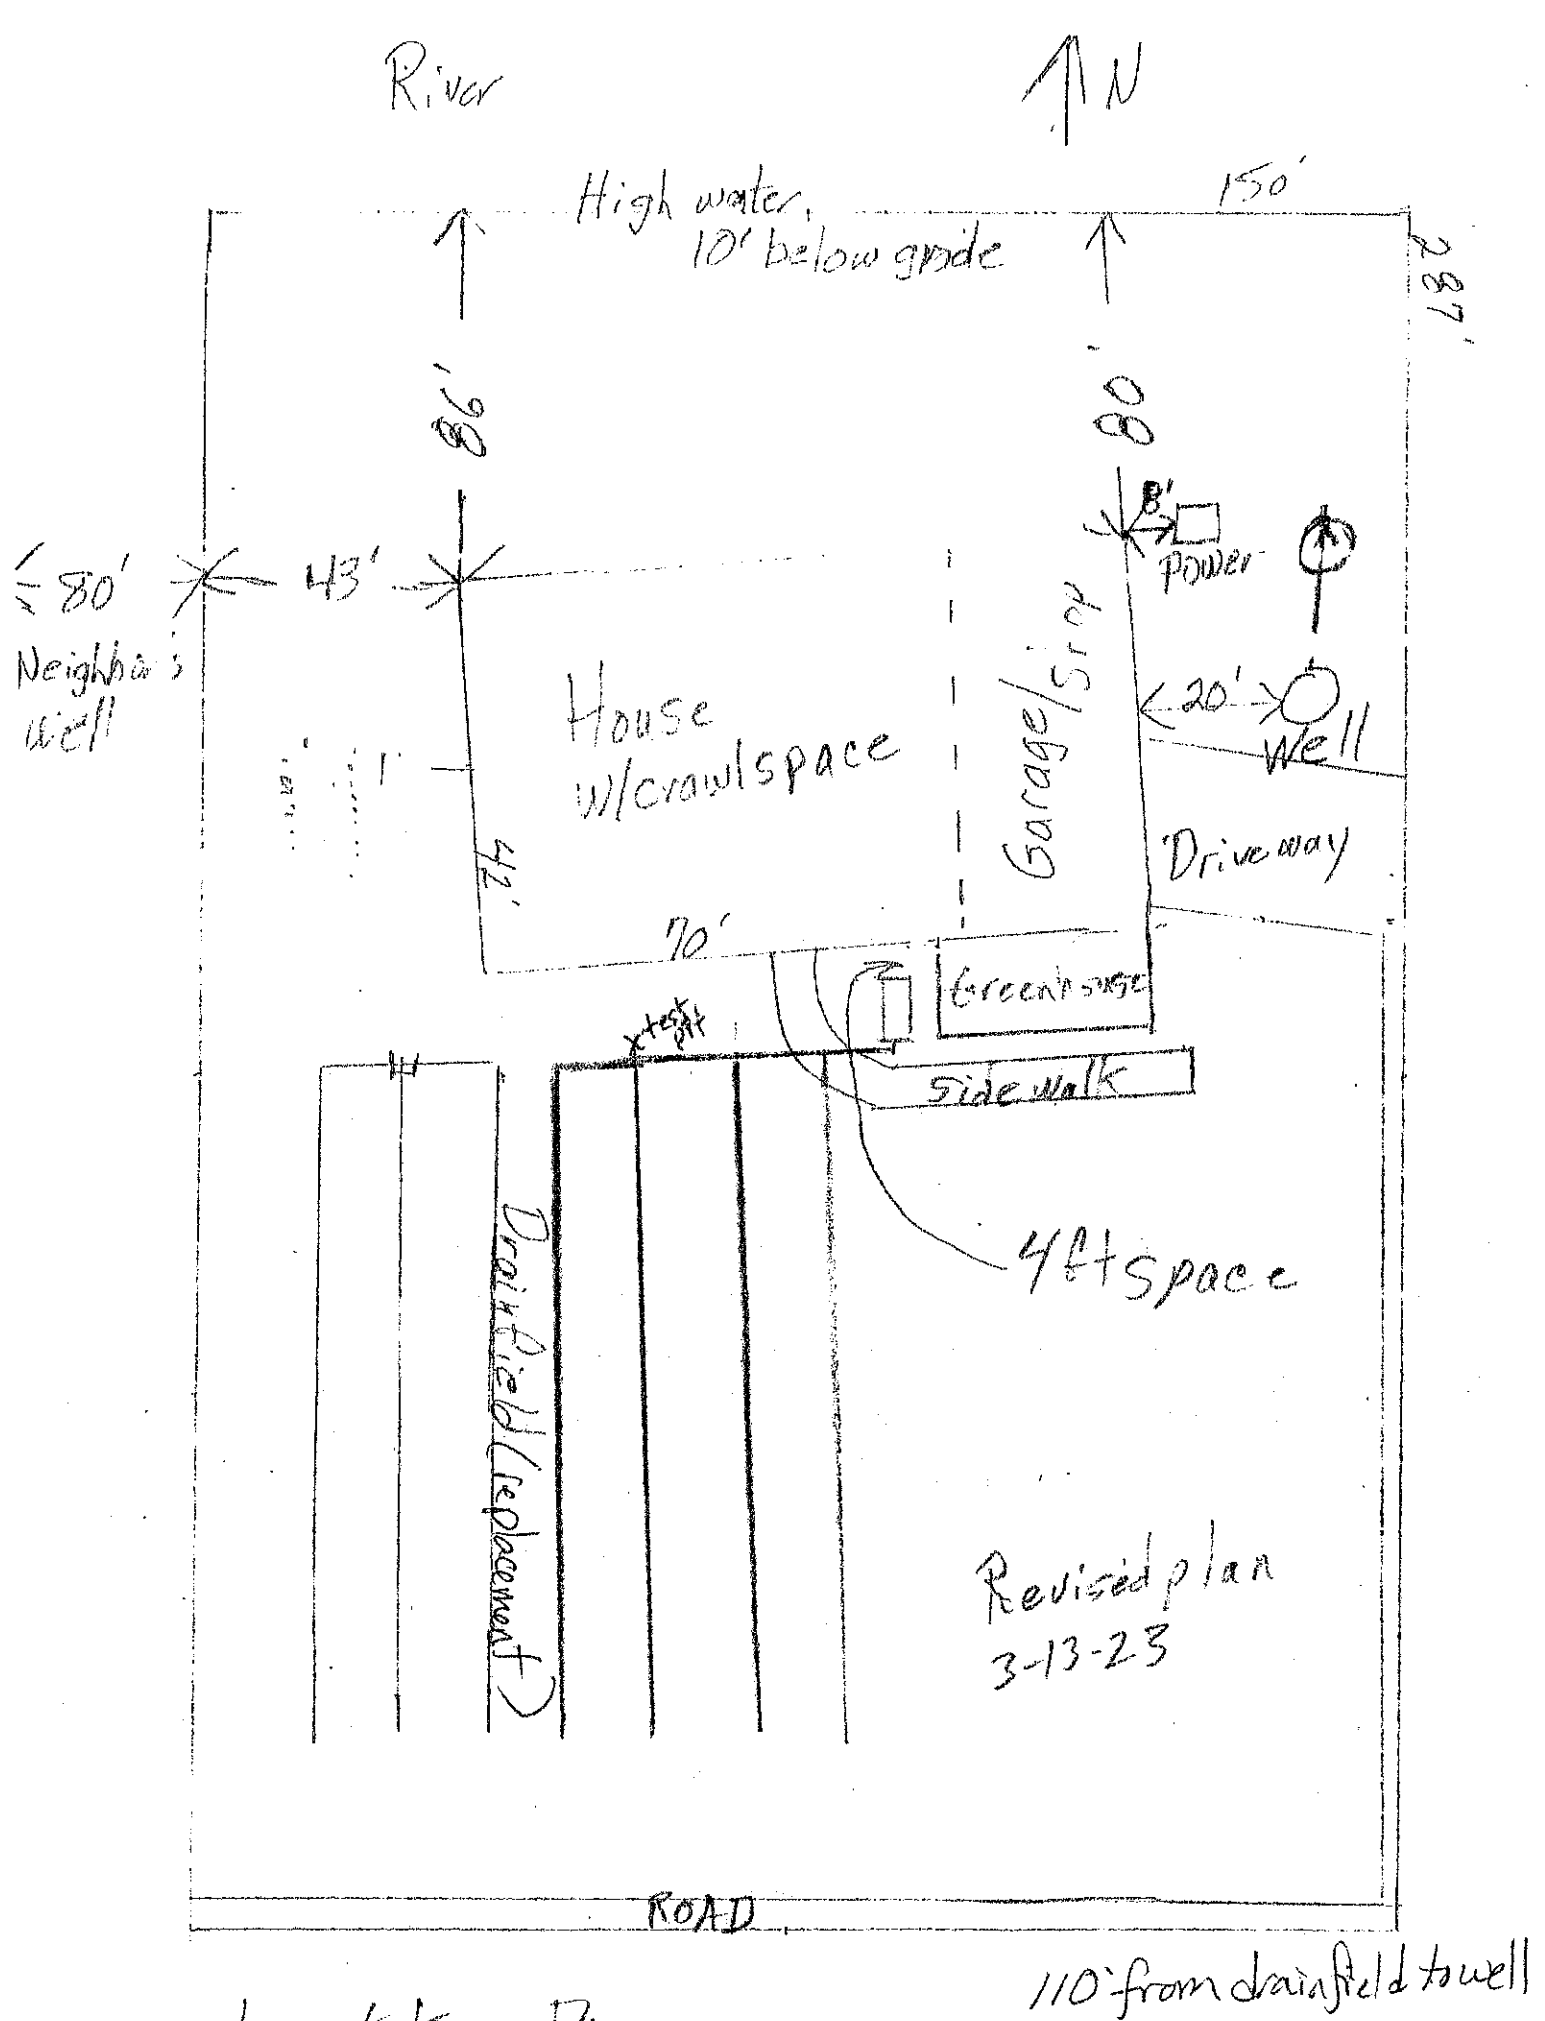
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Don Olmsby *Date:* 7/5/23

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


River
N
High water,
10' below grade
150'
287'
98'
80'
B'
Power
80'
43'
Neighbor's well
House
w/crawlspace
Garage/Shop
20'
well
Driveway
42'
70'
Greenspace
test pit
Sidewalk
4ft space
Drainfield/replacement
Revised plan
3-13-23
ROAD
110' from drainfield to well
Lee & Karen Disney