LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 24-11180

Issue Date: 07/11/2024 Expiration Date: 07/10/2025

Property Owner: Mark and Soonmi Duggins

Mailing Address: [redacted]

Installer: Tom Cole License #: 1

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☒ Extension

Describe: Installation of extension to laterals for 3 Bedroom House.

Parcel Description:

Legal: WILDERNESS PLATEAU, S19, T31 N, R33 W, BLOCK 006, ACRES 0.534, LOT 13 BLK 6

Property Address: 200 Wapiti Way, Troy, MT 59935 Assessment Code: 11180

DEQ COSA: EQ#27-85-S23-429 Date: 11/1/84

Approved Design Criteria: Installation of extension to laterals for 3 Bedroom House adding 3 laterals @ 40'.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 40' Trench Depth: 24"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

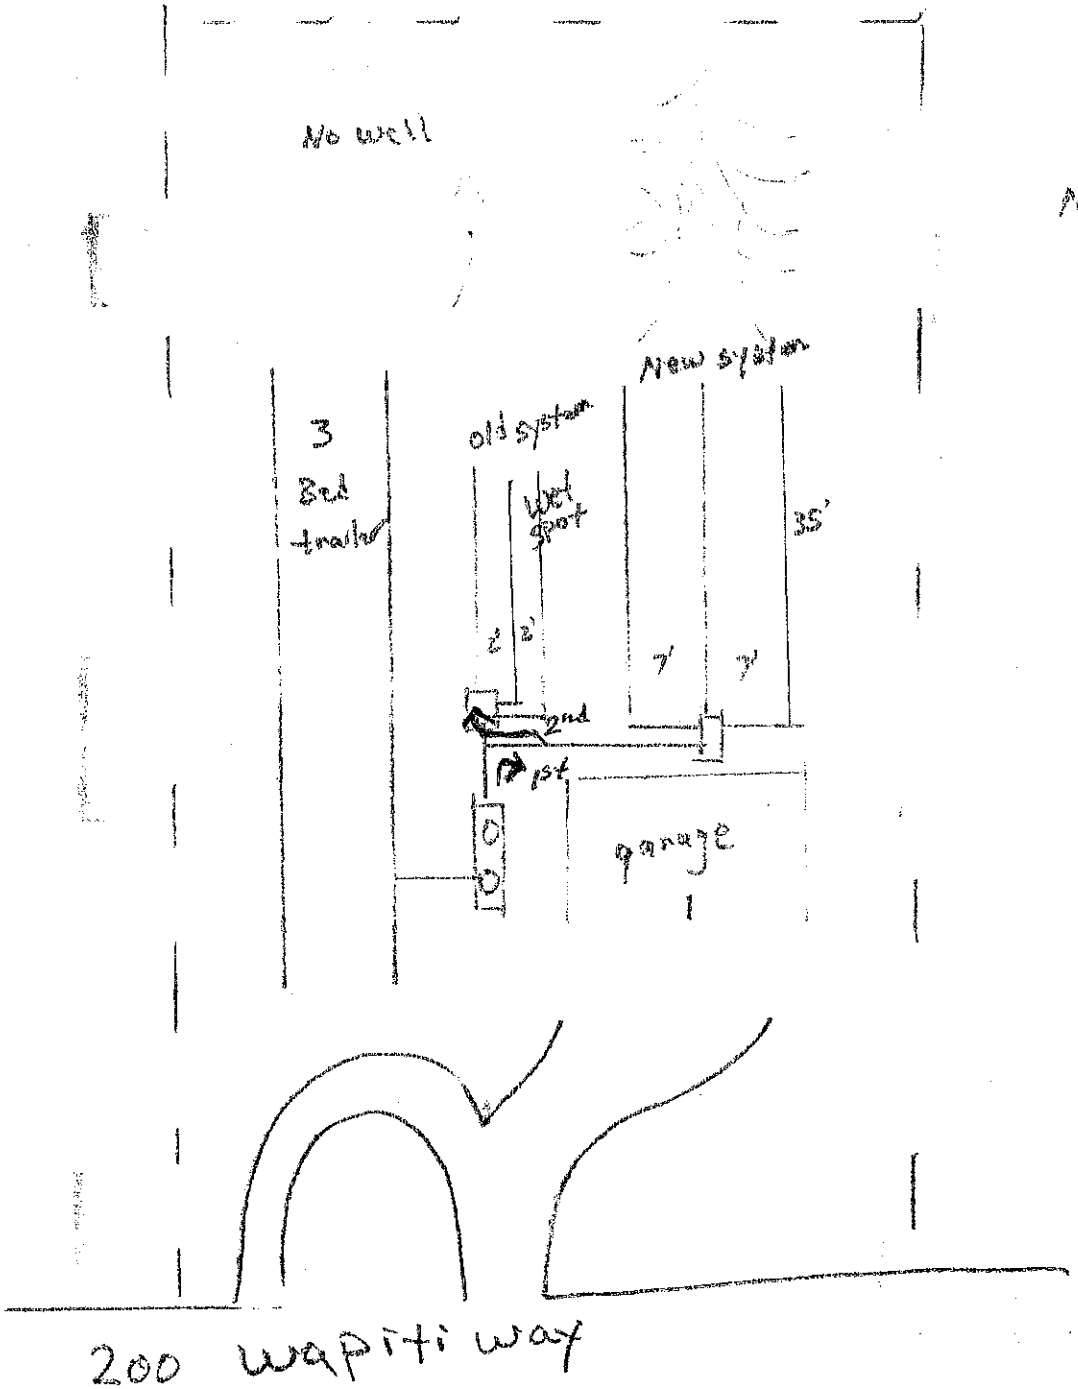
Signed: Robin Blumberg *Date:* 7/29/24

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SV


No well
No well
New system
3
Bed
trailer
old system
Wet spot
35'
2'
3'
7'
7'
2nd
1st
garage
1
200 Wapiti Way