LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/09/2023 Expiration Date: 08/08/2024

Property Owner: Jace Featherly

Mailing Address: [redacted]

Telephone: [redacted] E-mail:

Installer: Buck Schermerhorn License #: 135

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of septic tank w/ pump to public on-site wastewater system.

Parcel Description:

Legal: INDIAN SPRINGS PH 1, S36, T37 N, R27 W, LOT13, ACRES 0.428, COS 6815

Property Address: 319 Peltier Pl. Eureka, MT 59917 Assessment Code: 55113

DEQ COSA: EQ#06-3321 Date: 05/09/2007

Approved Design Criteria: Installation of septic tank w/ pump to public on-site wastewater system.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallon Trench Width:

# of Laterals: Length of Laterals: Trench Depth: 60"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

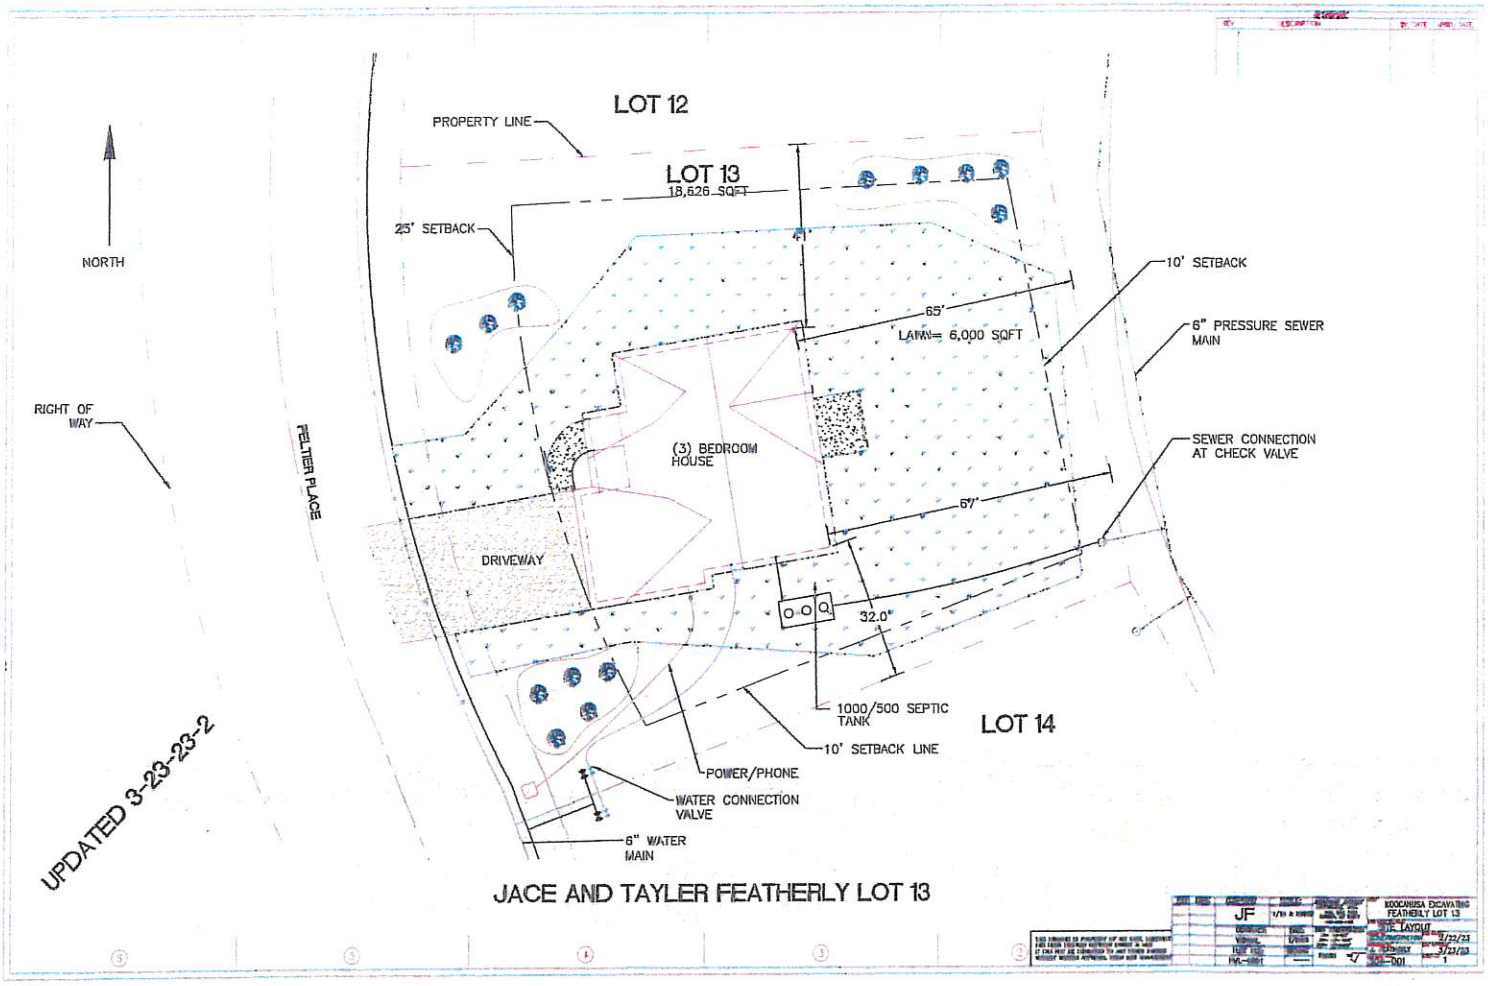
Signed: _____ *Date:* 11/20/23

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5


LOT 12
PROPERTY LINE
LOT 13
18,626 SQFT
25' SETBACK
10' SETBACK
65'
LAWN= 6,000 SQFT
6" PRESSURE SEWER MAIN
NORTH
RIGHT OF WAY
FELTIER PLACE
(3) BEDROOM HOUSE
SEWER CONNECTION AT CHECK VALVE
67'
DRIVEWAY
32.0'
1000/500 SEPTIC TANK
LOT 14
10' SETBACK LINE
POWER/PHONE
WATER CONNECTION VALVE
6" WATER MAIN
UPDATED 3-23-23-2
JACE AND TAYLER FEATHERLY LOT 13