LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/14/2023 Expiration Date: 06/13/2024

Property Owner: Edith Dorene Fish

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Mountain Contracting Richard Luciano License #: 3

Approved Work: (Check One) ☐ New Installation ☐ Existing System

☐ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of replacement tank.

Parcel Description:

Legal: MINOR 5282, S28, T35 N, R27 W, LOT 1A, ACRES 20, PM 7069

Property Address: 11687 Pinkham Creek Rd., Rexford, MT 59930 Assessment Code: 17901

DEQ COSA: EQ#27-95-S78-761 Sidney Workman Date: 01/26/95

Approved Design Criteria: Installation of replacement tank.

# of Bedrooms: 2	Septic Tank Size: 1000 gallons	Trench Width: 24"
# of Laterals: 2	Length of Laterals: 84'	Trench Depth: 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/11/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

✓

Lot Layout
Sidney L. Workman
Scale: 1"=200'
Lincoln Co.

Montana Department of Health
and Environmental Sciences
APPROVED
Initials [illegible] Date 2-3-95

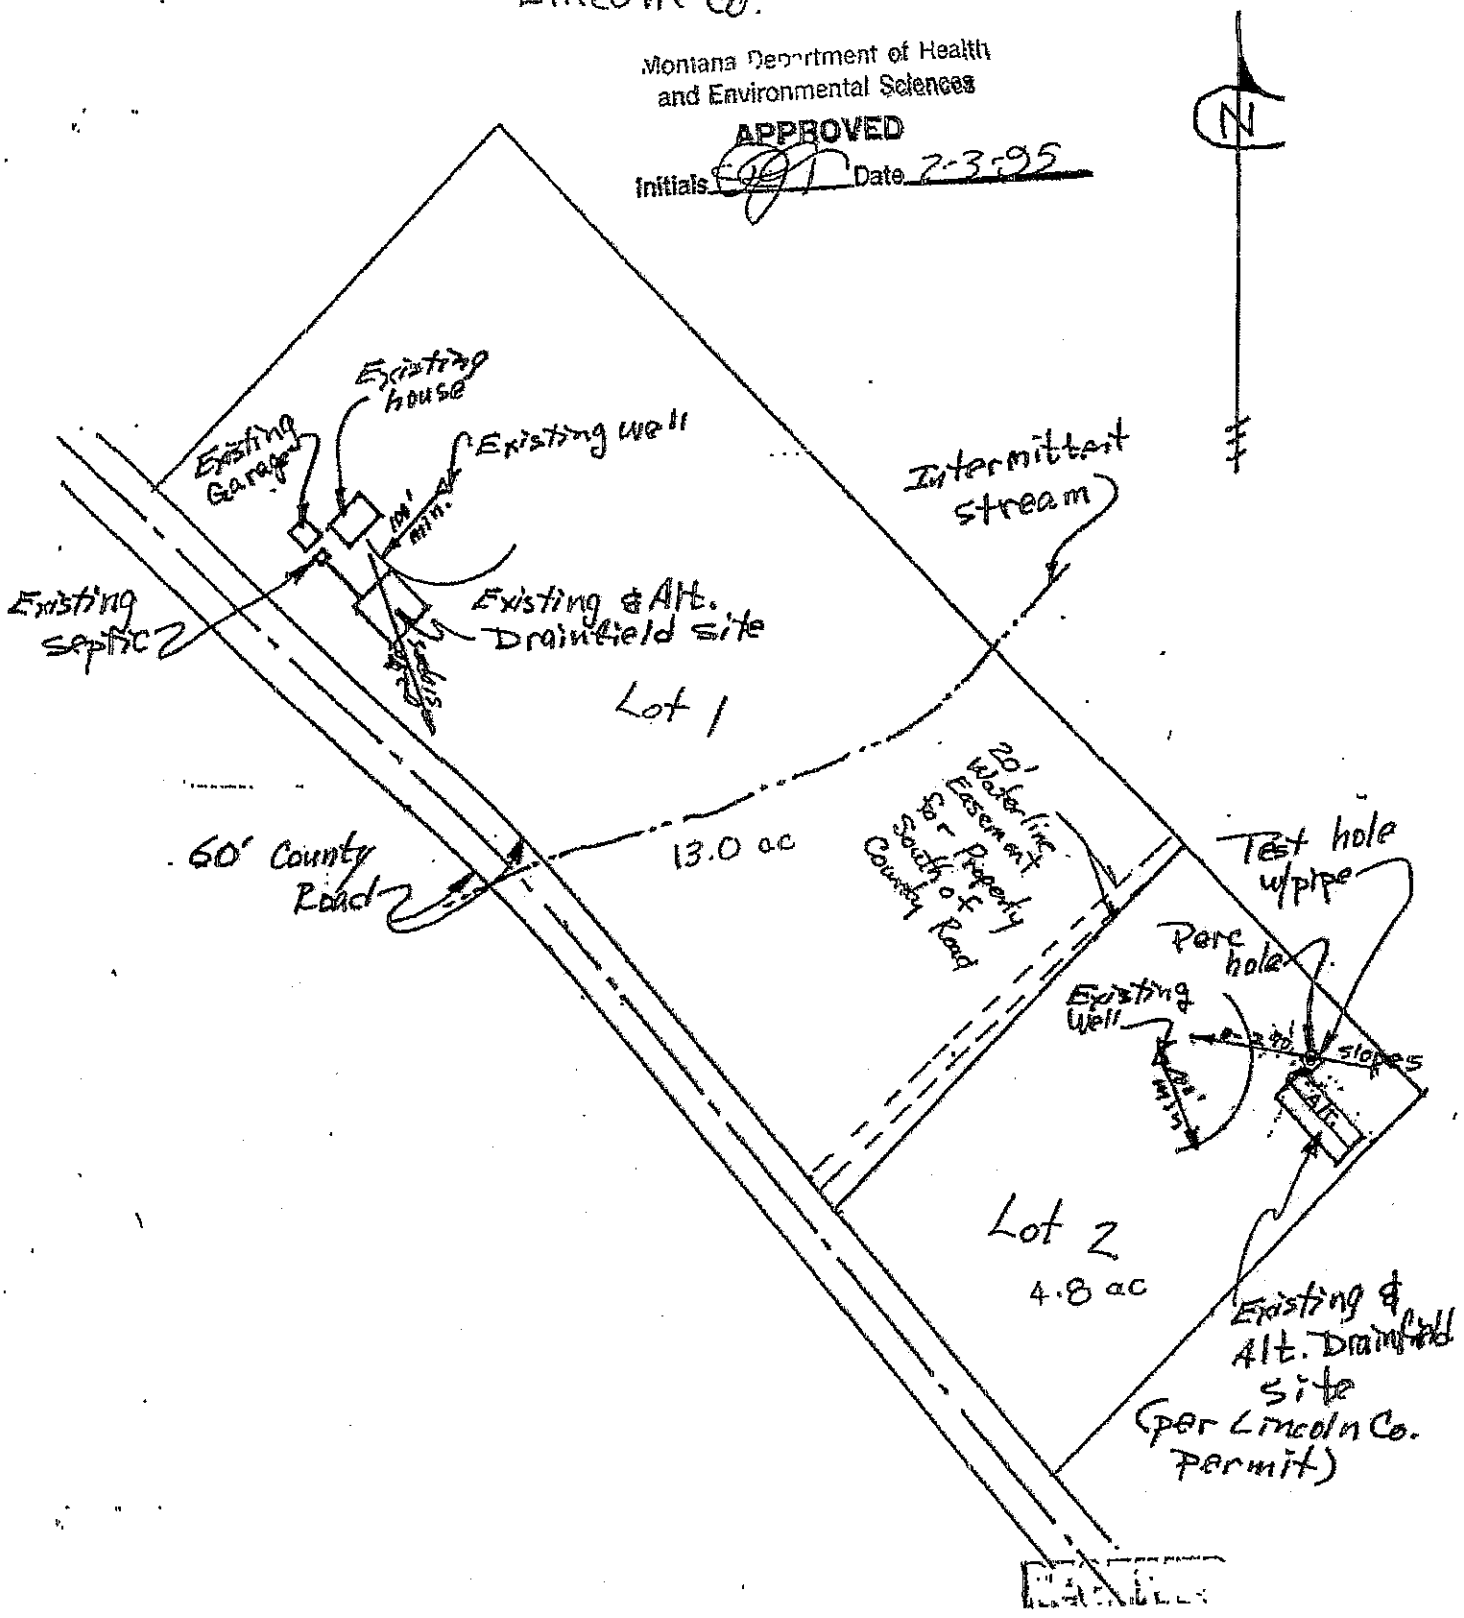

JAN 30 1995
MONTANA
DEPT. OF HEALTH & ENV. SCIENCES