LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/09/2023 Expiration Date: 06/08/2024

Property Owner: Michael and Laura Garner

Mailing Address: [redacted]

Telephone: [redacted] E-mail: [redacted]

Installer: Ole Blue Trucking License #: 159

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☒ Extension

Describe: Existing 1000 Gallon tank and 3 laterals@84' are being added on to accommodating 4 bedrooms. Additional 1000 Gallon tank to be added and 2 additional laterals @ 84' each.

Parcel Description:

Legal: S11, T35 N, R26 W, C.O.S. 3397, ACRES 5.01, TRACT 7 IN NENW

Property Address: 175 Hirschkorn Ln. Eureka, MT 59917 Assessment Code: 14269

DEQ COSA: EQ#05-1360 Date: 12/3/2023

Approved Design Criteria: Adding 1000 Gallon tank and 2 laterals@84' with chambers to existing system.

# of Bedrooms: 4	Septic Tank Size: 2@1000 gallons	Trench Width: 24"
# of Laterals: 5 Total	Length of Laterals: 84'	Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, S97

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

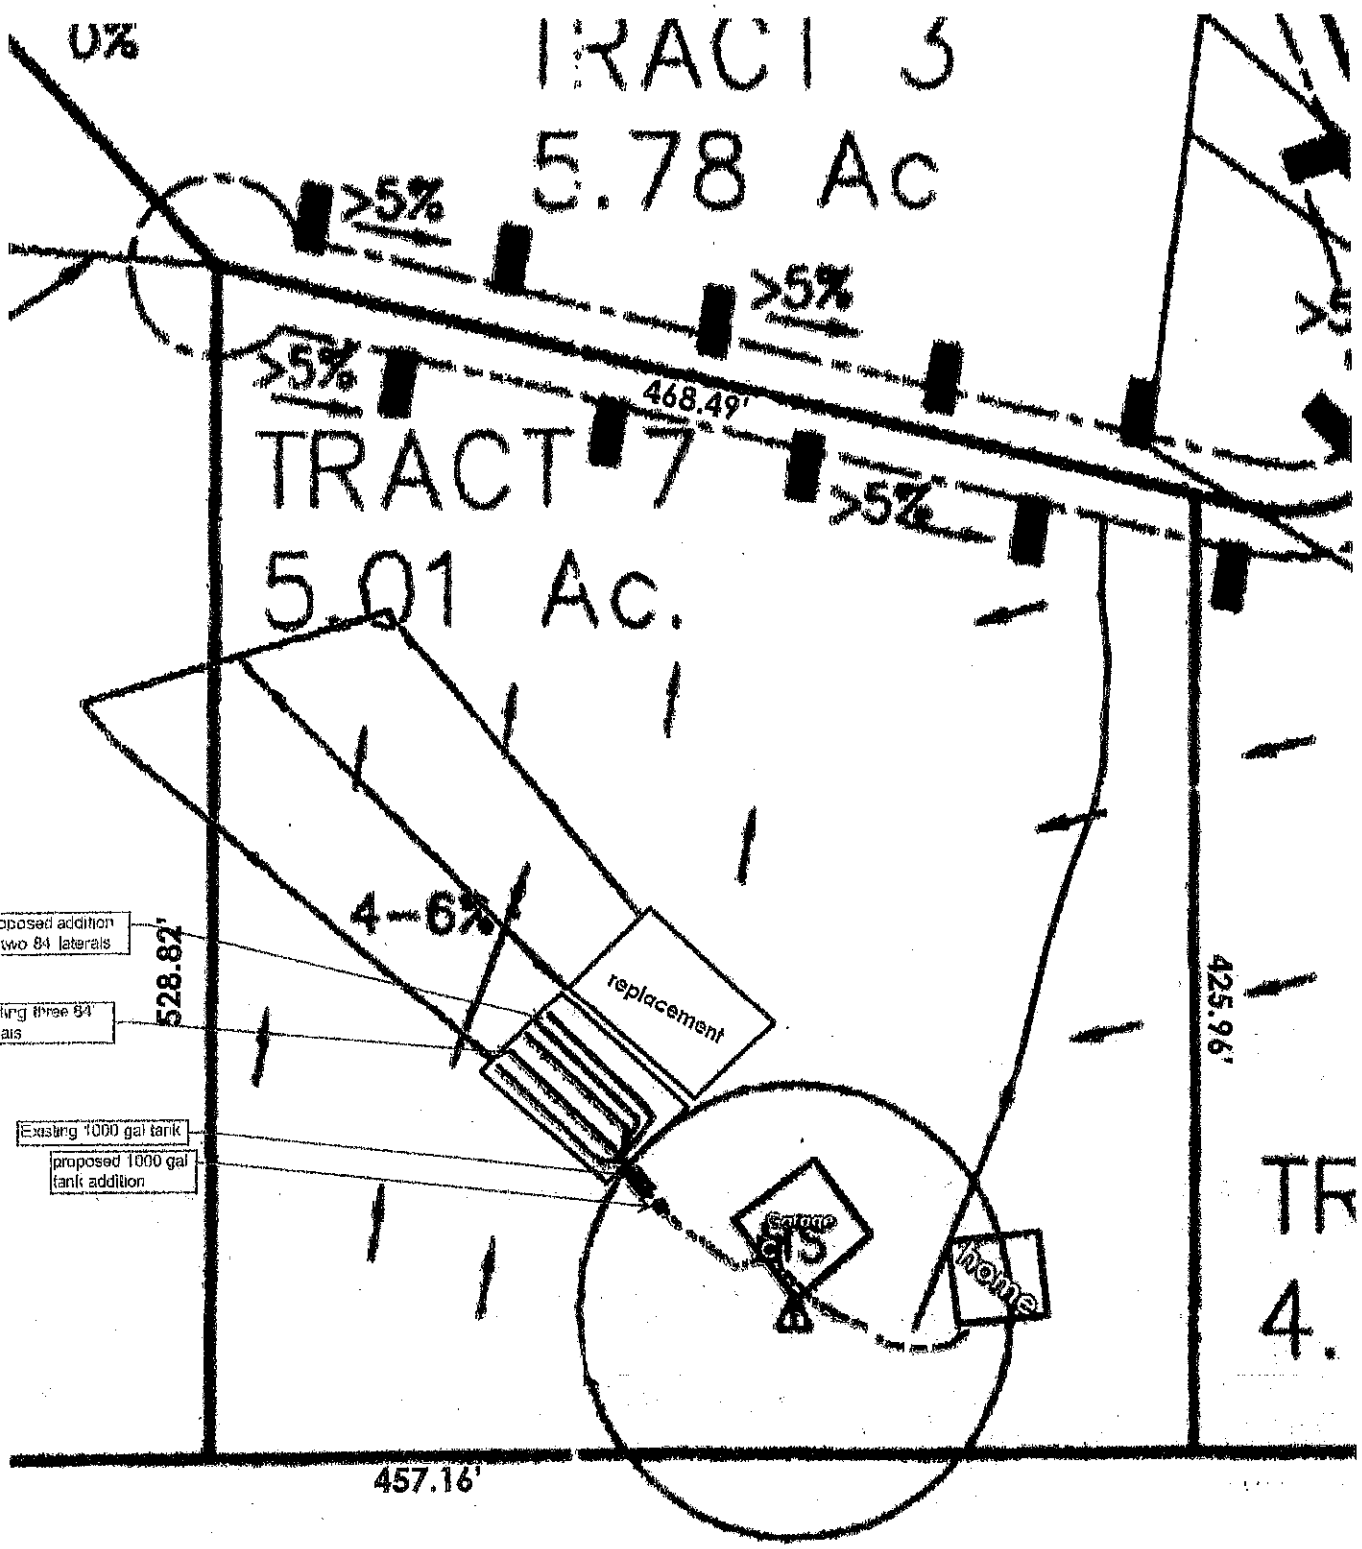
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 6/27/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


0%
TRACT 3
5.78 Ac
>5%
>5%
>5%
468.49'
TRACT 7
5.01 Ac.
>5%
4-6%
proposed addition of two 84' laterals
Existing three 84' laterals
528.82'
replacement
Existing 1000 gal tank
proposed 1000 gal tank addition
Garage
Home
425.96'
TR
4.
457.16'